



222 EAST 4TH AVENUE

PLANNING APPLICATION RESUBMITTAL SET
06/15/22



Sheet Index	
Sheet Number	Sheet Name
1-ARCHITECTURE	
A-000	COVER SHEET
A-001	SHEET INDEX
A-002	GENERAL NOTES AND PROJECT INFORMATION
A-003A	EGRESS AND OCCUPANCY
A-003B	EGRESS AND OCCUPANCY
A-004	PLUMBING FIXTURE CALCULATIONS
A-005	PARKING DETAILS
A-101	SITE PLAN
A-102	CONTEXT IMAGES
A-103	SHADOW STUDIES
A-201	LEVEL 1 FLOOR PLAN
A-202	LEVEL 2 FLOOR PLAN
A-203	LEVEL 3 FLOOR PLAN
A-204	LEVEL 4 FLOOR PLAN
A-205	LEVEL 5 FLOOR PLAN
A-206	LEVEL B1 FLOOR PLAN
A-207	LEVEL B2 FLOOR PLAN
A-210	RESIDENTIAL UNIT PLANS
A-220	DESIGN CONTEXT PLAN
A-231	LEVEL 1 VEHICLE TURNING ANALYSIS
A-232	LEVEL B1 & B2 VEHICLE TURNING ANALYSIS
A-301	RENDERING
A-302	RENDERING
A-303	RENDERING
A-304	RENDERING
A-305	RENDERING
A-306	MATERIALS
A-307	LINE OF SIGHT DIAGRAMS
A-311	BUILDING ELEVATIONS
A-312	BUILDING ELEVATIONS
A-321	BUILDING SECTIONS
A-322	BUILDING SECTIONS
A-401	ENLARGED ELEVATIONS AND SECTIONS
A-402	ENLARGED ELEVATIONS AND SECTIONS
2-CIVIL	
C1.00	EXISTING CONDITIONS PLAN
C1.01	DEMOLITION PLAN
C2.00	PRELIMINARY STREET LAYOUT PLAN
C2.01	TYPICAL SECTIONS
C3.00	PRELIMINARY GRADING AND DRAINAGE PLAN
C4.00	PRELIMINARY UTILITY PLAN
C5.00	PRELIMINARY STORMWATER QUALITY CONTROL PLAN
C5.01	PRELIMINARY STORMWATER QUALITY CONTROL NOTES
C5.02	PRELIMINARY LOW IMPACT DEVELOPMENT REDUCION CALCULATIONS
C6.00	VEHICLE TURNING ANALYSIS
C6.01	VEHICLE TURNING ANALYSIS
C6.02	DELIVERY TRUCK ARRIVAL ANALYSIS
3-LANDSCAPE	
L-002	TREE PROTECTION PLAN
L-003	TREE INVENTORY
L-004	TREE INVENTORY
L-005	TREE INVENTORY
L-006	TREE INVENTORY
L-100	LEVEL 1 LANDSCAPE PLAN
L-101	LEVEL 3 LANDSCAPE PLAN
L-102	LEVEL 4 LANDSCAPE PLAN
L-103	ROOFTOP LANDSCAPE PLAN
L-200	STREETSCAPE SECTIONS
L-201	LANDSCAPE RENDERINGS
L-202	LANDSCAPE RENDERINGS
L-203	LANDSCAPE RENDERINGS
L-204	LANDSCAPE RENDERINGS
L-205	LANDSCAPE MATERIALS AND FURNISHING IMAGES
L-300	SITE FURNISHING DETAILS
4-TRASH MANAGEMENT	
T0.1	SITE PLAN LEVEL 1
T0.2	KEY PLAN TYPICAL UPPER LEVEL
T0.3	STAGING DETAILS OFFICE / CAFETERIA
T0.4	STAGING DETAILS RESIDENTIAL AND GROCERY
T1.0	OFFICE / CAFETERIA TRASH COLLECTION ROOM LAYOUT
T1.1	RESIDENTIAL TRASH CLOSET LAYOUT
T1.2	GROCERY TRASH ROOM PROTOTYPE
5-CONSTRUCTION	
DEV-101	PRELIMINARY SITE LOGISTICS PLAN
6-ELECTRICAL	
EP-1	SITE LIGHTING PHOTOMETRIC CALCS
EP-2	LIGHT FIXTURE CUT SHEETS
EP-3	LIGHT FIXTURE CUT SHEETS
TOTAL SHEETS: 73	

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set
E	02/04/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
SHEET INDEX

SCALE

SHEET NUMBER

A-001

PROJECT DIRECTORY	
OWNER LANE PARTNERS 644 MENLO AVENUE, 2ND FLOOR MENLO PARK, CA 94025	MARCUS GILMOUR MARCUS@LANE-PARTNERS.COM 650-665-7085
CONSTRUCTION MANAGEMENT COMPASS SOLUTIONS	JASON SCHLUTT JSCHLUTT@COMPASSSOLUTIONSINC.COM 408-718-9614
ARCHITECT KORTH SUNSERI HAGEY ARCHITECTS	TED KORTH TKORTH@KSHA.COM 415-954-1960 X 230 JBLUM@KSHA.COM 415-954-1960 X 234
GEOTECHNICAL ENGINEER CORNERSTONE EARTH GROUP	NICHOLAS DEVLIN NDEVLIN@CORNERSTONEEARTH.COM 408-245-4600
CIVIL ENGINEER KIER AND WRIGHT	MARK KNUDSEN MKNUDSEN@KIERWRIGHT.COM 408-727-6665
LANDSCAPE ARCHITECT ANDREA COCHRAN LANDSCAPE ARCH	EMILY RYLANDER EMILY@ACOCCHRAN.COM 415-503-0060
TRASH MANAGEMENT CONSULTANT AMERICAN TRASH MANAGEMENT	SCOTT BROWN SBROWN@TRASHMAN.COM 415-292-5401

ABBREVIATIONS			
A.C.	ASPHALTIC CONCRETE	HOWD.	HARDWOOD
ACCD'G.	ACCORDING	H.M.	HOLLOW METAL
ACCOUS.	ACOUSTICAL	HT.	HEIGHT
A.D.	AREA DRAIN	H.W.	HOT WATER
ADD'L	ADDITIONAL	INSUL.	INSULATION
ADJ.	ADJACENT	JT.	JOINT
A.F.F.	ABOVE FINISH FLOOR	LAM.	LAMINATE
ALUM.	ALUMINUM	L.N.E.	LINE OF
ANOD.	ANODIZED	MAT.	MATERIAL
BD.	BOARD	MAX.	MAXIMUM
BDLG.	BUILDING	MECH.	MECHANICAL
BLK'G	BLOCKING	MEMB.	MEMBRANE
B.O.	BOTTOM OF	MFR.	MANUFACTURER
B.U.	BUILT UP	MFY.	MODIFY
CAB.	CABINET	MIN.	MINIMUM
CER.	CERAMIC	MTL.	METAL
CLG.	CEILING	N.I.C.	NOT IN CONTRACT
CLR.	CLEAR	N.S.	NOT TO SCALE
C.M.U.	CONCRETE MASONRY UNIT	(N)	NEW
C.O.	CLEANOUT	O.C.	ON CENTER
COL.	COLUMN	O.D.	OVERFLOW DRAIN
CONC.	CONCRETE	O.P.P.	OPPOSITE
COND.	CONDITION	P.G.	PAINT GRADE
CONTR.	CONTRACTOR	PLAS.	PLASTIC
CPT.	CARPET	P-LAM.	PLASTIC LAMINATE
C.T.	CERAMIC TILE	PLY.	PLYWOOD
C.W.	COLD WATER	POL.	POLISHED
DET.	DETAIL	P.T.	PRESSURE TREATED
D.F.	DOUBLE FIR	PTD.	PAINTED
DIA.	DIAMETER	PTN.	PARTITION
DIM.	DIMENSION	R.	RADIUS
D.S.	DOWNSPOUT	R.D.	ROOF DRAIN
DWG.	DRAWING	R.RINF.	REINFORCED
EA	EACH	REQ'D.	REQUIRED
ELEC.	ELECTRICAL OR ELECTRIC	R.O.	ROUGH OPENING
ELEV.	ELEVATOR	RM.	ROOM
ENCL.	ENCLOSURE	S.C.D.	SEE CIVIL DRAWINGS
EQ.	EQUAL	S.E.D.	SEE ELECTRICAL DRAWINGS
(E)	EXISTING	S.L.D.	SEE LANDSCAPE DRAWINGS
EXH.	EXHAUST	S.M.D.	SEE MECHANICAL DRAWINGS
EXT.	EXTERIOR	S.P.D.	SEE PLUMBING DRAWINGS
F.A.	FIRE ALARM PULL STATION	S.S.D.	SEE STRUCTURAL DRAWINGS
FDN.	FOUNDATION	SCHED.	SCHEDULE
FIN.	FINISH	S.G.	STAIN GRADE
F.D.	FLOOR DRAIN	S.S.	STAINLESS STEEL
FLOR.	FLUORESCENT	SIM.	SIMILAR
F.O.	FACE OF	SPEC.	SPECIFICATIONS
F.O.W.	FACE OF WALL	STL.	STEEL
F.R.	FIRE RATED	STRUCT.	STRUCTURAL
FRMG.	FRAMING	TEMP.	TEMPERATURE
FSTNRS.	FASTENERS	THK.	THICK
FTG.	FOOTING	TRANS.	TRANSPARENT
GA.	GAUGE	T.O.	TOP OF
GALV.	GALVANIZED	T.O.P.	TOP OF PLATE
GDN.	GARDEN	T.S.	TOP OF STEEL
GL.	GLASS	T.W.	TOP OF WALL
G.S.M.	GALVANIZED SHEET METAL	TYP.	TYPICAL
GYP. BD.	GYPSPUM BOARD	U.O.N.	UNLESS OTHERWISE NOTED
H.C.	HANDICAP	V.I.F.	VERIFY IN FIELD
HDR.	HEADER	WD.	WOOD
HDWR.	HARDWARE		

FLOOR AREA*	
FAR Floor Area	
Level	Area
OFFICE	
LEVEL 1	5,258 SF
LEVEL 2	39,968 SF
LEVEL 3	29,995 SF
LEVEL 4	29,332 SF
	104,554 SF
PARKING	
LEVEL 1	12,392 SF
	12,392 SF
RESIDENTIAL	
LEVEL 1	1,240 SF
LEVEL 5	7,757 SF
	8,997 SF
RETAIL	
LEVEL 1	17,658 SF
	17,658 SF
SHARED (ALL USES)	
LEVEL 1	4,296 SF
LEVEL 5	4,637 SF
	8,932 SF
TOTAL FAR AREA	152,533 SF

* PER SAN MATEO MUNICIPAL CODE SECTION 21.04.000
 1. FLOOR AREA IS MEASURED FROM THE EXTERIOR FAÇADE OF THE BUILDING'S WALL PLANES, FROM THE CENTERLINE OF PARTY WALLS, OR FROM A LINE THREE FEET FROM THE EDGE OF AN EAVE, WHICHEVER PRODUCES THE LARGEST FLOOR AREA. STORES EXCEEDING 15 FEET IN HEIGHT SHALL BE COUNTED AS ADDITIONAL FLOOR AREA, WITH THE EXCEPTION THAT GROUND FLOOR RETAIL MAY BE UP TO 18 FEET IN HEIGHT MEASURED FROM FIRST FINISH FLOOR TO SECOND FINISH FLOOR BEFORE BEING COUNTED AS ADDITIONAL FLOOR AREA. FLOOR AREA ALSO INCLUDES ALL ACCESSORY STRUCTURES ON THE SITE AND BASEMENTS THAT MEET THE DEFINITION IN SUBSECTION (G)(2).
 2. EXCLUSIONS: THE FOLLOWING ARE NOT COUNTED AS FLOOR AREA:
 a. COVERED OR OPEN COURTS, AND TERRACES, ON THE GROUND FLOOR, PROVIDED THAT THE AREA IS NOT USED AS DWELLING, OFFICE, RETAILING, OR REQUIRED ACCESS.
 b. IN MULTILEVEL BUILDINGS, COVERED COURTS, IF THE RETAILING USES ARE OPEN TO THE PUBLIC, MULTILEVEL STAIRWELLS AND ELEVATORS SHALL BE COUNTED ONLY AS GROUND FLOOR AREA.
 c. COVERED WALKWAYS AND BALCONIES.
 d. FIRST FLOORS, MECHANICAL AREAS, PENITENTIARY, AND TOP FLOORS ARE COUNTED ONLY ONCE AS FLOOR AREA, REGARDLESS OF HEIGHT.
 e. BICYCLE PARKING FACILITIES.
 f. FLOOR AREA DESIGNATED FOR DAY CARE CENTERS ACCESSORY TO AND INTENDED TO SERVE A MULTI-FAMILY, COMMERCIAL, OFFICE OR MANUFACTURING USE. SUCH FLOOR AREA MAY BE LOCATED WITHIN THE PRIMARY STRUCTURE OR MAY BE IN A FREESTANDING STRUCTURE ACCESSORY TO THE PRIMARY STRUCTURE.
 3. OFF-STREET PARKING AND LOADING FLOOR AREA FOR DETERMINING OFF-STREET PARKING AND LOADING REQUIREMENTS AS CONTAINED IN CHAPTER 27.04, SHALL BE BASED ON PHYSICAL FLOOR SPACE AND SHALL NOT INCLUDE THE FOLLOWING:
 a. STORAGE AREAS EXCEPT FOR AREAS LOCATED WITHIN SELLING OR WORKING SPACE SUCH AS COUNTERS, RACKS, AND CLOSETS.
 b. UTILITY AREAS INCLUDING, BUT NOT LIMITED TO, ELEVATOR SHAFTS, TELEPHONE SWITCHING ROOMS, STAIRWELLS, REST ROOMS, AND HEATING AND COOLING ROOMS.
 c. ACCESSORY FACILITIES TO BE USED ONLY BY EMPLOYEES OF THE PRINCIPAL USES.
 d. OFF-STREET PARKING AND LOADING FACILITIES, INCLUDING AISLES, RAMPS, AND MANEUVERING SPACE.
 e. BASEMENT, ATTIC, OR MEZZANINE FLOOR AREA OTHER THAN AREA DEVOTED TO RETAILING ACTIVITIES, TO THE PRODUCTION OF PROCESSING OF GOODS, OR TO BUSINESS OR PROFESSIONAL OFFICES.
 f. FLOOR AREA DESIGNATED FOR DAY CARE CENTERS ACCESSORY TO AND INTENDED TO SERVE A MULTI-FAMILY, COMMERCIAL, OFFICE OR MANUFACTURING USE. SUCH FLOOR AREA MAY BE LOCATED WITHIN THE PRIMARY STRUCTURE OR MAY BE IN A FREESTANDING STRUCTURE ACCESSORY TO THE PRIMARY STRUCTURE.
 g. FLOOR AREA COMMITTED FOR BUILDING VOLUME. ADDITIONAL PARKING SHALL BE REQUIRED IN THE EVENT OF CHANGE OF EXCLUDED FLOOR AREAS INTO USES GENERATING PARKING.

SCOPE OF WORK													
DEMOLISH THE EXISTING BUILDING AT 222 E. 4TH AVENUE BETWEEN ELLSWORTH AVENUE AND B STREET. CONSTRUCT A NEW FIVE-STORY BUILDING WITH TWO LEVELS OF BELOW-GRADE PARKING. THE BUILDING HOUSES 104,554 SF OF OFFICE SPACE, 17,658 SF OF RETAIL SPACE, AND 8,997 SF OF RESIDENTIAL SPACE (INCLUDING 10 RESIDENTIAL UNITS); THE PARKING GARAGE INCLUDES 12,392 SF ABOVE GRADE AND 89,519 SF BELOW GRADE, AND PROVIDES A TOTAL OF 221 PHYSICAL PARKING SPACES. THERE ARE TWO OUTDOOR TERRACES AT LEVEL 3, TWO TERRACES AT LEVEL 4, AND A ROOF DECK TOTALING 14,821 SF. THERE IS ALSO 1,515 SF OF COMMON USABLE OPEN SPACE ON A ROOF LEVEL FOR THE RESIDENTIAL TENANTS.													
PLANNING INFORMATION													
1. SITE ASSESSOR'S PARCEL NUMBERS ZONING DOWNTOWN AREA PLAN PARKING SITE AREA	034-176-050, 034-176-070, 034-176-080, 034-176-090 CBD/R DOWNTOWN RETAIL CORE LIMITED PARKING ZONE 49,478 SF												
2. BUILDING HEIGHT ALLOWABLE BUILDING HEIGHT PROPOSED BUILDING HEIGHT	55'-0" MAX* 72'-0"												
3. PARCEL COVERAGE AND OPEN SPACE ALLOWABLE PARCEL COVERAGE PROPOSED PARCEL COVERAGE	100% SEE "PARCEL COVERAGE"												
REQUIRED OPEN SPACE 1% OF FAR AREA EXCLUDING RESIDENTIAL AND PARKING	1,317 SF												
PROPOSED OPEN SPACE	1,455 SF												
REQUIRED COMMON USABLE OPEN SPACE PROPOSED COMMON USABLE OPEN SPACE	120 SF PER UNIT = 1,200 SF 1,515 SF												
4. FLOOR AREA MAX F.A.R. ALLOWABLE FLOOR AREA PROPOSED FLOOR AREA	3.0 148,434 SF SEE "FLOOR AREA"												
5. PARKING OFFICE REQUIRED RETAIL REQUIRED TOTAL REQUIRED TOTAL PARKING PROVIDED	<table border="1"> <tr> <td>TOTAL</td> <td>EVCS-READY</td> <td>EVCS</td> </tr> <tr> <td>171</td> <td>18</td> <td>9</td> </tr> <tr> <td>37</td> <td>4</td> <td>2</td> </tr> <tr> <td>208</td> <td>22</td> <td>11</td> </tr> </table> SEE "PARKING SUMMARY"	TOTAL	EVCS-READY	EVCS	171	18	9	37	4	2	208	22	11
TOTAL	EVCS-READY	EVCS											
171	18	9											
37	4	2											
208	22	11											
6. BIKE PARKING TOTAL OFFICE REQUIRED RETAIL REQUIRED RESIDENTIAL REQUIRED TOTAL BIKE PARKING PROVIDED	<table border="1"> <tr> <td>SHORT TERM</td> <td>LONG TERM</td> <td>TOTAL</td> </tr> <tr> <td>5</td> <td>10</td> <td>15</td> </tr> <tr> <td>9</td> <td>1</td> <td>10</td> </tr> <tr> <td>15</td> <td>21</td> <td>36</td> </tr> </table> SEE "BIKE PARKING SUMMARY"	SHORT TERM	LONG TERM	TOTAL	5	10	15	9	1	10	15	21	36
SHORT TERM	LONG TERM	TOTAL											
5	10	15											
9	1	10											
15	21	36											
*AN ADDITIONAL 33 OR 3 STORES IS ALLOWED PER GOVERNMENT CODE § 65916(a)(2)(D)													


ISSUE HISTORY			
DATE	DESCRIPTION	DATE	DESCRIPTION
05/05/20	PRE-APPLICATION SET		
10/21/20	PRE-APPLICATION RESUBMITTAL SET		
03/19/21	PRE-APPLICATION RESUBMITTAL SET		
10/15/21	PLANNING APPLICATION SET		
02/04/22	PLANNING APPLICATION RESUBMITTAL SET		
04/22/22	PLANNING APPLICATION RESUBMITTAL SET		
06/15/22	PLANNING APPLICATION RESUBMITTAL SET		

GENERAL NOTES	
1. ALL WORK SHALL CONFORM TO THE CONTRACT DOCUMENTS WHICH INCLUDE THE OWNER/CONTRACTOR AGREEMENT, THE DRAWINGS, AND ALL ADDENDA AND MODIFICATIONS TO THE CONTRACT ARCHITECT.	
2. THE CONTRACTOR SHALL REVIEW ALL DOCUMENTS AND VERIFY ALL DIMENSIONS AND FIELD CONDITIONS AND CONFIRM THAT WORK IS BUILDABLE AS SHOWN. ANY CONFLICTS OR OMISSIONS SHALL BE IMMEDIATELY REPORTED TO THE ARCHITECT FOR CLARIFICATION PRIOR TO THE PERFORMANCE OF ANY WORK IN QUESTION.	
3. IN CASE OF CONFLICT BETWEEN ARCHITECTS' AND ENGINEER'S DRAWINGS IN LOCATING MATERIALS AND/OR EQUIPMENT, THE ARCHITECT'S DRAWINGS SHALL GOVERN.	
4. "ALIGN" SHALL MEAN TO ACCURATELY LOCATE FINISH SURFACES IN THE SAME PLANE.	
5. "TYPICAL" OR "TYP" SHALL MEAN THAT THE CONDITION IS REPRESENTATIVE FOR SIMILAR CONDITIONS THROUGHOUT. DETAILS ARE USUALLY KEYED AND NOTED "TYP" ONLY ONCE, WHEN THEY FIRST OCCUR.	
6. "SIMILAR" OR "SIM" MEANS COMPARABLE CHARACTERISTICS FOR THE CONDITIONS NOTED. VERIFY DIMENSIONS AND ORIENTATION ON PLANS AND ELEVATIONS.	
7. WORK AREAS TO REMAIN SECURE AND LOCKABLE DURING CONSTRUCTION. CONTRACTOR SHALL COORDINATE WITH LANDLORD AND TENANT TO ENSURE SECURITY.	
8. THE CONTRACTOR SHALL OBTAIN ALL PERMITS AND INSPECTIONS AND COMPLY WITH ALL CODES, LAWS, ORDINANCES, RULES AND REGULATIONS OF ALL PUBLIC AUTHORITIES (FEDERAL, STATE OR LOCAL) GOVERNING THE WORK. THE MOST STRINGENT SHALL APPLY.	
9. ALL WORK NOTED "BY OTHERS" OR "N.I.C." SHALL BE PROVIDED BY THE OWNER OR TENANT UNDER SEPARATE CONTRACT. INCLUDE SCHEDULE REQUIREMENTS FOR THIS "OTHER" WORK IN THE CONSTRUCTION PROGRESS SCHEDULE AND COORDINATE AS REQUIRED TO ASSURE ORDERLY SEQUENCE OF INSTALLATION.	
10. DO NOT SCALE THE DRAWINGS.	
11. CONTRACTOR SHALL REPAIR OR REPLACE ALL LANDSCAPE PLANTING AND IRRIGATION DAMAGED THROUGH THE COURSE OF CONSTRUCTION, REPLACE CONTAMINATED OR COMPACTED SOILS, PROTECT ALL TREES TO REMAIN WITH RIGID METAL FENCING, AND REPAIR ALL DAMAGED PAVING SURFACES IN KIND. CONTRACTOR RESPONSIBLE FOR THE HEALTH AND PROTECTION OF ALL PLANTS WITHIN THE PROJECT FENCE LINE.	
12. ALL DIMENSIONS SHALL BE TO THE FACE OF FINISH UNLESS OTHERWISE NOTED.	
13. DESIGN OF AUTOMATED SPRINKLER SYSTEM, SMOKE DETECTION SYSTEM, AND FIRE ALARM & COMMUNICATION SYSTEM SHALL BE PER CODE. SEE MECHANICAL, ELECTRICAL, PLUMBING AND FIRE PROTECTION DRAWINGS AND DOCUMENTS.	
14. THE BUILDING FIRE SPRINKLER SYSTEM SHALL BE MAINTAINED AND OPERATIONAL AT ALL TIMES DURING CONSTRUCTION ONCE COMPLETED. WHEN RENOVATIONS REQUIRE MODIFICATION OF A PORTION OF A FIRE PROTECTION SYSTEM, THE REMAINDER OF THE SYSTEM SHALL BE KEPT IN SERVICE. WHEN IT IS NECESSARY TO SHUT DOWN THE ENTIRE SYSTEM, A FIRE WATCH SHALL BE KEPT ON SITE UNTIL THE SYSTEM IS RETURNED TO SERVICE IN COMPLIANCE WITH CFC SECTION 3304.5 & NFPA 241 SECTION 10.8.	
15. EXIT SIGNS, EMERGENCY LIGHTING, ADDRESS POSTING, FIRE LANE MARKING, FIRE EXTINGUISHERS AND KNOX BOX LOCATION(S) TO BE FIELD VERIFIED BY FIRE INSPECTOR.	

PARKING SUMMARY		
Office Parking Schedule		
	Count	Dimensions
LEVEL 1		
ACCESSIBLE STALL - VAN	1	9'-0" x 18'-0"
COMPACT STALL	3	8'-0" x 17'-0"
STANDARD STALL	16	8'-6" x 18'-0"
LEVEL B1		
ACCESSIBLE STALL - STANDARD	5	9'-0" x 18'-0"
ACCESSIBLE STALL - VAN	1	9'-0" x 18'-0"
COMPACT STALL	14	8'-0" x 17'-0"
EVCS - ACCESSIBLE	1	9'-0" x 18'-0"
EVCS - AMBULATORY	1	10'-0" x 18'-0"
EVCS - VAN ACCESSIBLE	1	12'-0" x 18'-0"
STANDARD STALL	31	8'-6" x 18'-0"
LEVEL B2		
COMPACT STALL	33	8'-0" x 17'-0"
EVCS - STANDARD	24	8'-6" x 18'-0"
STANDARD STALL	53	8'-6" x 18'-0"
TOTAL	184	
Retail Parking Schedule		
	Count	Dimensions
LEVEL B1		
RETAIL - ACCESSIBLE STALL - STANDARD	1	9'-0" x 18'-0"
RETAIL - ACCESSIBLE STALL - VAN	1	9'-0" x 18'-0"
RETAIL - COMPACT STALL	12	8'-0" x 17'-0"
RETAIL - EVCS - ACCESSIBLE	1	9'-0" x 18'-0"
RETAIL - EVCS - STANDARD	4	8'-6" x 18'-0"
RETAIL - EVCS - VAN ACCESSIBLE	1	12'-0" x 18'-0"
RETAIL - STANDARD STALL	17	8'-6" x 18'-0"
TOTAL	37	
Bike Parking Summary		
	Count	
COMMERCIAL - LONG TERM	10	
COMMERCIAL - SHORT TERM	5	
RESIDENTIAL - LONG TERM	10	
RESIDENTIAL - SHORT TERM	1	
RETAIL - LONG TERM	1	
RETAIL - SHORT TERM	14	
TOTAL	41	



FIRE DEPARTMENT NOTES

- EMERGENCY RESPONDER RADIO COVERAGE - AN EMERGENCY RESPONDER RADIO COVERAGE SYSTEM MAY BE REQUIRED FOR THIS BUILDING. TESTING SHOULD OCCUR PRIOR TO CONSTRUCTION DUE TO CIRCUIT PROTECTION REQUIREMENTS THAT WILL AFFECT BUILDING DESIGN, A THIRD PARTY TESTING GRID REPORT SHALL BE PROVIDED TO THE SAN MATEO CONSOLIDATED FIRE DEPARTMENT BEFORE THE FINAL INSPECTION. (FIRE)
- BARRICADES ACROSS EMERGENCY ACCESS ROADS - THE INSTALLATION OR USE OF BARRICADES, FENCES, OR GATES ACROSS EMERGENCY VEHICLE ACCESS ROADS DURING CONSTRUCTION SHALL HAVE PRIOR APPROVAL OF THE SAN MATEO CONSOLIDATED FIRE CHIEF, OR HIS/HER DESIGNEE. (FIRE)
- FIRE SPRINKLER SYSTEM - THE APPLICANT SHALL INSTALL A FIRE SPRINKLER SYSTEM THROUGHOUT THE SINGLE-FAMILY DWELLING IN ACCORDANCE WITH NFPA 13D OR THE CALIFORNIA RESIDENTIAL CODE. FIRE SPRINKLER PLANS SHALL BE A DEFERRED SUBMITTAL. THE FIRE SPRINKLER PLANS ARE SUBJECT TO REVIEW AND APPROVAL BY THE FIRE MARSHAL OR HIS/HER DESIGNEE PRIOR TO ISSUANCE OF A FIRE SPRINKLER PERMIT. (FIRE)
- REMOTE POWER DISCONNECT - PROVIDE A KEY SWITCH TO DISCONNECT (SHUNT) THE BUILDING ELECTRICAL POWER BY FIRE DEPARTMENT PERSONNEL. CONTACT THE BUREAU OF FIRE PROTECTION AND LIFE SAFETY TO COORDINATE THE EXACT LOCATION FOR SUCH DEVICES. THE KEY SWITCH LOCATION SHALL BE SUBMITTED TO THE FIRE MARSHAL OR HIS/HER DESIGNEE FOR REVIEW AND APPROVAL PRIOR TO THE FINAL INSPECTION. (FIRE)
- CODE CONFORMANCE - THE APPLICANT SHALL INDICATE ON ALL BUILDING PERMIT PLANS THAT ALL CONSTRUCTION SHALL MEET CURRENT CODE STANDARDS AT THE TIME OF BUILDING PERMIT SUBMITTAL. THE BUILDING PERMIT PLANS ARE SUBJECT TO REVIEW AND APPROVAL BY THE FIRE MARSHAL OR HIS/HER DESIGNEE PRIOR TO ISSUANCE OF THE BUILDING PERMIT. (FIRE)
- WATER SUPPLY - ALL CITY/DISTRICT OWNED WATER SYSTEMS AND ON-SITE WATER SYSTEMS SHALL BE LOOPED WITH TWO POINTS OF CONNECTION TO THE SATISFACTION OF THE CITY ENGINEER. THEY SHALL MEET THE REQUIREMENTS OF STATE DEPARTMENT OF HEALTH SERVICES, CITY PUBLIC WORKS AND THE FIRE MARSHAL. THE WATER SUPPLY INFORMATION SHALL BE SUBMITTED TO THE FIRE MARSHAL OR HIS/HER DESIGNEE FOR REVIEW AND APPROVAL PRIOR TO THE ISSUANCE OF THE BUILDING PERMIT. (FIRE)
- DEMOLITION - BUILDING(S) UNDER CONSTRUCTION OR DEMOLITION SHALL COMPLY WITH THE CALIFORNIA FIRE CODE CH. 33 DURING ALL PHASES OF CONSTRUCTION OF THE PROJECT. (FIRE)
- EGRESS - ADJACENT BUILDINGS/PROPERTIES SHALL NOT HAVE THEIR REQUIRED EGRESS RESTRICTED OR COMPROMISED AT ANY TIME DURING THE CONSTRUCTION OF THIS PROJECT. (FIRE)
- SUBMITTALS - THE APPLICANT SHALL SUBMIT ALL FIRE PLANS IN CONJUNCTION WITH THE SUPERSTRUCTURE BUILDING PERMIT PLANS. THE PLANS ARE SUBJECT TO REVIEW AND APPROVAL BY THE FIRE MARSHAL OR HIS/HER DESIGNEE PRIOR TO ISSUANCE OF THE SUPERSTRUCTURE BUILDING PERMIT PLANS. (FIRE)
- STANDPIPES - IN BUILDINGS REQUIRED TO HAVE STANDPIPES BY SECTION 905.3.1, NOT LESS THAN ONE STANDPIPE SHALL BE PROVIDED FOR USE DURING CONSTRUCTION OR DEMOLITION. (FIRE)
- FIRE HYDRANTS - THE APPLICANT SHALL INSTALL PUBLIC/PRIVATE FIRE HYDRANT(S) SPACED AS PER THE SMC FIRE ORDINANCE. ALL FIRE HYDRANTS USED FOR FIRE FLOW FOR THE PROJECT SITE SHALL BE UPGRADED TO A CLOW MODEL 960 OR EQUIVALENT CONSISTING OF (2) 2 1/2 INCH AND (1) 4 1/2 INCH OUTLET. EACH HYDRANT SHALL BE CAPABLE OF PROVIDING A MINIMUM FIRE FLOW OF 1500 GPM AT 20 PSI RESIDUAL PRESSURE. WATER SUPPLY FOR FIRE PROTECTION IS REQUIRED TO BE INSTALLED IN ACCORDANCE WITH WATER PURVEYOR'S SPECIFICATIONS. THE WATER SUPPLY SHALL BE TESTED, FLUSHED AND APPROVED OPERABLE PRIOR TO ANY COMBUSTIBLE CONSTRUCTION MATERIALS BEING PLACED ON THE SITE. STAGED CONSTRUCTION SHALL INSURE THAT THE NECESSARY WATER SUPPLY IS MAINTAINED FROM STAGE TO STAGE IN THE CONSTRUCTION PLANNING. THE LETTER SHALL BE SUBMITTED TO THE FIRE MARSHAL OR HIS/HER DESIGNEE FOR REVIEW AND APPROVAL BEFORE THE ISSUANCE OF A FIRE SPRINKLER PERMIT. (FIRE)
- FIRE FLOW - THE APPLICANT SHALL PROVIDE A FIRE FLOW OF GPM FOR HOURS. THE FIRE FLOW INFORMATION SHALL BE SUBMITTED TO THE FIRE MARSHAL OR HIS/HER DESIGNEE FOR REVIEW AND APPROVAL PRIOR TO THE ISSUANCE OF THE BUILDING PERMIT. (FIRE)
- ADDRESS NUMBERS - THE APPLICANT SHALL POST TEMPORARY ADDRESS NUMBERS ON EACH BUILDING AT THE PROJECT SITE THAT MUST BE EASILY VISIBLE FROM THE STREET OR FIRE ACCESS ROAD DURING ALL PHASES OF CONSTRUCTION OF THE PROJECT. (FIRE)
- FIRE CONTROL ROOM - AN APPROVED FIRE CONTROL ROOM SHALL BE PROVIDED FOR THIS BUILDING. THERE SHALL BE DIRECT ACCESS TO THE ROOM DIRECTLY FROM THE EXTERIOR OF THE BUILDING. REFER TO LOCAL ORDINANCE FOR DETAILS. THE FIRE CONTROL ROOM SHALL BE INDICATED ON THE BUILDING PERMIT SET OF PLANS SUBMITTED TO THE FIRE MARSHAL OR HIS/HER DESIGNEE FOR REVIEW AND APPROVAL PRIOR TO THE ISSUANCE OF THE BUILDING PERMIT. (FIRE)

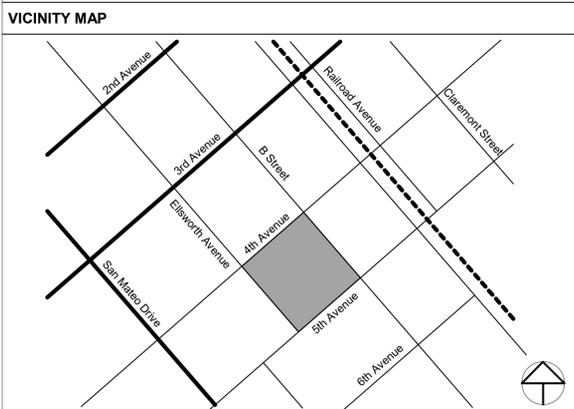



VICINITY MAP	
VICINITY MAP	

BUILDING INFORMATION	
1. CONSTRUCTION TYPE (CBC CH. 6)	TYPE 1B
2. USE AND OCCUPANCY (CBC CH. 3)	A-3, B, M, R-2, S-2
3. ALLOWABLE HEIGHT (CBC TABLE 504.3+4)	180' / 12 STORIES (A-3) 180' / 12 STORIES (B) 180' / 12 STORIES (M) 180' / 12 STORIES (R-2) 180' / 12 STORIES (S-2)
4. ALLOWABLE AREA (CBC TABLE 506.2)	UL (A-3) TABULATED MAX AREA UL (M) UL (R-2) 237,000 SF (S-2) - MOST RESTRICTIVE
5. ALLOWABLE BUILDING AREA (CBC SEC 506)	UNLIMITED
PER CBC 503.1.4, THE AREA OF OCCUPIED ROOFS SHALL NOT BE INCLUDED IN THE BUILDING AREA AS REGULATED BY SECTION 506.	
PER CBC 506.1.3, LEVELS B1 AND B2 ARE CONSIDERED BASEMENTS. THE CUMULATIVE AREA OF THE TWO BASEMENT LEVELS ARE LESS THAN THE ALLOWABLE AREA FOR A SINGLE STORY GROUP S-2 OCCUPANCY AND THEREFORE NEED NOT BE INCLUDED IN THE TOTAL ALLOWABLE FLOOR AREA OF A BUILDING.	
6. PROPOSED HEIGHT AND GROSS FLOOR AREA (CBC CHAPTER 2)	5 STORIES 72'-0"
STORIES ABOVE GRADE:	5 STORIES
MAXIMUM HEIGHT ABOVE GRADE:	72'-0"
GROSS FLOOR AREA:	
Gross Floor Area (Per CBC Ch. 2)	
Level	Area
LEVEL 5	12,205 SF
LEVEL 4	30,684 SF
LEVEL 3	31,087 SF
LEVEL 2	40,841 SF
LEVEL 1	39,380 SF
TOTAL	154,196 SF
7. RATING REQUIREMENTS (CBC TABLE 601)	
PRIMARY STRUCTURAL FRAME:	2 HOURS
EXTERIOR BEARING WALLS:	2 HOURS
INTERIOR BEARING WALLS:	2 HOURS
EXTERIOR NONBEARING WALLS:	0 HOURS
INTERIOR NONBEARING WALLS:	0 HOURS
FLOOR CONSTRUCTION:	2 HOURS
ROOF CONSTRUCTION:	2 HOURS
SHAFT ENCLOSURES	2 HOURS
PER CBC 713.4, SHAFT ENCLOSURES SHALL HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 2 HOURS WHERE CONNECTING FOUR STORIES OR MORE, AND NOT LESS THAN 1 HOUR WHERE CONNECTING LESS THAN FOUR STORIES. THE NUMBER OF STORES CONNECTED BY THE SHAFT ENCLOSURE SHALL INCLUDE ANY BASEMENTS BUT NOT ANY MEZZANINES. SHAFT ENCLOSURES SHALL HAVE A FIRE-RESISTANCE RATING NOT LESS THAN THE FLOOR ASSEMBLY PENETRATED, BUT NEED NOT EXCEED 2 HOURS.	
8. REQUIRED SEPARATIONS (CBC CH. 5)	
OCCUPANCY SEPARATION (LEVELS B2-4)	0 HOURS
PER CBC 506.3.2, THE PROPOSED BUILDING HEIGHT AND AREA FALLS WITHIN THE ALLOWABLE LIMITS OF THE MOST RESTRICTIVE USE. SO ALL OCCUPANCIES CAN BE CONSIDERED NONSEPARATED OCCUPANCIES. PER CBC 508.3.3, NO SEPARATION IS REQUIRED BETWEEN NONSEPARATED OCCUPANCIES.	
SEPARATIONS WALLS (LEVEL 5)	1 HOUR
PER CBC 420.2, WALLS SEPARATING DWELLING UNITS IN THE SAME BUILDING SHALL BE CONSTRUCTED AS FIRE PARTITIONS PER CBC 708.	
9. FIRE PROTECTION (CBC CH. 9)	
THIS BUILDING IS PROVIDED WITH AN AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH CBC 903.	
THIS BUILDING IS PROVIDED WITH AN EMERGENCY VOICE/ALARM COMMUNICATIONS SYSTEM IN ACCORDANCE WITH CBC 907.	
APPLICABLE CODES	
THE GENERAL CONTRACTOR IS RESPONSIBLE FOR COMPLETING THE CONSTRUCTION REQUIREMENTS OF THIS PROJECT IN ACCORDANCE WITH THE FOLLOWING FEDERAL, STATE AND LOCAL CODES, INCLUDING THEIR MOST RECENT AMENDMENTS AND REVISIONS.	
THE CITY OF SAN MATEO ADOPTS THE FOLLOWING CODES, ORDINANCES, RULES AND REGULATIONS (INCLUDING ERRATA AND SUPPLEMENTS OF	

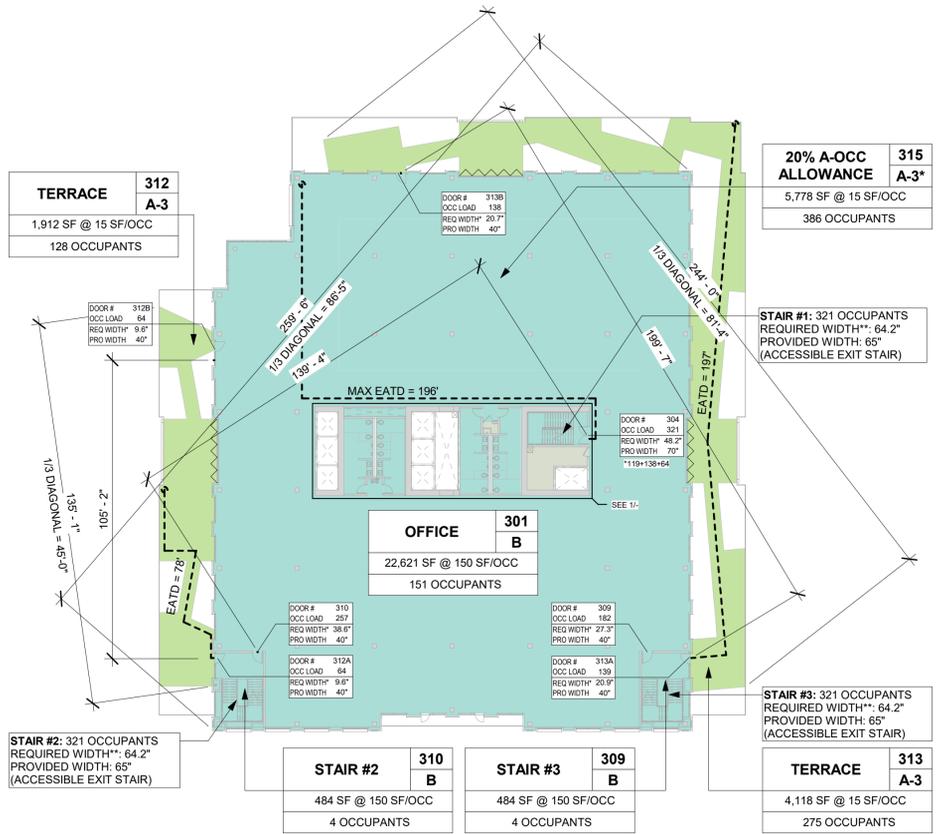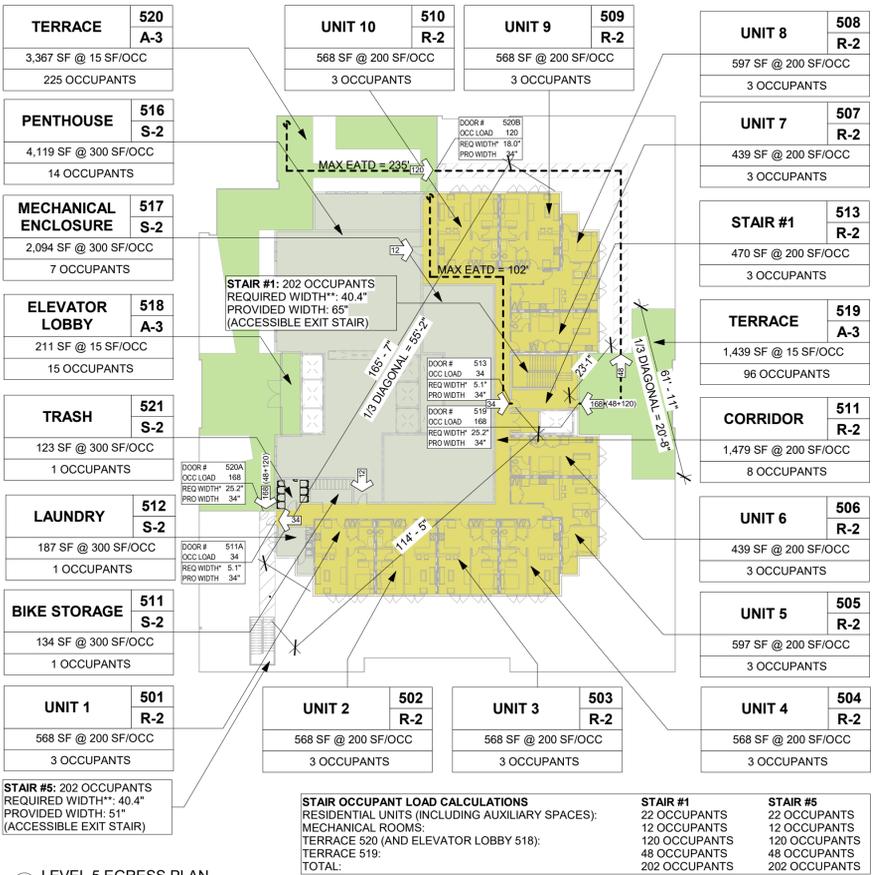

④ LEVEL 5 EGRESS PLAN
1" = 30'-0"

② LEVEL 3 EGRESS PLAN
1" = 30'-0"

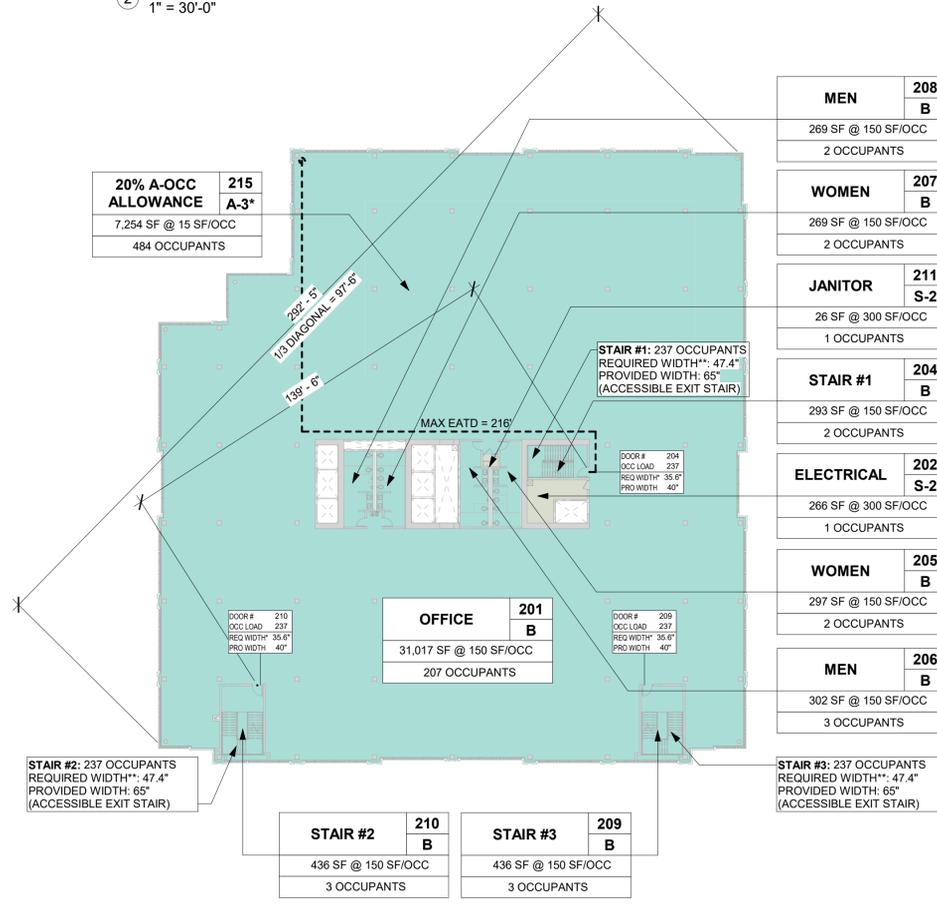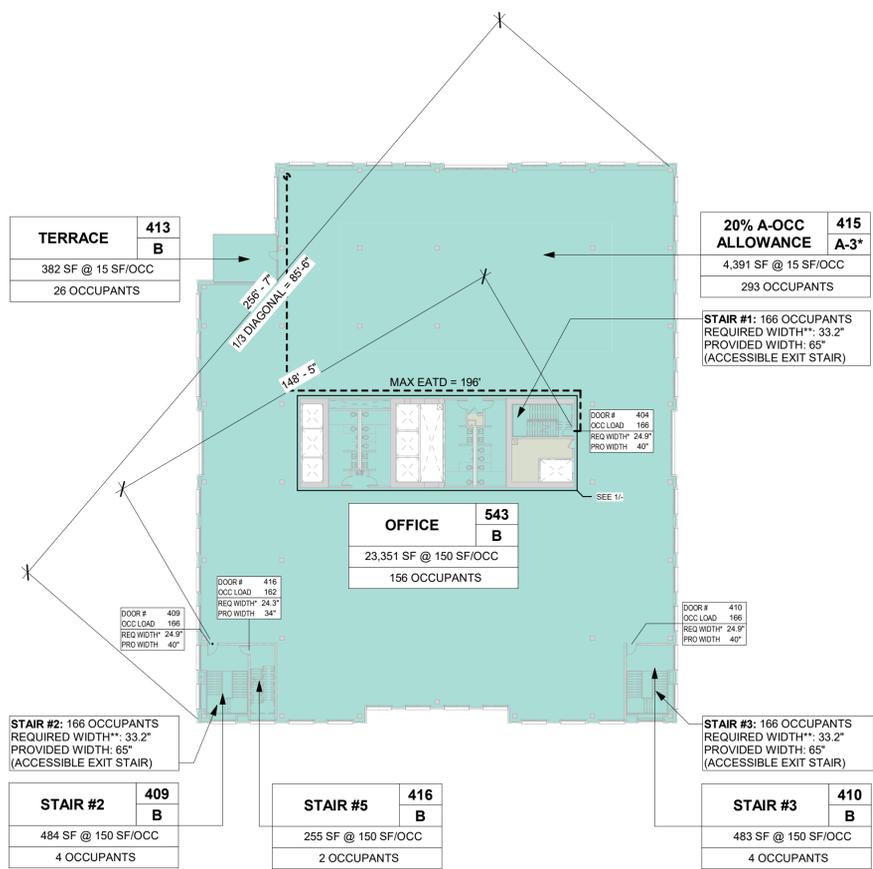

③ LEVEL 4 EGRESS PLAN
1" = 30'-0"

① LEVEL 2 EGRESS PLAN
1" = 30'-0"

EGRESS LEGEND

- PATH OF TRAVEL
- COMMON PATH OF TRAVEL
- ☆ POINT OF DECISION (END OF COMMON PATH OF TRAVEL)
- FEC FIRE EXTINGUISHER CABINET WITH MINIMUM 4A-40B:C FIRE EXTINGUISHER
- FE FIRE EXTINGUISHER (MINIMUM 4A-40B:C) FIRE INSPECTOR TO VERIFY LOCATION AT TIME OF ROUGH INSPECTION

EGRESS SUMMARY

CBC TABLE 1006.3.1 NUMBER OF EXITS PER STORY

TWO EXITS OR EXIT ACCESS DOORWAYS SHALL BE PROVIDED FROM ANY STORY WITH AN OCCUPANT LOAD GREATER THAN 1 AND LESS THAN 500. THREE EXITS OR EXIT ACCESS DOORWAYS SHALL BE PROVIDED FROM ANY SPACE WITH AN OCCUPANT LOAD GREATER THAN 500 AND LESS THAN 1,000.

CBC TABLE 1006.2.1 COMMON PATH OF EGRESS TRAVEL

MAX ALLOWABLE (SPRINKLERED):
75' FOR GROUP "A-3" AND "M" OCCUPANCIES
100' FOR GROUP "B" OCCUPANCY
125' FOR GROUP "R-2" OCCUPANCY
100' FOR GROUP "S-2" OCCUPANCY

CBC TABLE 1017.2 EXIT ACCESS TRAVEL DISTANCE

MAX ALLOWABLE (SPRINKLERED):
250' FOR GROUP "A-3" AND "M" OCCUPANCIES
300' FOR GROUP "B" OCCUPANCY
250' FOR GROUP "R-2" OCCUPANCY
400' FOR GROUP "S-2" OCCUPANCY

CBC 1005 MEANS OF EGRESS SIZING

IN BUILDINGS EQUIPPED WITH AN AUTOMATIC SPRINKLER SYSTEM AND AN EMERGENCY VOICE/ALARM COMMUNICATIONS SYSTEM:
1. THE CAPACITY OF EGRESS STAIRWAYS = 0.2' PER OCCUPANT SERVED*
2. THE CAPACITY OF ALL OTHER EGRESS COMPONENTS = 0.15' PER OCCUPANT SERVED**

* PER CBC 1005.2 AND 1005.3, THE MINIMUM WIDTH OF ALL CORRIDORS AND EXIT PASSAGEWAYS SHALL BE 4'-0". PER CBC 1010.1.1, ALL MEANS OF EGRESS DOORS SHALL PROVIDE A MINIMUM CLEAR OPENING OF 32" AND A MAXIMUM DOOR LEAF HEIGHT OF 48". ALL MEANS OF EGRESS DOORS SHALL PROVIDE A MINIMUM CLEAR OPENING HEIGHT OF 80".
** PER CBC 1011.2, THE MINIMUM WIDTH OF ALL EGRESS STAIRWAYS SHALL BE 44".

CBC TABLE 1004.5
MAXIMUM FLOOR AREA ALLOWANCES PER OCCUPANT

Occupancy	Egress Schedule Levels 2-Roof		
	Area	Load Factor	Occupant Load
LEVEL 5			
A-3	5,016 SF	15	336
R-2	7,431 SF	200	41
S-2	7,173 SF	300	26
	19,620 SF		403
LEVEL 4			
A-3*	4,391 SF	15	293
B	382 SF	15	26
B	26,003 SF	150	177
S-2	291 SF	300	2
	31,066 SF		498

LEVEL 3			
A-3	6,030 SF	15	403
A-3*	5,778 SF	15	386
B	25,018 SF	150	170
S-2	291 SF	300	2
	37,117 SF		961
LEVEL 2			
A-3*	7,254 SF	15	484
B	33,318 SF	150	224
S-2	291 SF	300	2
	40,863 SF		710

*NOTE: THIS A-3 OCCUPANCY ALLOWANCE IS A PLACEHOLDER FOR CONFERENCE ROOMS, BREAK ROOMS, ETC THAT MAY BE PART OF A FUTURE TI. IT IS INCLUDED HERE TO ENSURE THAT ALL EGRESS COMPONENTS ARE SIZED APPROPRIATELY FOR THIS FUTURE USE. IT HAS NOT BEEN USED TO DETERMINE OCCUPANCY SEPARATIONS.

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	02/04/22	Planning Resubmittal
E	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
EGRESS AND OCCUPANCY

SCALE
As indicated

SHEET NUMBER



ISSUES AND REVISIONS

No.	Date	Description
A	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
**PLUMBING FIXTURE
CALCULATIONS**

SCALE
1/16" = 1'-0"

SHEET NUMBER

A-004

PLUMBING FIXTURE SUMMARY

Plumbing Fixture Occupant Load				
Occupancy	Area	P Load Factor	P Occupant Load	P Occupant Load Per Sex
LEVEL 5				
A-3	3,367 SF	30	113	56.5
	3,367 SF		113	56.5
LEVEL 4				
A-3*	4,391 SF	30	147	73.5
B	382 SF	30	13	6.5
B	23,351 SF	200	117	58.5
	28,123 SF		277	138.5
LEVEL 3				
A-3	6,030 SF	30	202	101
A-3*	5,778 SF	30	193	96.5
B	22,621 SF	200	114	57
	34,429 SF		509	254.5
LEVEL 2				
A-3*	7,254 SF	30	242	121
B	31,017 SF	200	156	78
	38,271 SF		398	199
LEVEL 1				
B	1,751 SF	200	9	4.5
	1,751 SF		9	4.5

CPC TABLE 422.1 MINIMUM PUMBING FACILITIES

	Level 5 + 4	Level 3	Level 2	Level 1
A-3 Occupancy				
Occupant Load Per Sex	130.00	198.00	121.00	0.00
Water Closet (M)	1.30	1.98	1.21	0.00
Water Closet (F)	3.30	3.98	3.21	0.00
Urinal	1.30	1.98	1.21	0.00
Lavatory (M)	0.65	0.99	0.61	0.00
Lavatory (F)	1.30	1.98	1.21	0.00
Drinking Fountain	1.04	1.58	0.97	0.00
B Occupancy Terrace				
Occupant Load Per Sex	7.00	0.00	0.00	0.00
Water Closet (M)	0.07	0.00	0.00	0.00
Water Closet (F)	0.28	0.00	0.00	0.00
Urinal	0.07	0.00	0.00	0.00
Lavatory (M)	0.04	0.00	0.00	0.00
Lavatory (F)	0.07	0.00	0.00	0.00
Drinking Fountain	0.06	0.00	0.00	0.00
B Occupancy				
Occupant Load Per Sex	59.00	57.00	78.00	5.00
Water Closet (M)	1.18	1.14	1.56	0.10
Water Closet (F)	3.18	3.14	3.56	0.33
Urinal	0.59	0.57	0.78	0.05
Lavatory (M)	0.79	0.76	1.04	0.07
Lavatory (F)	1.18	1.14	1.56	0.10
Drinking Fountain	0.79	0.76	1.04	0.07
Total				
Water Closet (M)	3.00	4.00	3.00	1.00
Water Closet (F)	7.00	8.00	7.00	1.00
Urinal	2.00	3.00	2.00	1.00
Lavatory (M)	2.00	2.00	2.00	1.00
Lavatory (F)	3.00	4.00	3.00	1.00
Drinking Fountain	2.00	3.00	3.00	1.00

PLUMBING FIXTURES PROVIDED

LEVEL 1	
1 SINGLE OCCUPANCY RESTROOM*	
*PER CPC 422.2 EXCEPTION 2, ONE TOILET FACILITY FOR USE BY NO MORE THAN ONE PERSON AT A TIME SHALL BE PERMITTED FOR USE BY BOTH SEXES IN OCCUPANCIES WITH AN OCCUPANT LOAD OF 10 OR LESS.	
NOTE: RESTROOMS FOR M OCCUPANCY ARE NOT PROVIDED IN BASE BUILDING AND WILL BE INCLUDED UNDER SEPERATE TI PERMIT.	
LEVEL 2	
WATER CLOSETS (M):	4 FIXTURES
WATER CLOSETS (F):	8 FIXTURES
URINALS:	4 FIXTURES
LAVATORIES (M):	4 FIXTURES
LAVATORIES (F):	4 FIXTURES
DRINKING FOUNTAINS:	3 FIXTURES
LEVEL 3	
WATER CLOSETS (M):	4 FIXTURES
WATER CLOSETS (F):	8 FIXTURES
URINALS:	4 FIXTURES
LAVATORIES (M):	4 FIXTURES
LAVATORIES (F):	4 FIXTURES
DRINKING FOUNTAINS:	3 FIXTURES
LEVEL 4	
WATER CLOSETS (M):	4 FIXTURES
WATER CLOSETS (F):	8 FIXTURES
URINALS:	4 FIXTURES
LAVATORIES (M):	4 FIXTURES
LAVATORIES (F):	4 FIXTURES
DRINKING FOUNTAINS:	3 FIXTURES
LEVEL 5	
WATER CLOSETS (M):	NONE
WATER CLOSETS (F):	NONE
URINALS:	NONE
LAVATORIES (M):	NONE
LAVATORIES (F):	NONE
DRINKING FOUNTAINS:	NONE
*PER CPC 2902.3.3 THE REQUIRED TOILET FACILITIES SHALL BE LOCATED NOT MORE THAN ONE STORY ABOVE OR BELOW THE SPACE REQUIRED TO BE PROVIDED WITH TOILET FACILITIES. THE TOILET FACILITIES FOR THE OFFICE ROOF DECK ARE PROVIDED ON LEVEL 4, AND THE CALCULATIONS FOR THE REQUIRED NUMBER OF FIXTURES ON LEVEL 4 INCLUDE THE COMBINED OCCUPANT LOADS OF LEVELS 4 AND 5.	

ISSUES AND REVISIONS

No.	Date	Description
A	03/19/21	Pre-App Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
PARKING DETAILS


SCALE
1/8" = 1'-0"

SHEET NUMBER

A-005

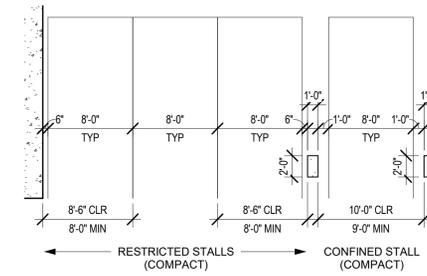

② STALL CLEARANCES - COMPACT
1/8" = 1'-0"

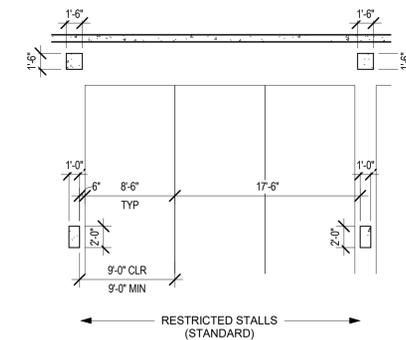

① STALL CLEARANCES - STANDARD
1/8" = 1'-0"



GENERAL NOTES

1. ACCESSIBLE PATHS OF TRAVEL:
 - A. ARE CONTINUOUSLY ACCESSIBLE
 - B. HAVE MAX. 1/2" CHANGES IN ELEVATION WITH A 1/2 BEVEL OR A RAMP PER CBC 11B-405
 - C. 48" MIN. WIDE
 - D. HAVE A MAX. RUNNING SLOPE OF 1:20 (5%) AND A MAX. CROSS SLOPE OF 1:50 (2%) PER CBC 403.3
 - E. SHALL COINCIDE WITH OR BE LOCATED IN THE SAME AREA AS GENERAL CIRCULATION PATHS. WHERE CIRCULATION PATHS ARE INTERIOR, REQUIRED ACCESSIBLE ROUTES SHALL ALSO BE INTERIOR.
2. PER CBC 11B-502.4 MAX. PERMITTED SLOPE OF ACCESSIBLE PARKING SPACE AND ACCESS AISLES IS 2% IN ANY DIRECTION

LEGEND

- ACCESSIBLE PATH OF TRAVEL
- APPROXIMATE EXTENT OF LIMITED PARKING ZONE

SHEET NOTES

Key Value	Keynote Text
1	THE PROJECT PROPOSES A LOT TIE AGREEMENT BETWEEN THE PROPERTY OWNERS OF THE FOUR LOTS THAT MAKE UP THE PROJECT SITE. THEREFORE, THE INTERIOR LOT LINES SHALL NOT BE USED TO DETERMINE THE FIRE SEPARATION REQUIREMENTS OF THE CALIFORNIA BUILDING CODE.
2	EXTENT OF CANOPY (ABOVE)
3	EXTENT OF FLOOR (ABOVE)
4	AUDIO/VISUAL PEDESTRIAN WARNING SIGN MOUNTED TO FACE OF BUILDING COLUMN, CALIBRATED TO NOT DISTURB RESIDENTIAL TENANTS ACROSS 5TH AVENUE.
5	BIKE RACK, S.L.D.

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set
E	02/04/22	Planning Resubmittal
F	06/15/22	Planning Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
SITE PLAN

SCALE
1/16" = 1'-0"



SHEET NUMBER

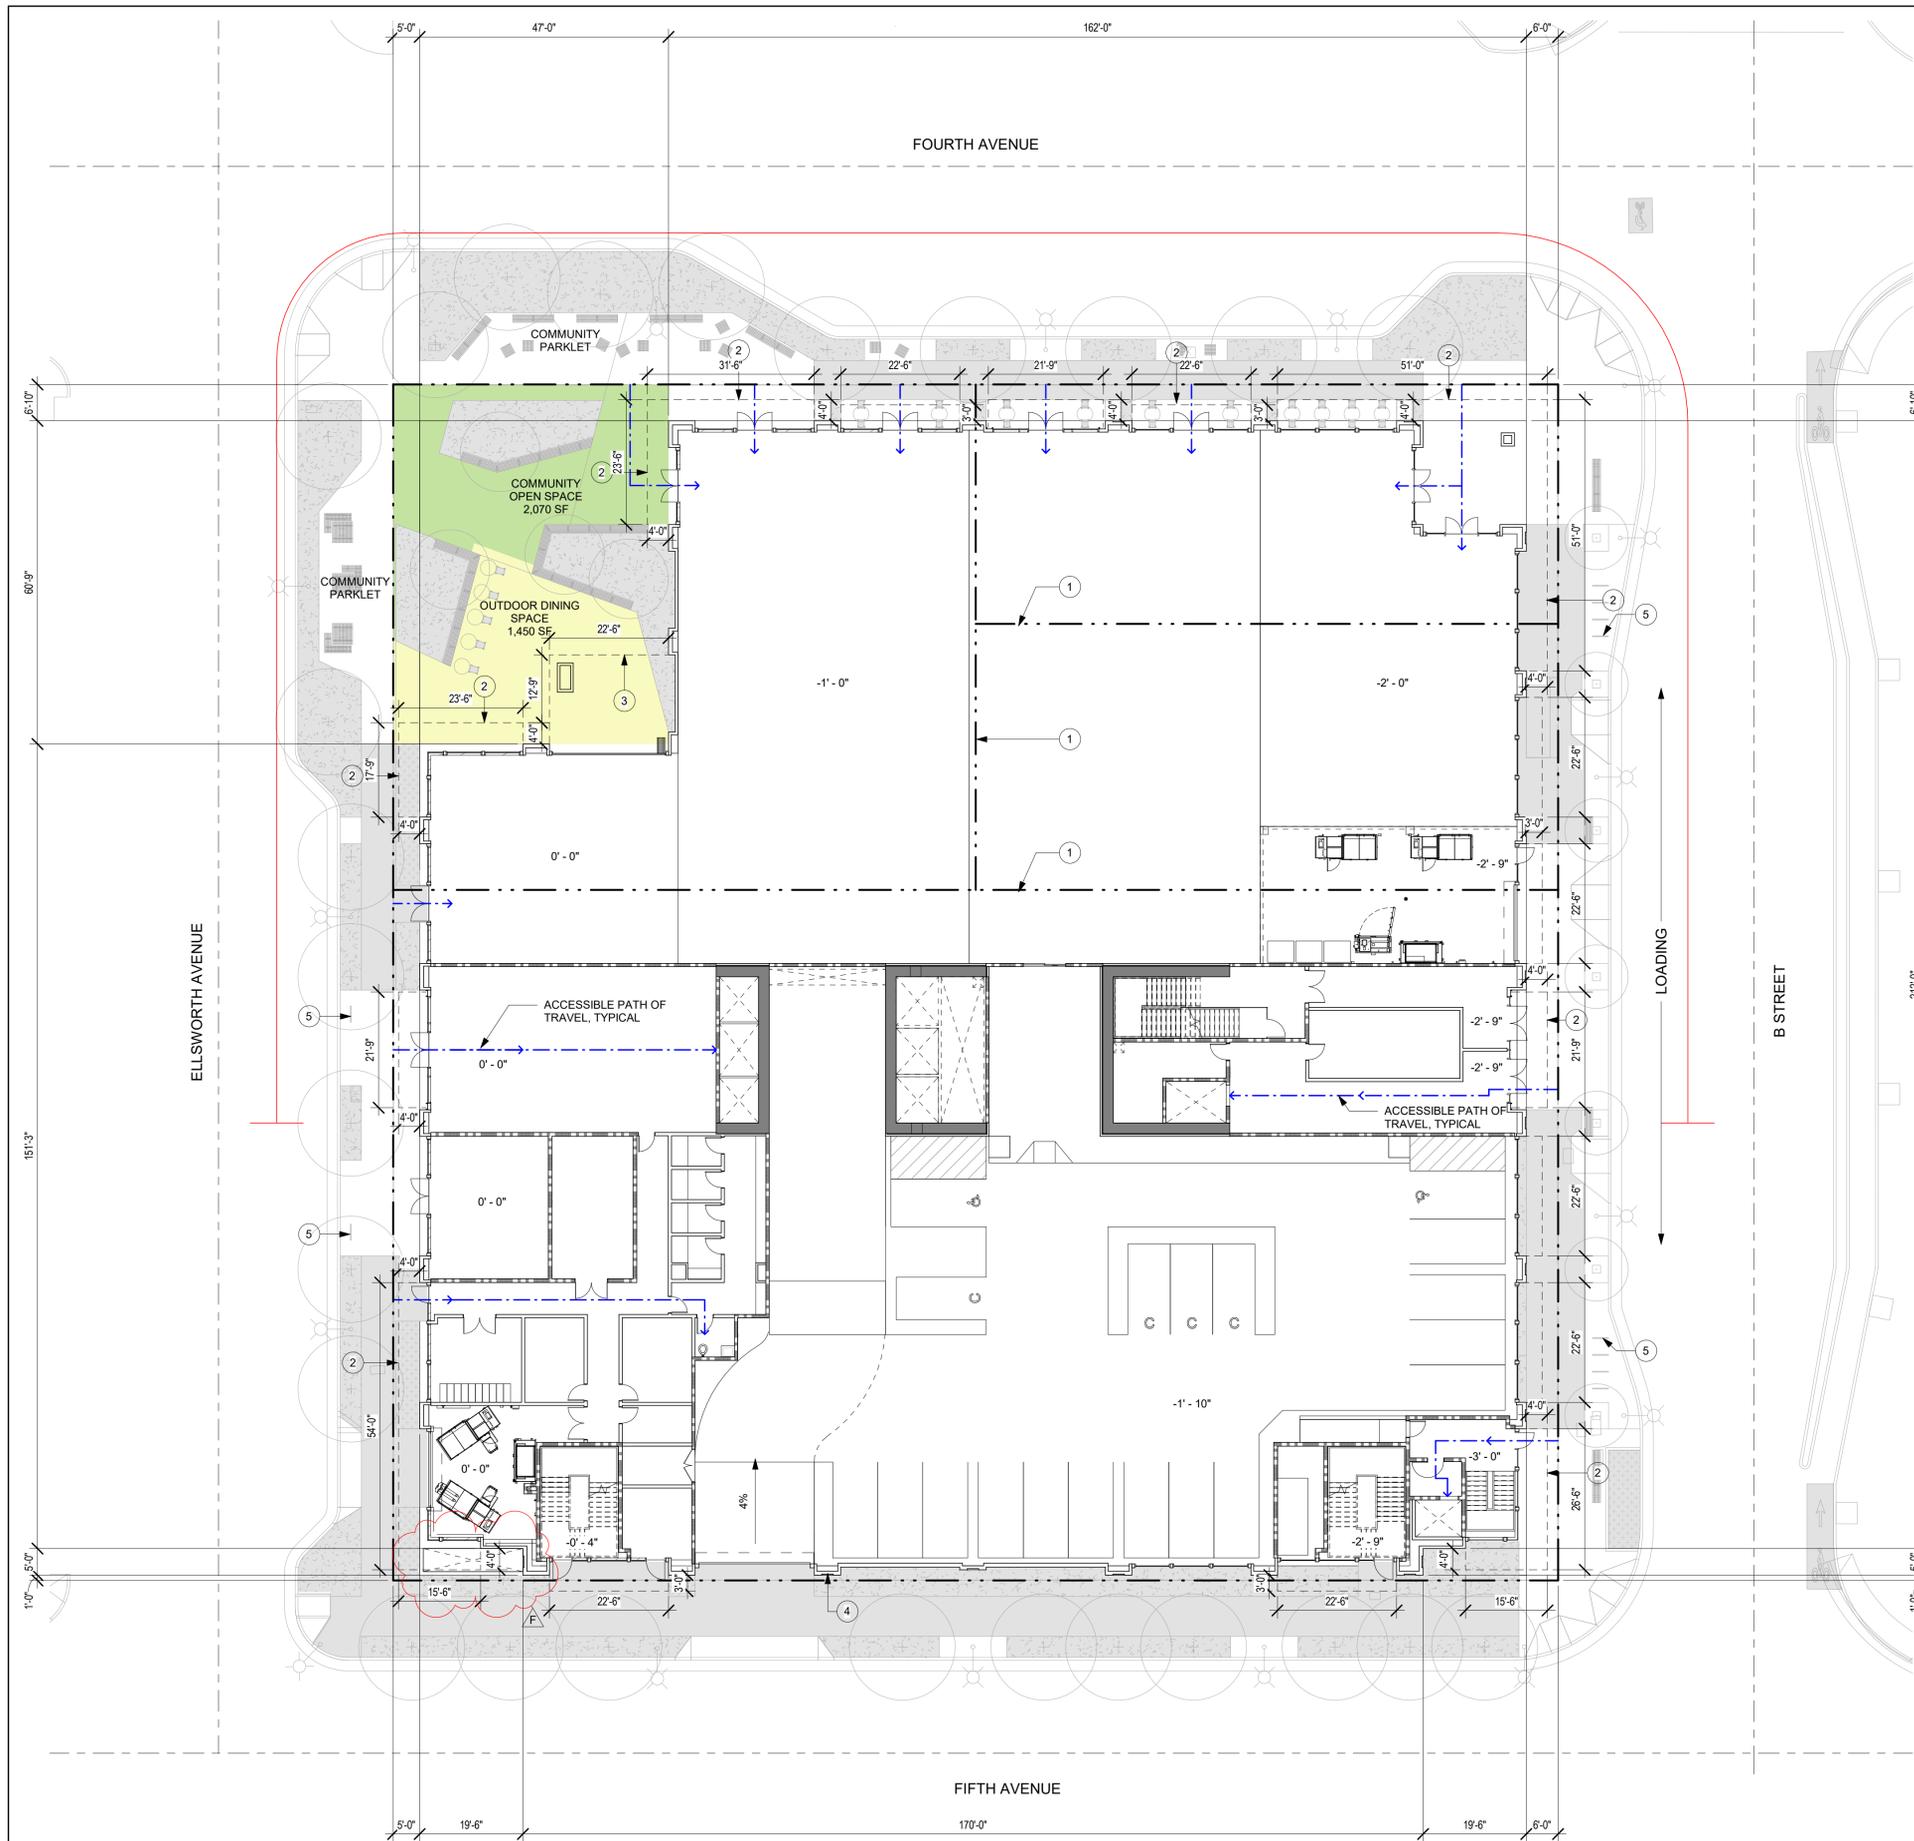

1 LEVEL 1 SITE PLAN
1/16" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
CONTEXT IMAGES

SCALE



SHEET NUMBER

A-102



5



4




3



2



6

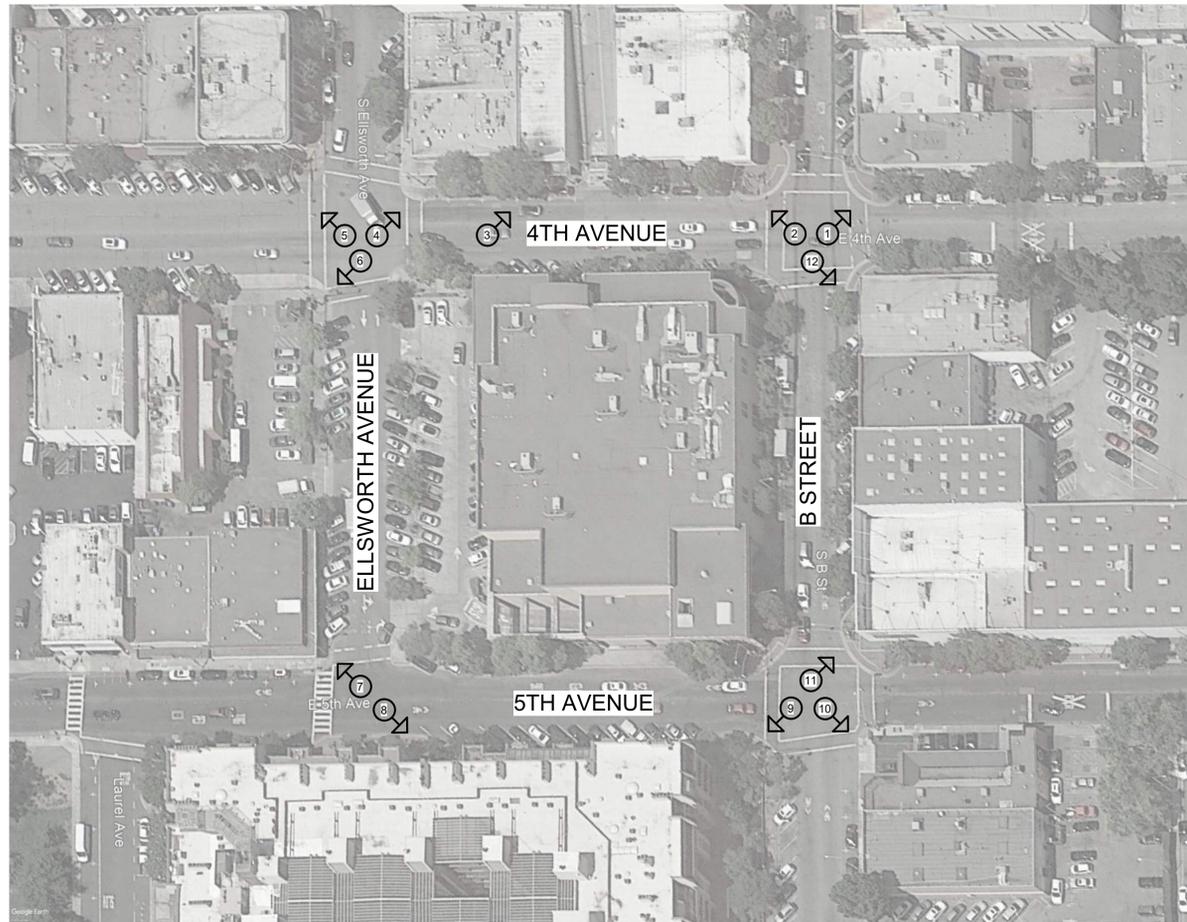

1



7



12



8




9



10




11

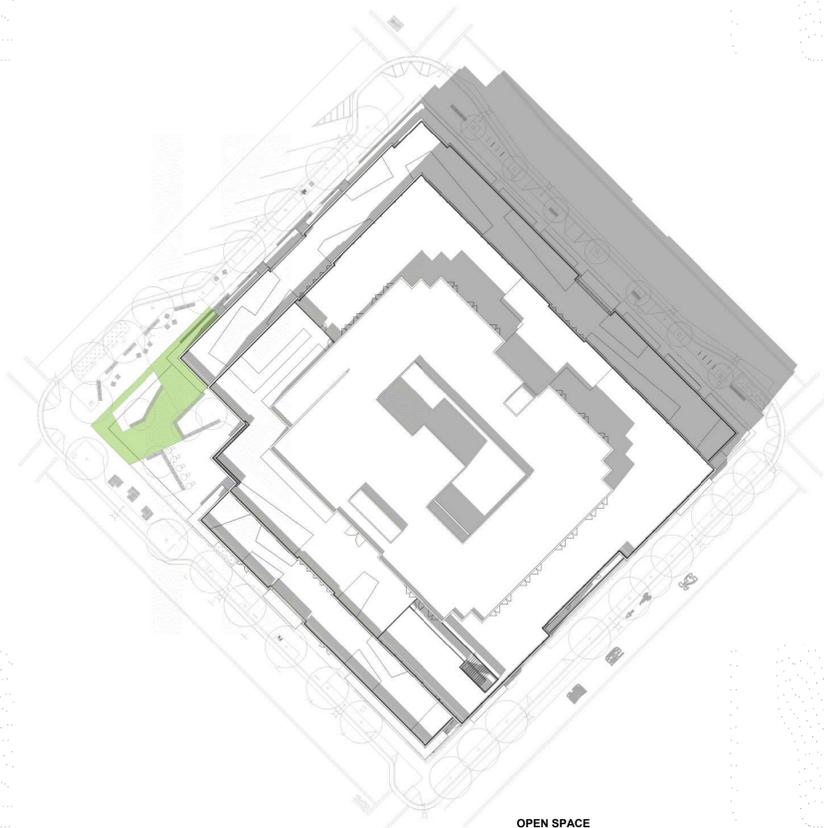


OPEN SPACE
TOTAL AREA: 1,455 SF
UNSHADED AREA: 1,455 SF
UNSHADED %: 100%

④ Spring, 2PM
1" = 40'-0"

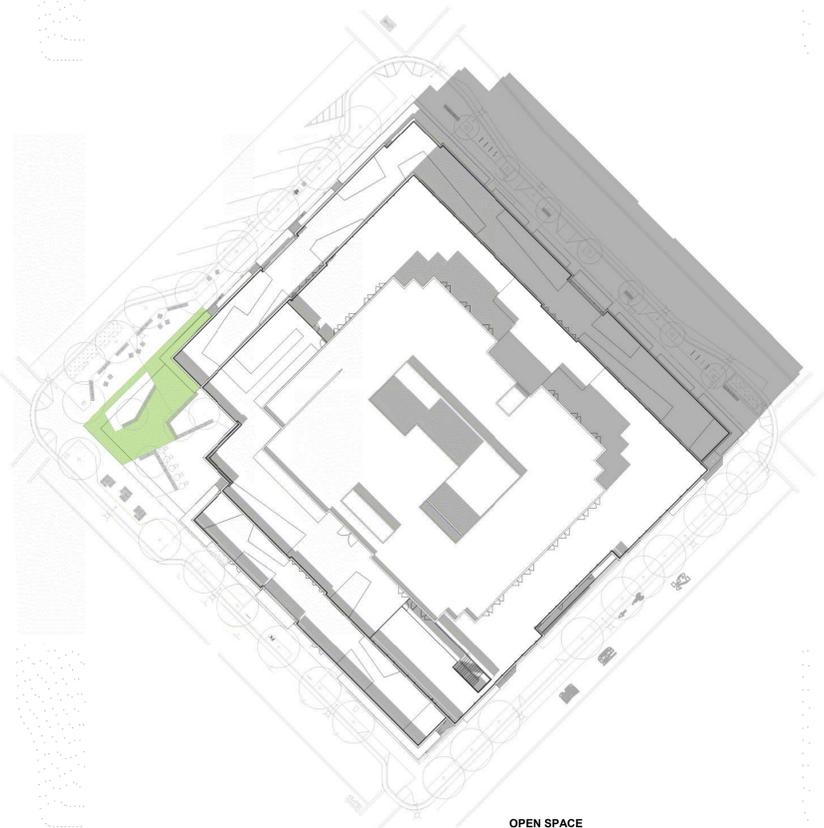


OPEN SPACE
TOTAL AREA: 1,455 SF
UNSHADED AREA: 1,455 SF
UNSHADED %: 100%

② Fall, 2PM
1" = 40'-0"

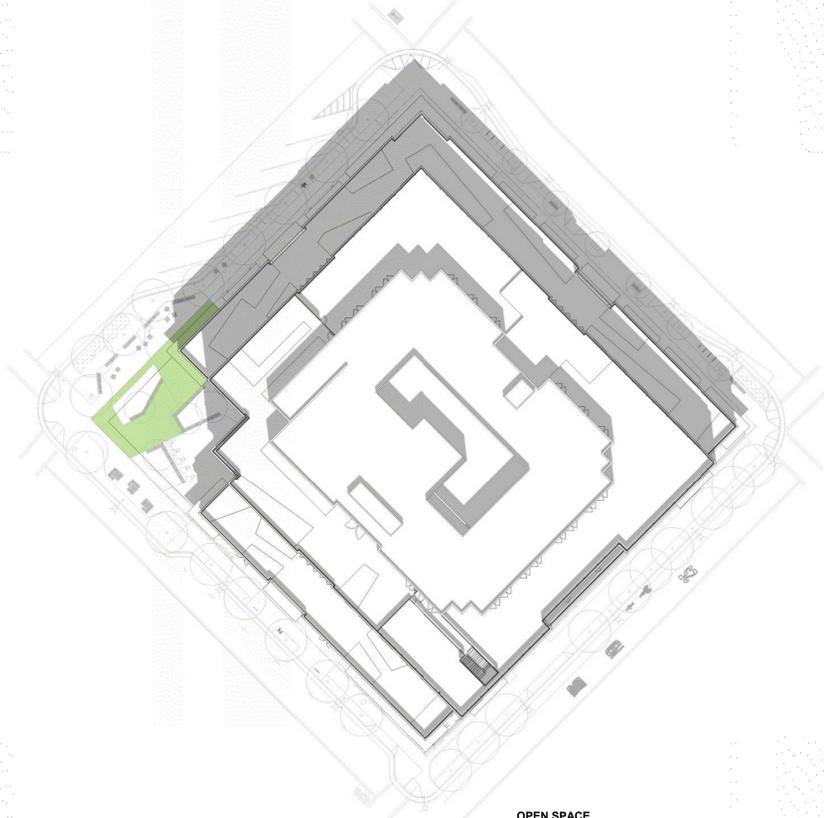

OPEN SPACE
TOTAL AREA: 1,455 SF
UNSHADED AREA: 1,280 SF
UNSHADED %: 88%

③ Spring, 12PM
1" = 40'-0"

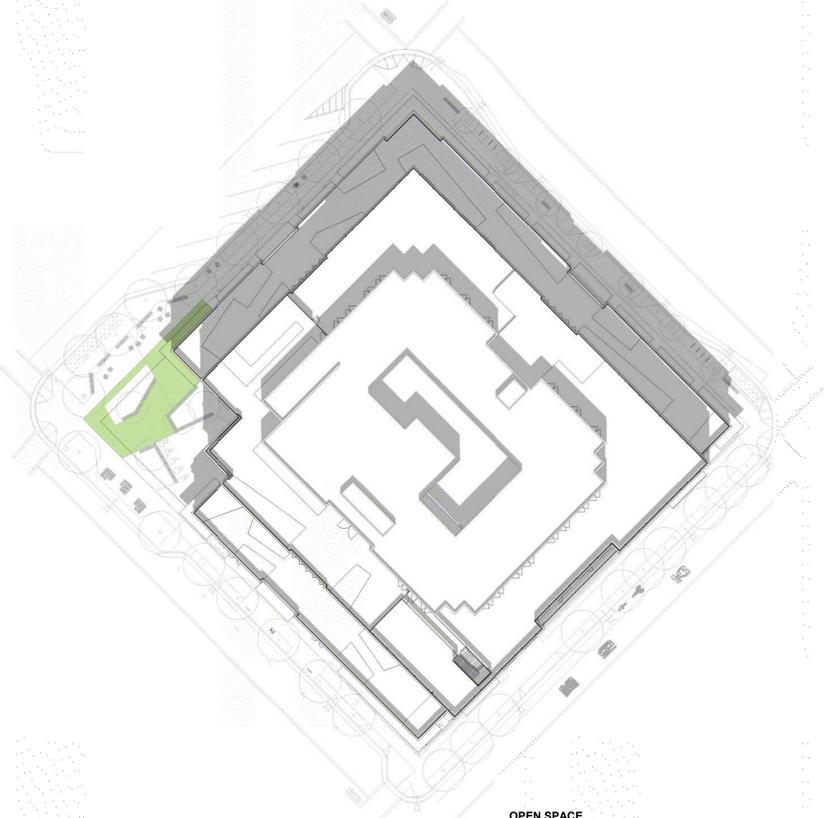

OPEN SPACE
TOTAL AREA: 1,455 SF
UNSHADED AREA: 1,290 SF
UNSHADED %: 89%

① Fall, 12PM
1" = 40'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	10/15/21	Planning Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
SHADOW STUDIES

SCALE
1" = 40'-0"



SHEET NUMBER

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
LEVEL 2 FLOOR PLAN

SCALE
3/32" = 1'-0"



SHEET NUMBER

A-202

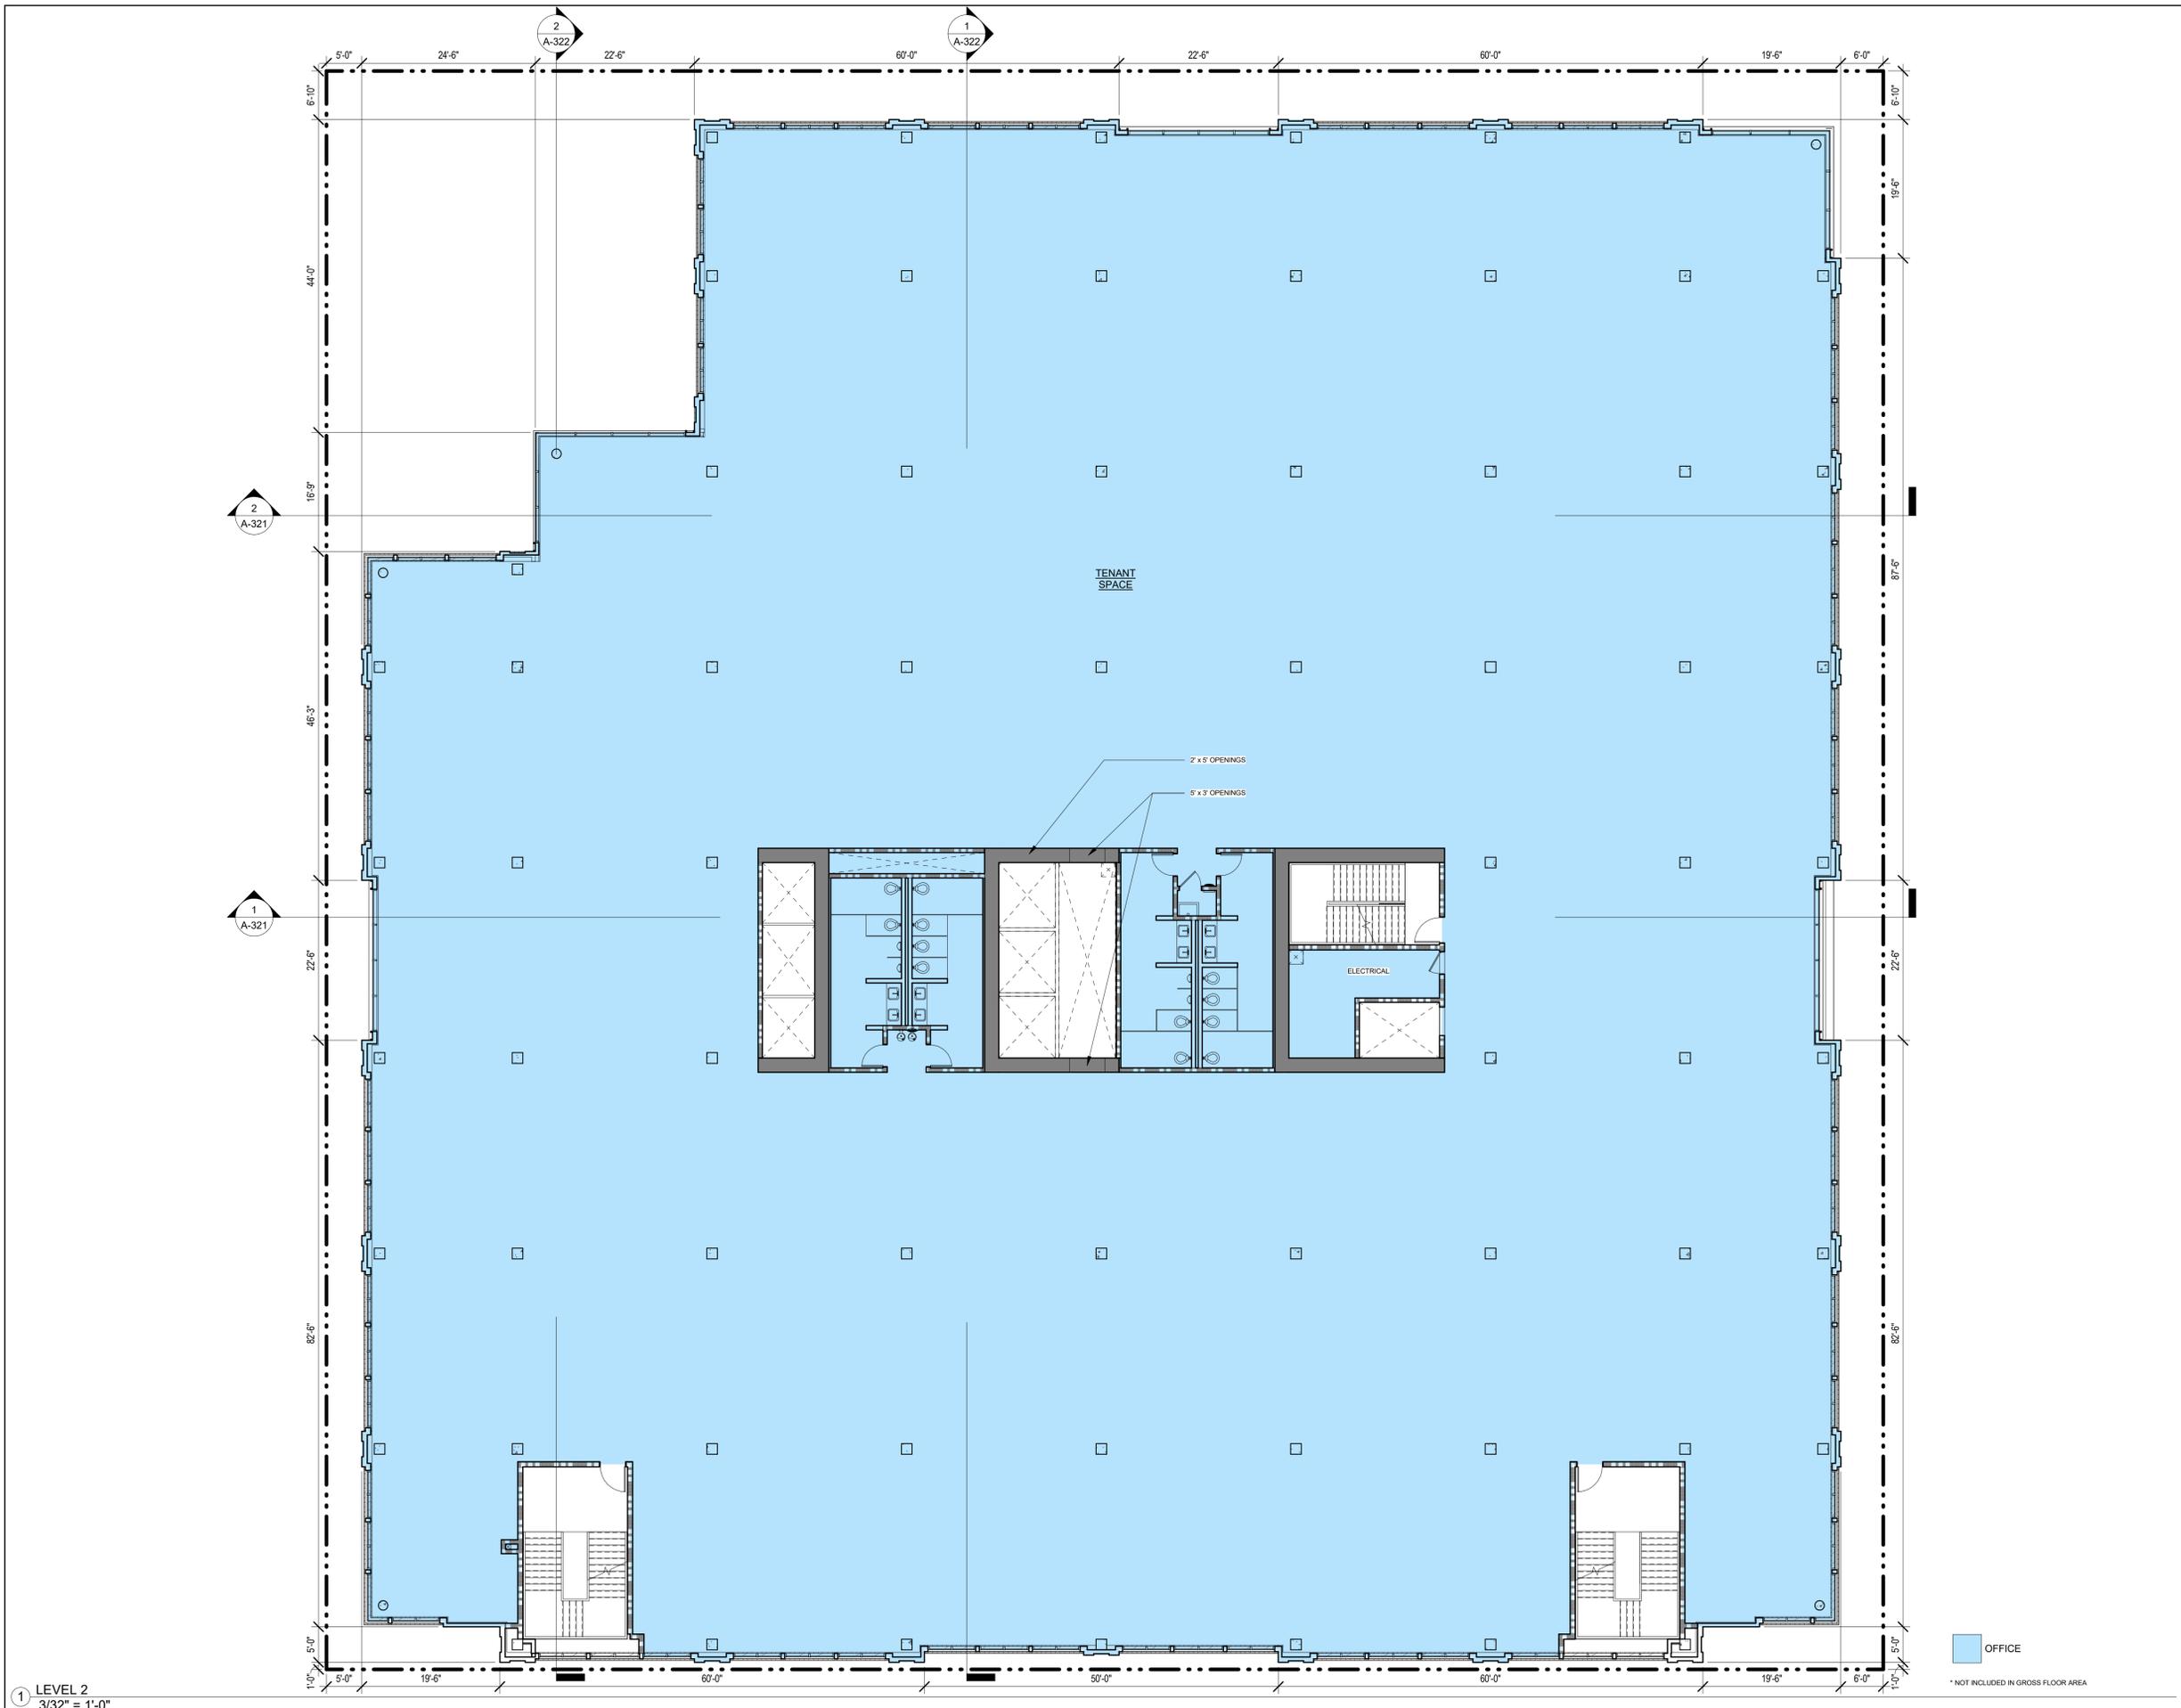

1 LEVEL 2
3/32" = 1'-0"

OFFICE
*NOT INCLUDED IN GROSS FLOOR AREA



ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
LEVEL 3 FLOOR PLAN

SCALE
3/32" = 1'-0"



SHEET NUMBER

A-203

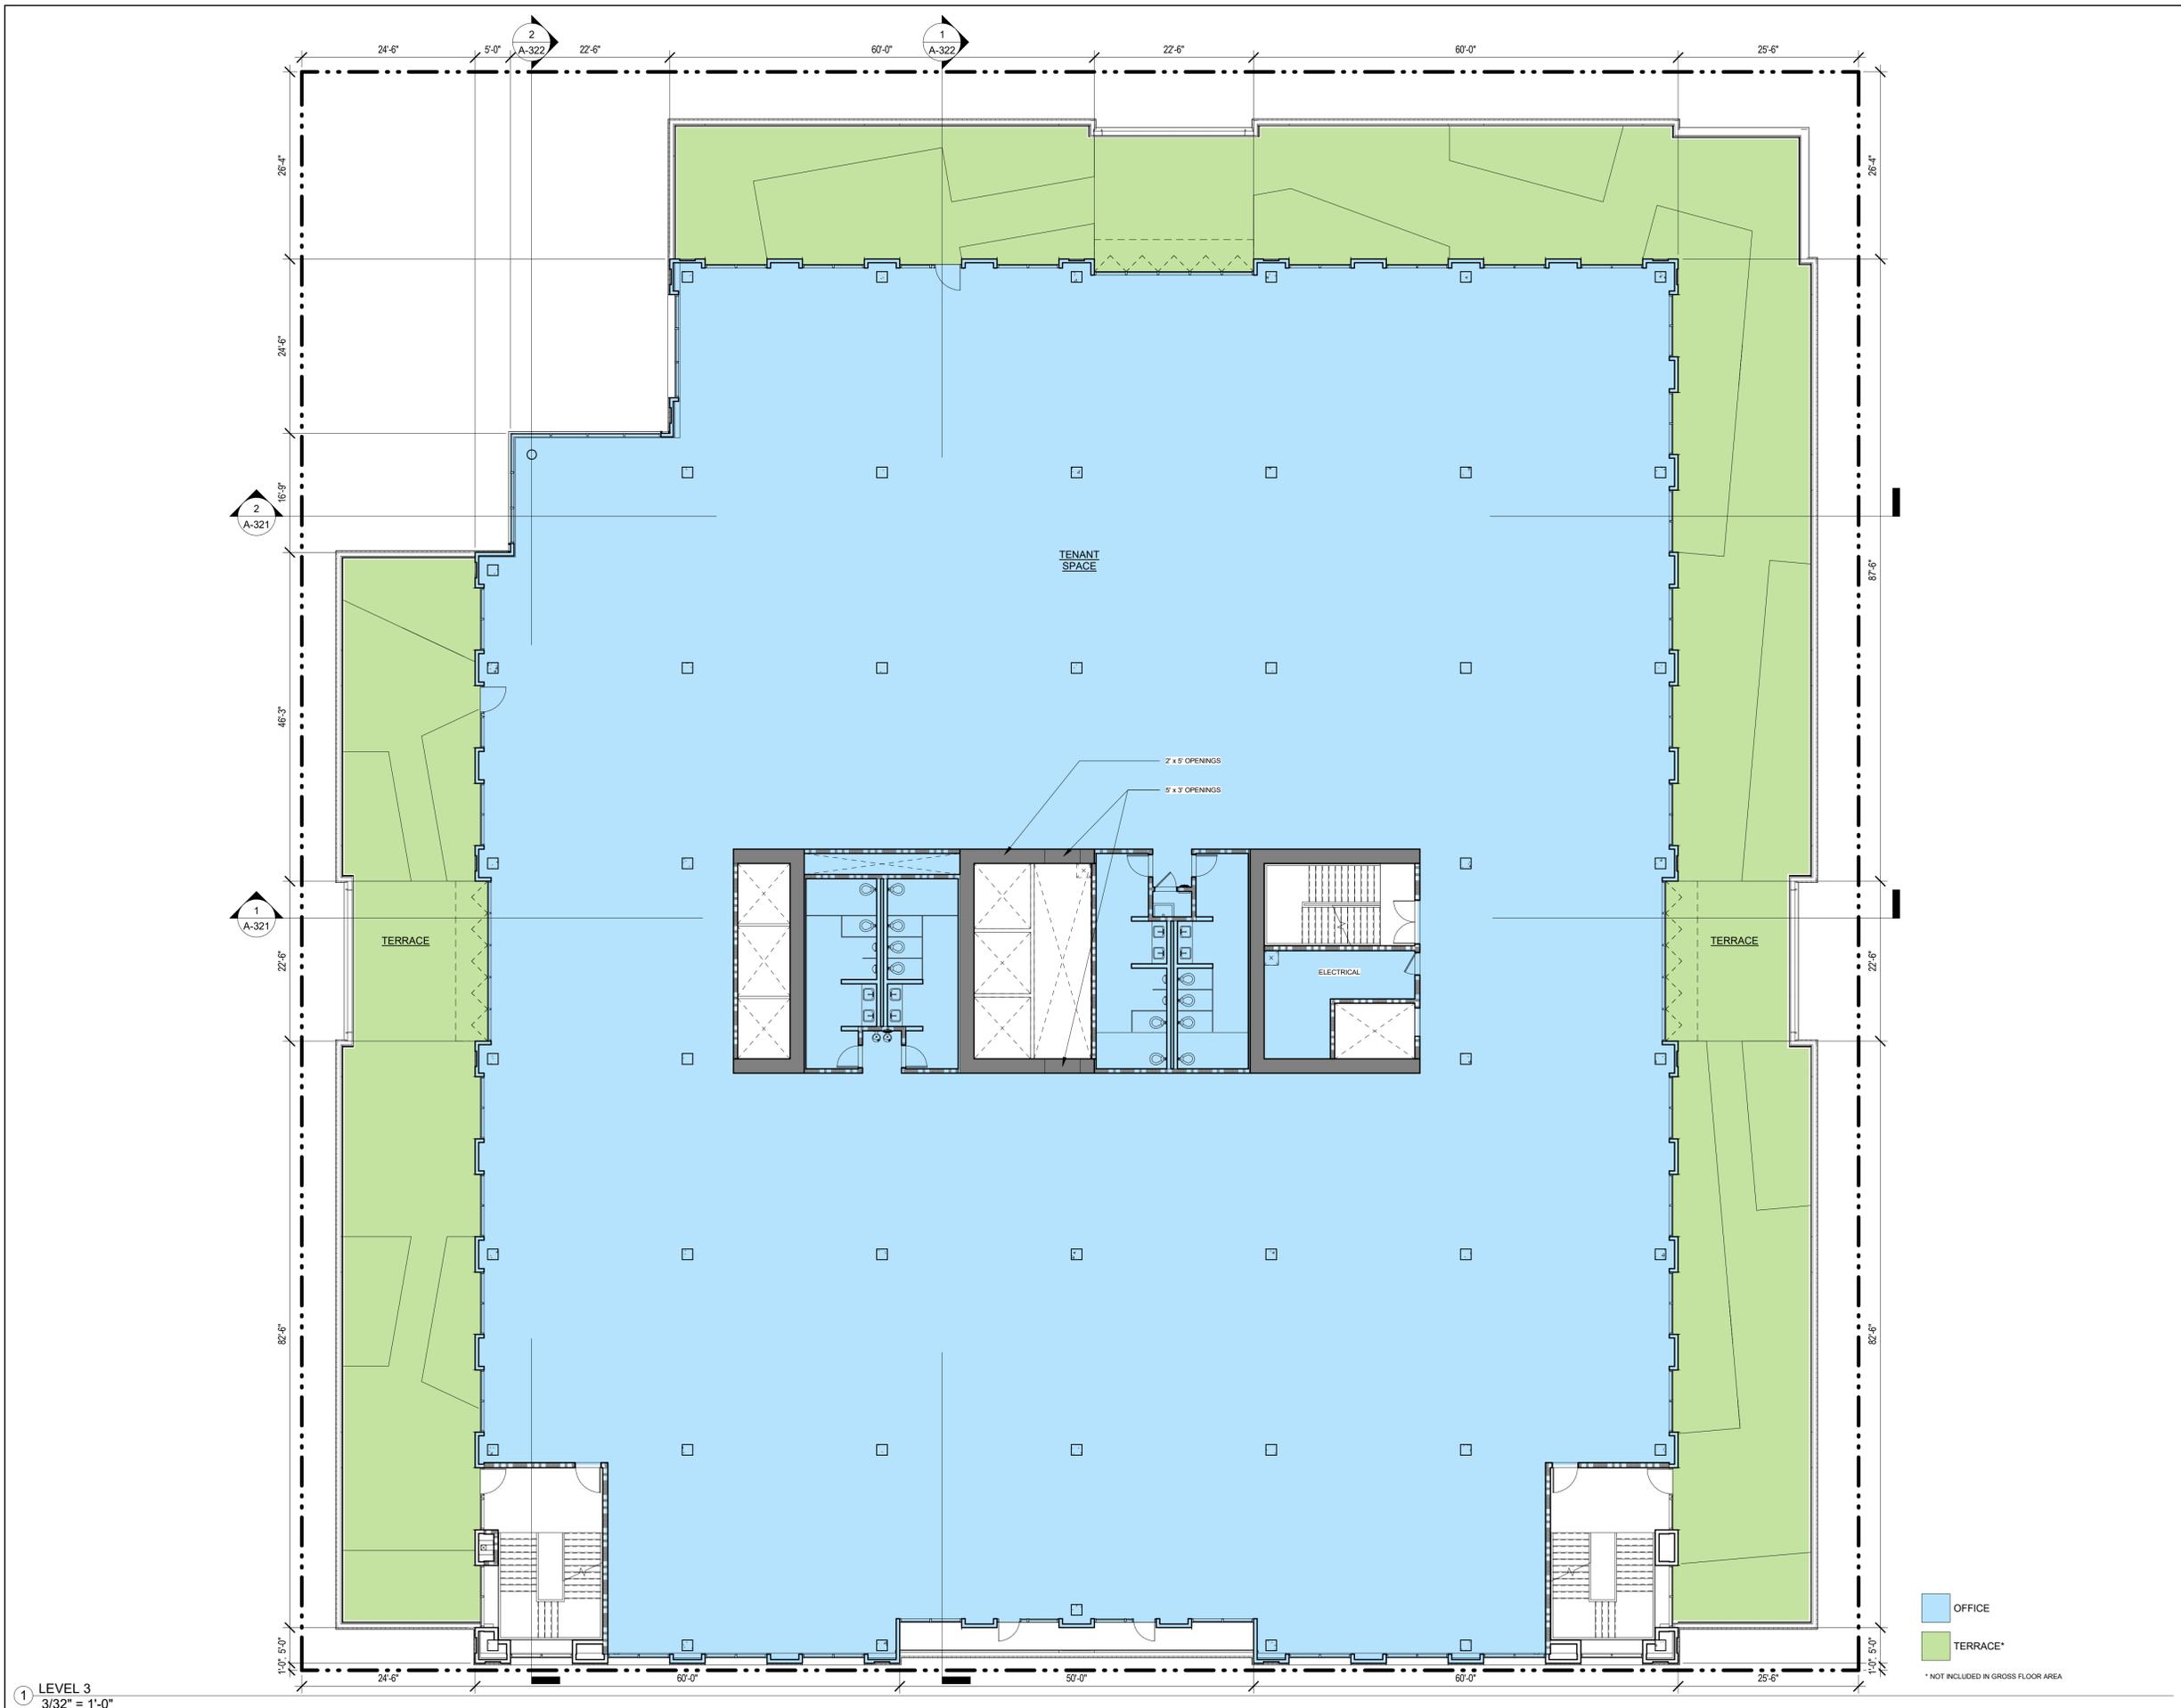

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
LEVEL 4 FLOOR PLAN

SCALE
3/32" = 1'-0"



SHEET NUMBER

A-204

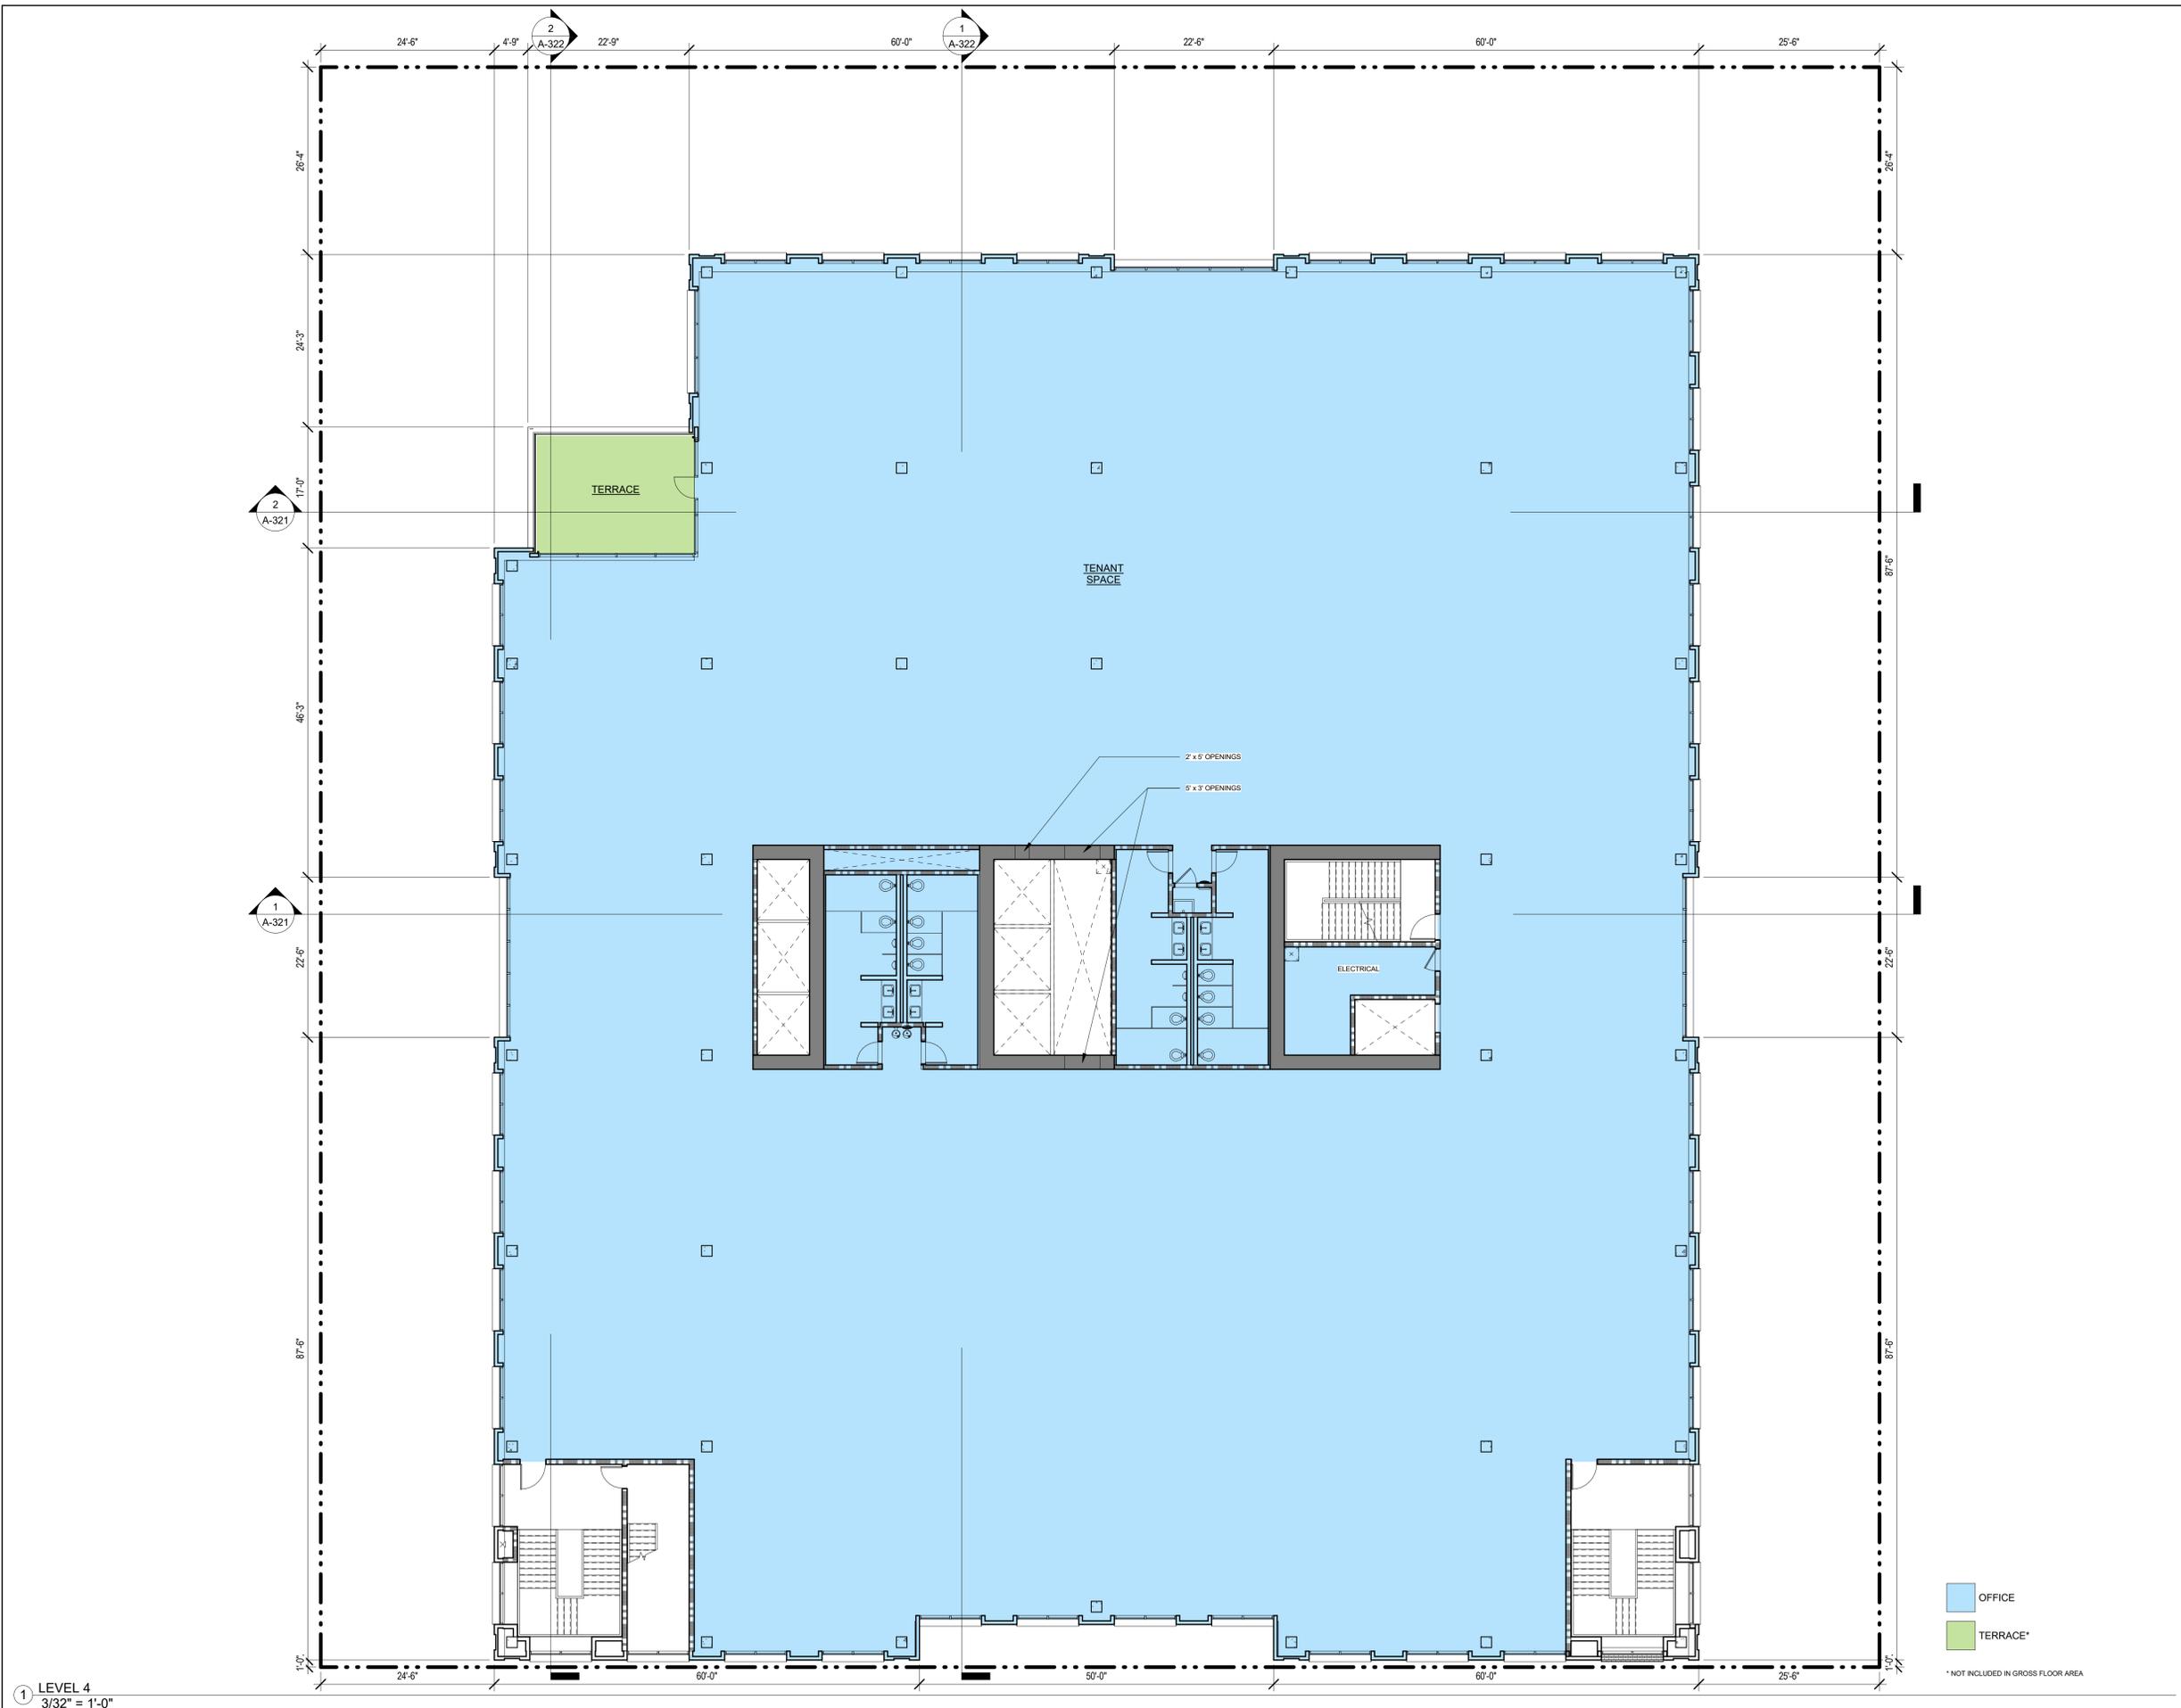

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set
E	02/04/22	Planning Resubmittal
F	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LEVEL 5 FLOOR PLAN

SCALE
3/32" = 1'-0"



SHEET NUMBER

A-205



① LEVEL 5
3/32" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	02/04/22	Planning Resubmittal
E	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
LEVEL B1 FLOOR PLAN

SCALE
3/32" = 1'-0"



SHEET NUMBER

A-206

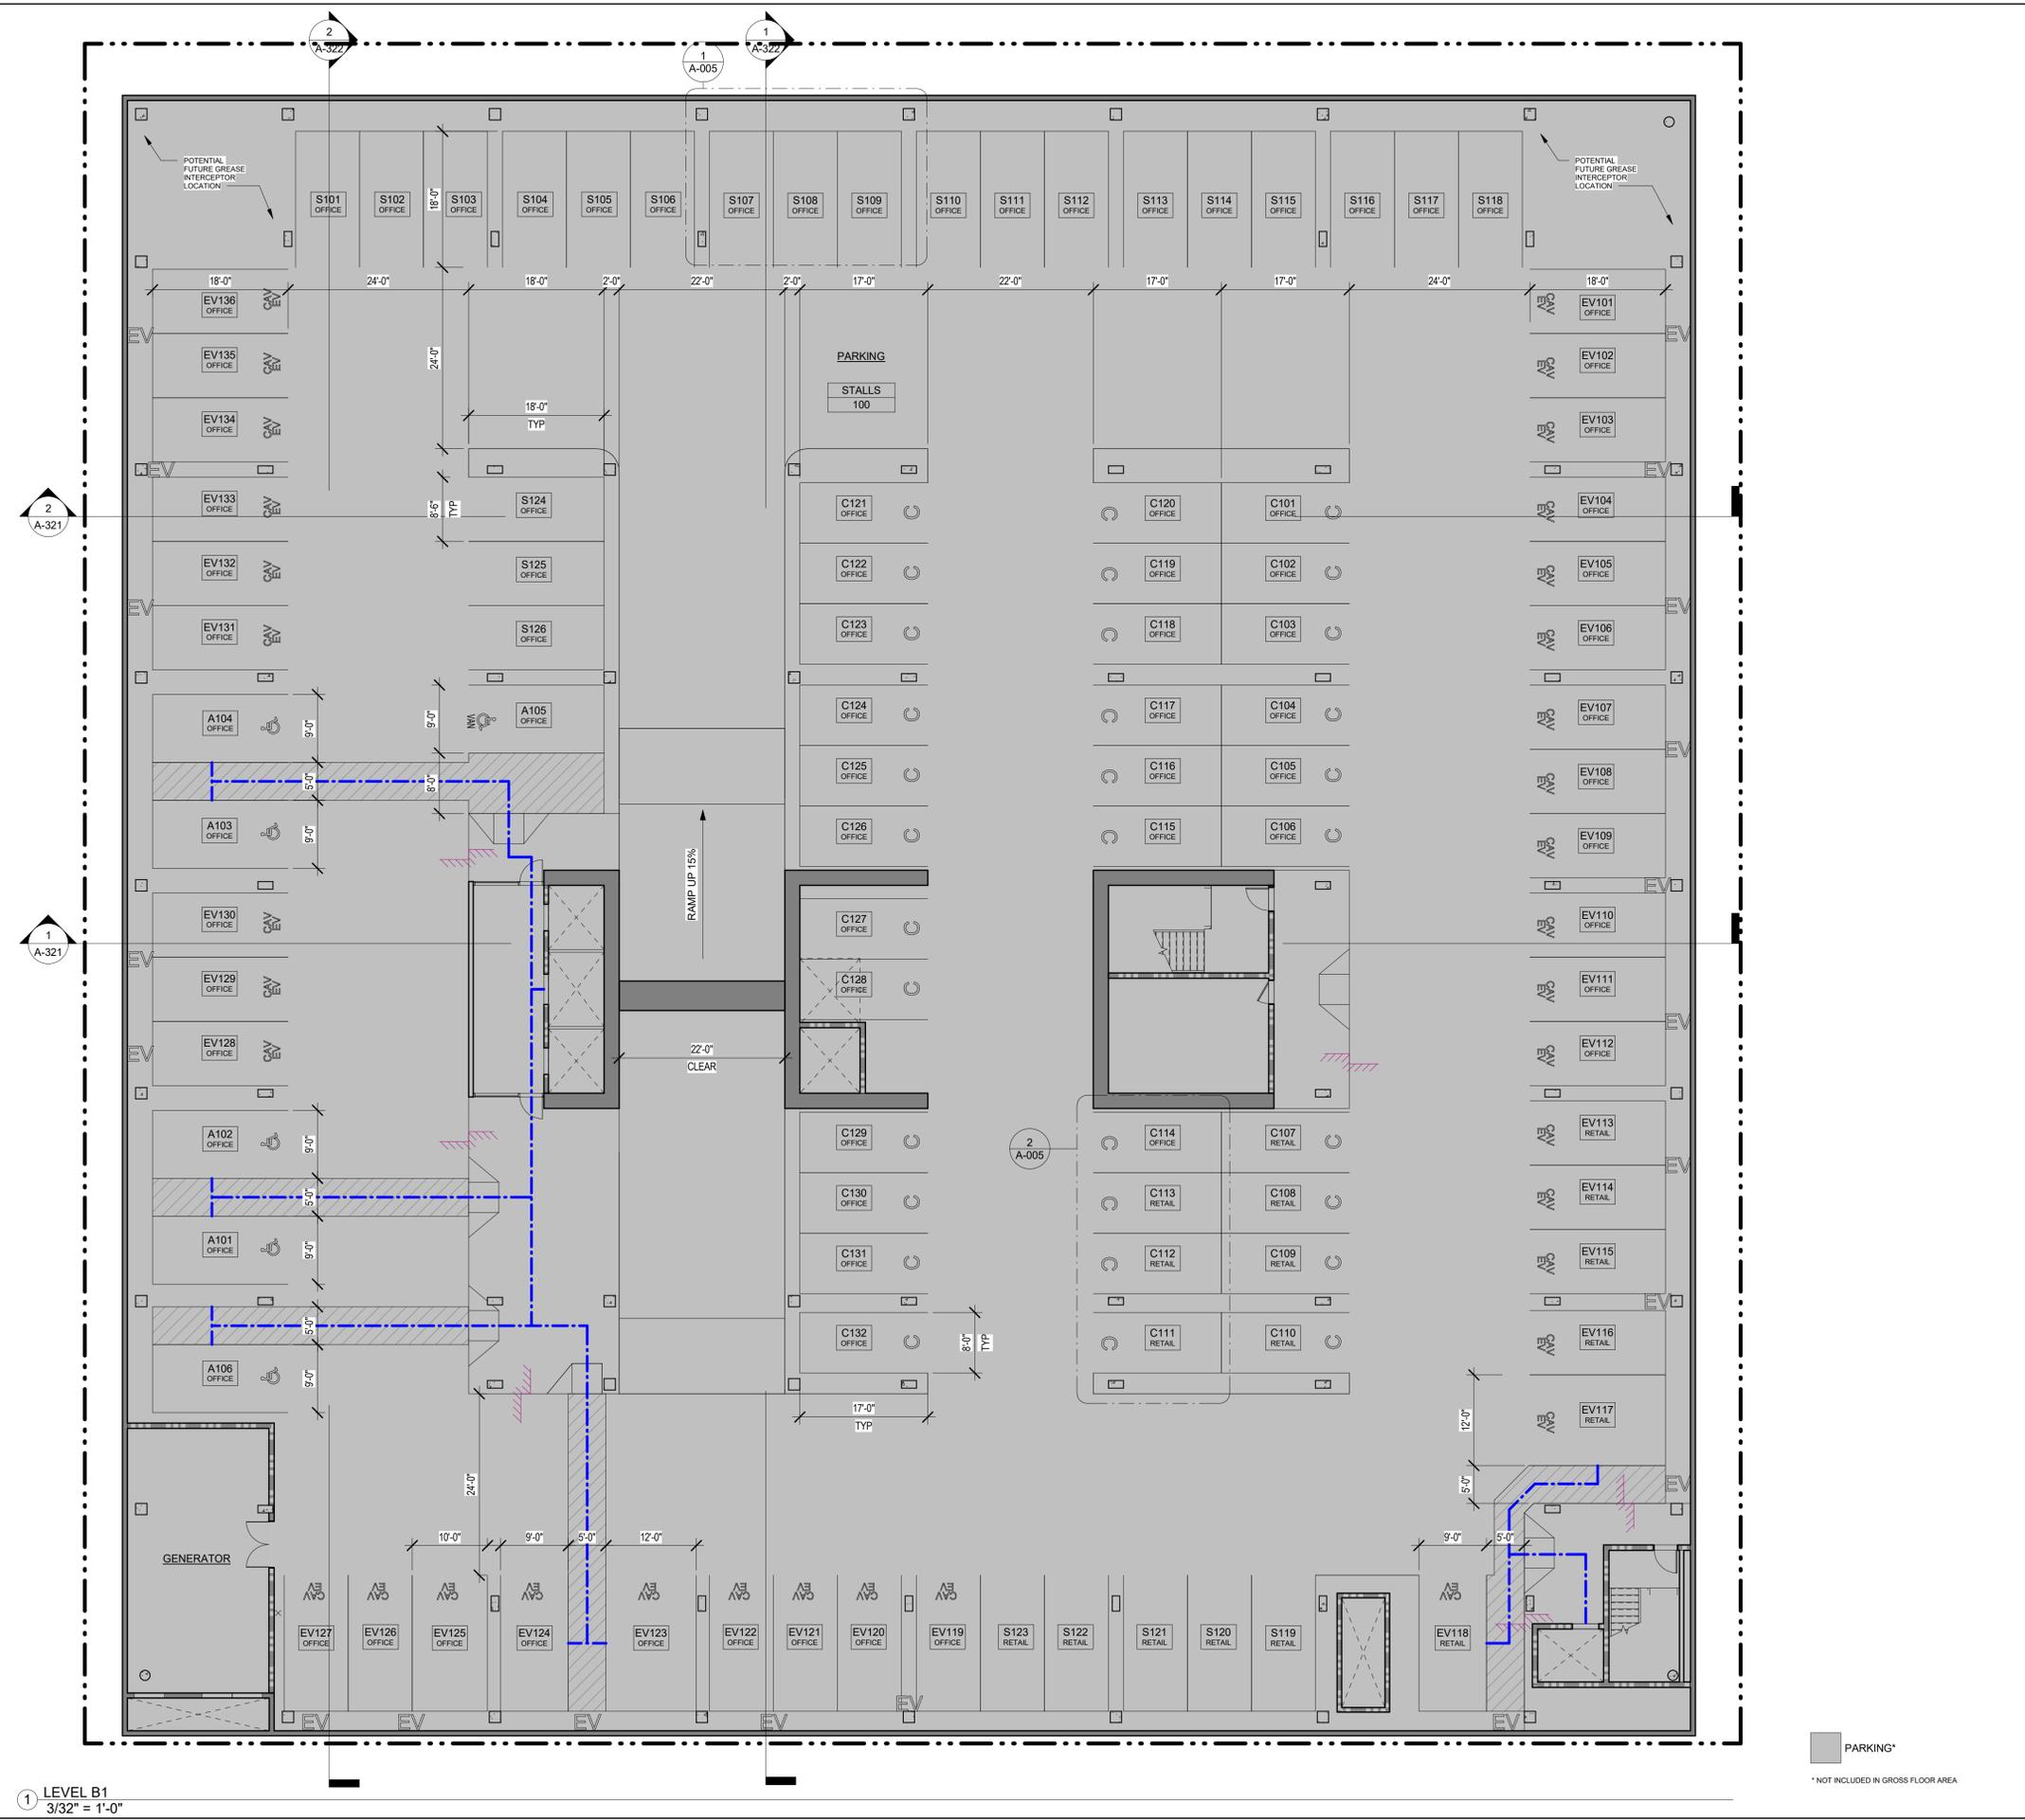

1 LEVEL B1
3/32" = 1'-0"

PARKING*
* NOT INCLUDED IN GROSS FLOOR AREA



ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	02/04/22	Planning Resubmittal
E	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LEVEL B2 FLOOR PLAN

SCALE
3/32" = 1'-0"




SHEET NUMBER

A-207

1 LEVEL B2
3/32" = 1'-0"

PARKING*
* NOT INCLUDED IN GROSS FLOOR AREA

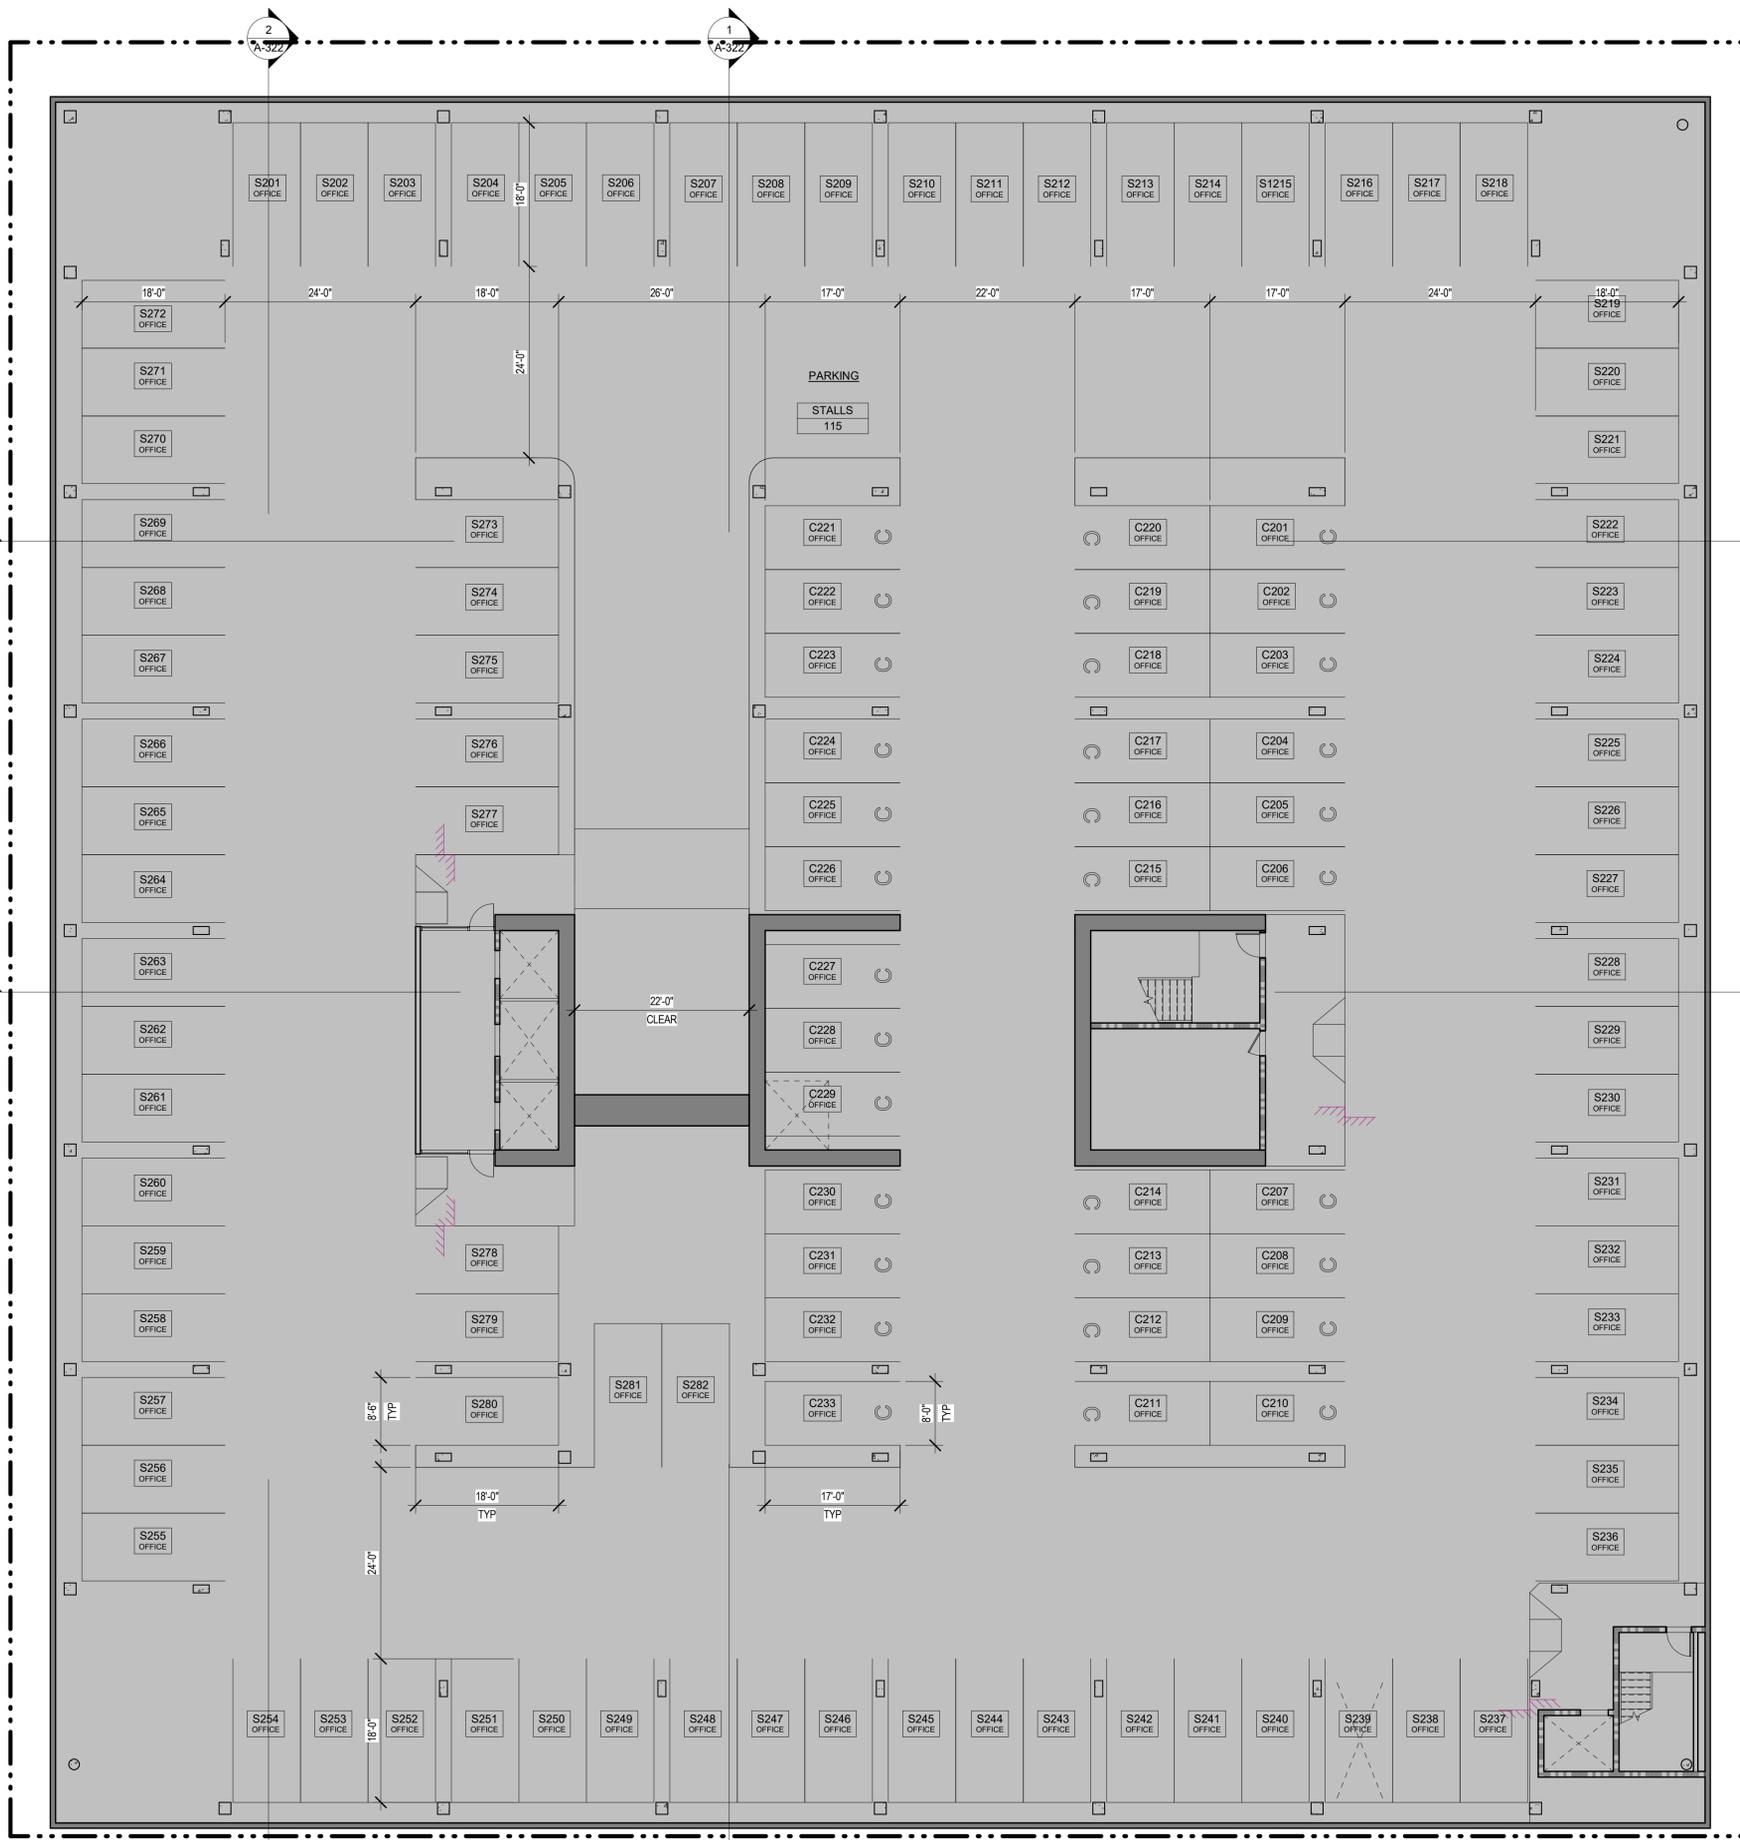

ISSUES AND REVISIONS

No.	Date	Description
A	10/21/20	Pre-App Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
RESIDENTIAL UNIT PLANS

SCALE
1/4" = 1'-0"




SHEET NUMBER


A-210

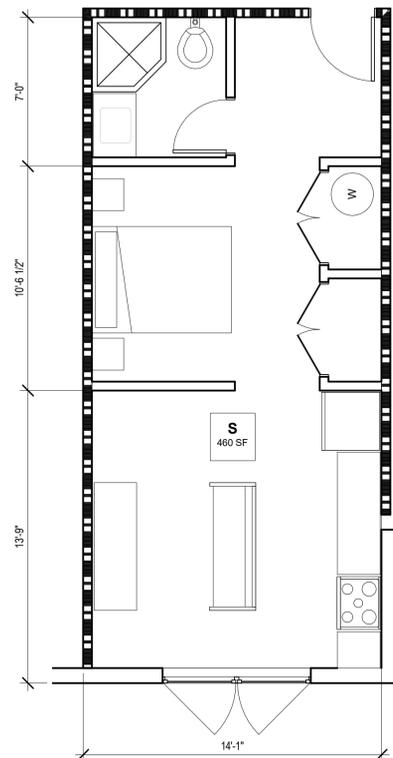

③ STUDIO
1/4" = 1'-0"

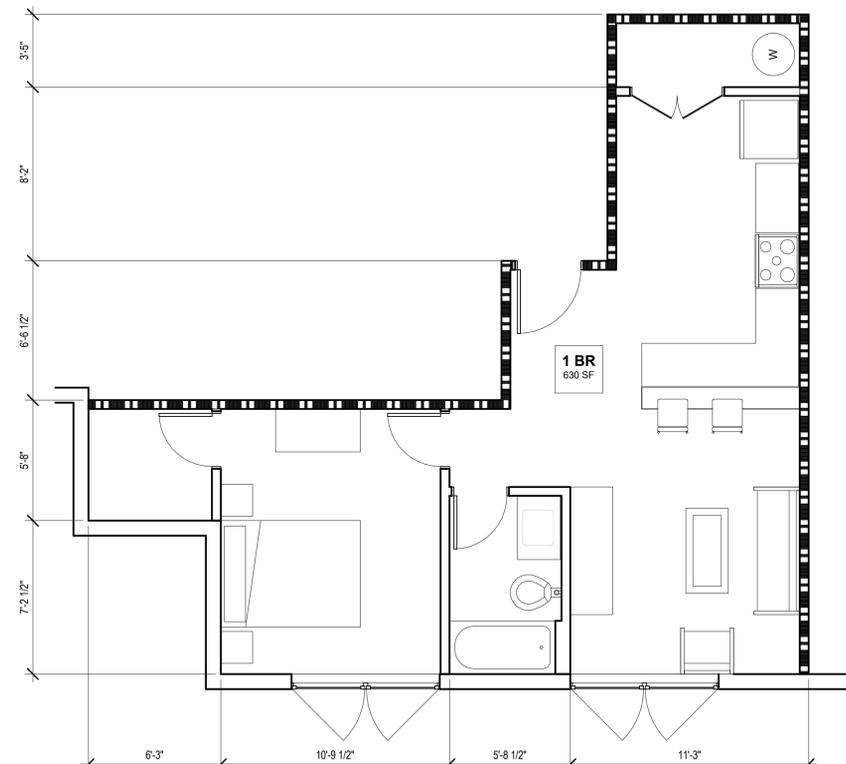

② 1-BED TYPE B
1/4" = 1'-0"

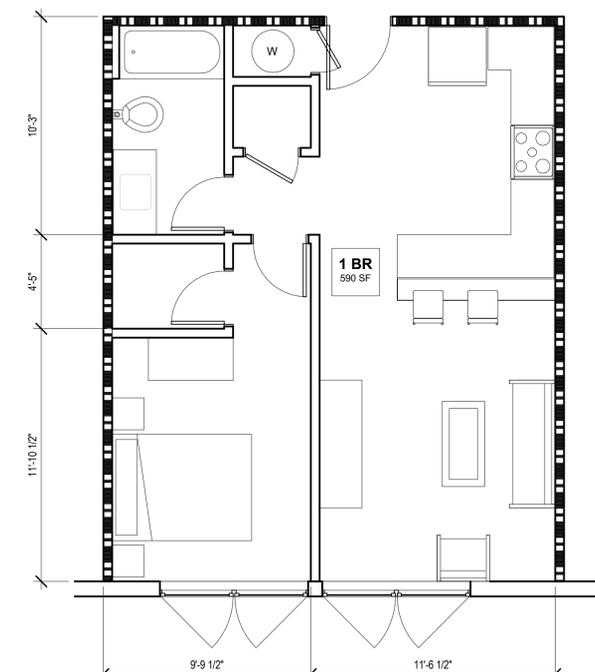

① 1-BED TYPE A
1/4" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
DESIGN CONTEXT PLAN

SCALE
1" = 20'-0"




SHEET NUMBER

A-220



VIEW 1: FACADE TYPE 1
SEE SHEET A-301 FOR MORE INFORMATION

TYPE 1

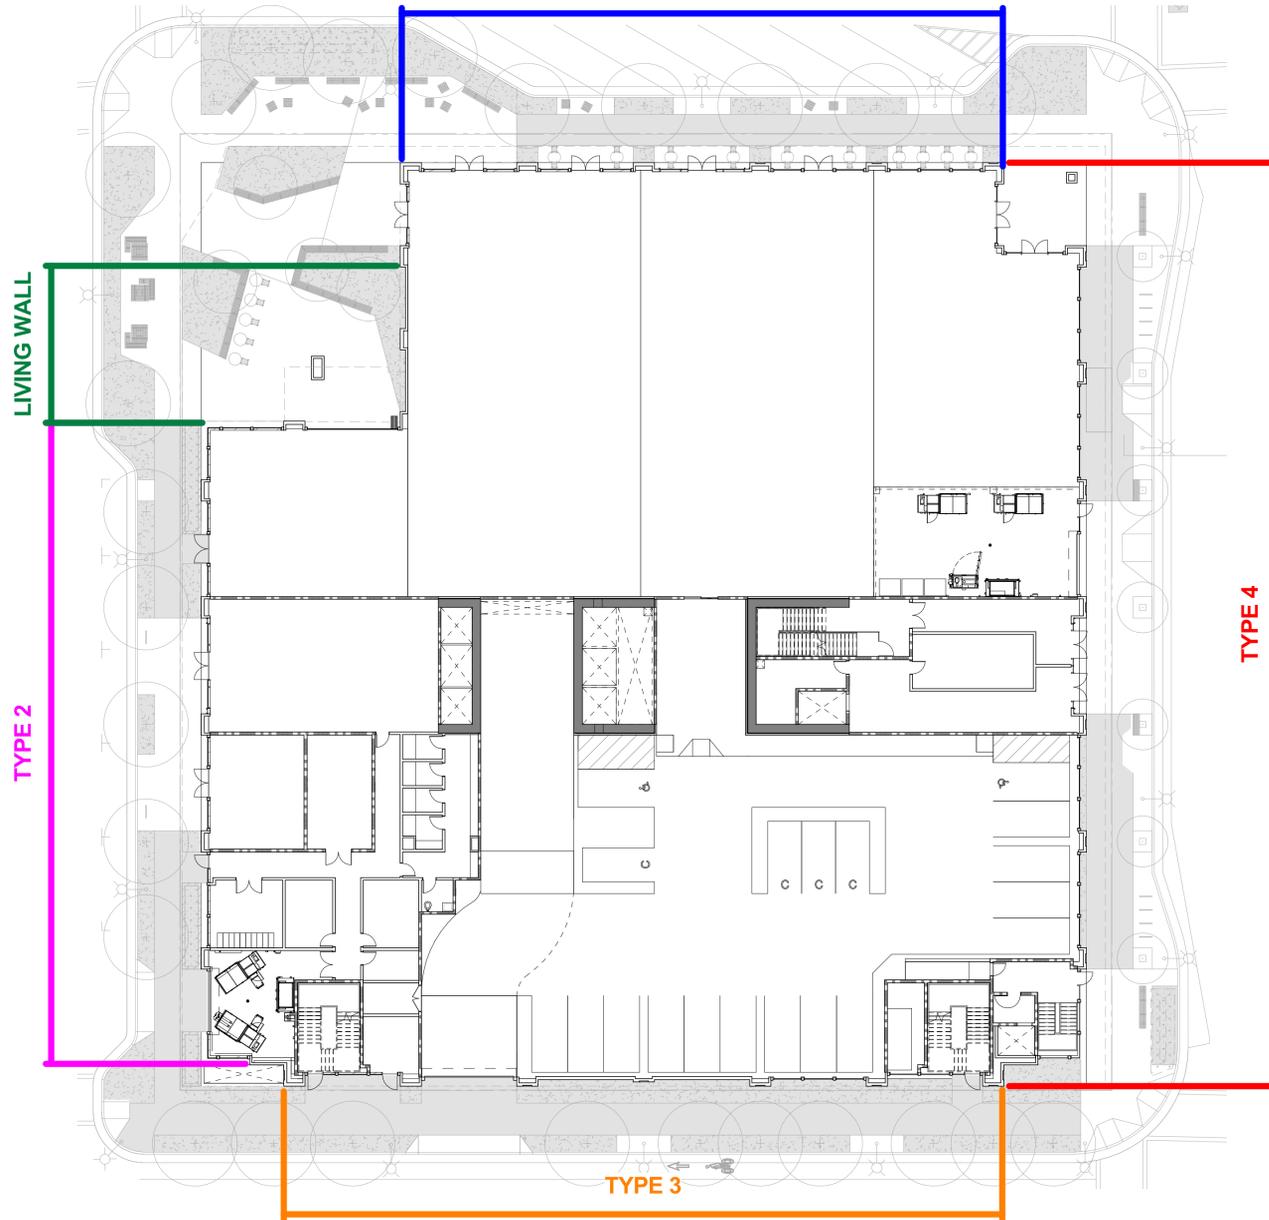

VIEW 2: FACADE TYPE 2
SEE SHEET A-302 FOR ADDITIONAL INFORMATION

LIVING WALL

TYPE 2



VIEW 4: FACADE TYPE 4
SEE SHEET A-304 FOR MORE INFORMATION

TYPE 4



VIEW 3: FACADE TYPE 3
SEE SHEET A-303 FOR MORE INFORMATION

TYPE 3

ISSUES AND REVISIONS

No.	Date	Description
A	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00



SHEET TITLE
**LEVEL 1 VEHICLE TURNING
ANALYSIS**

SCALE
1/16" = 1'-0"



SHEET NUMBER

A-231

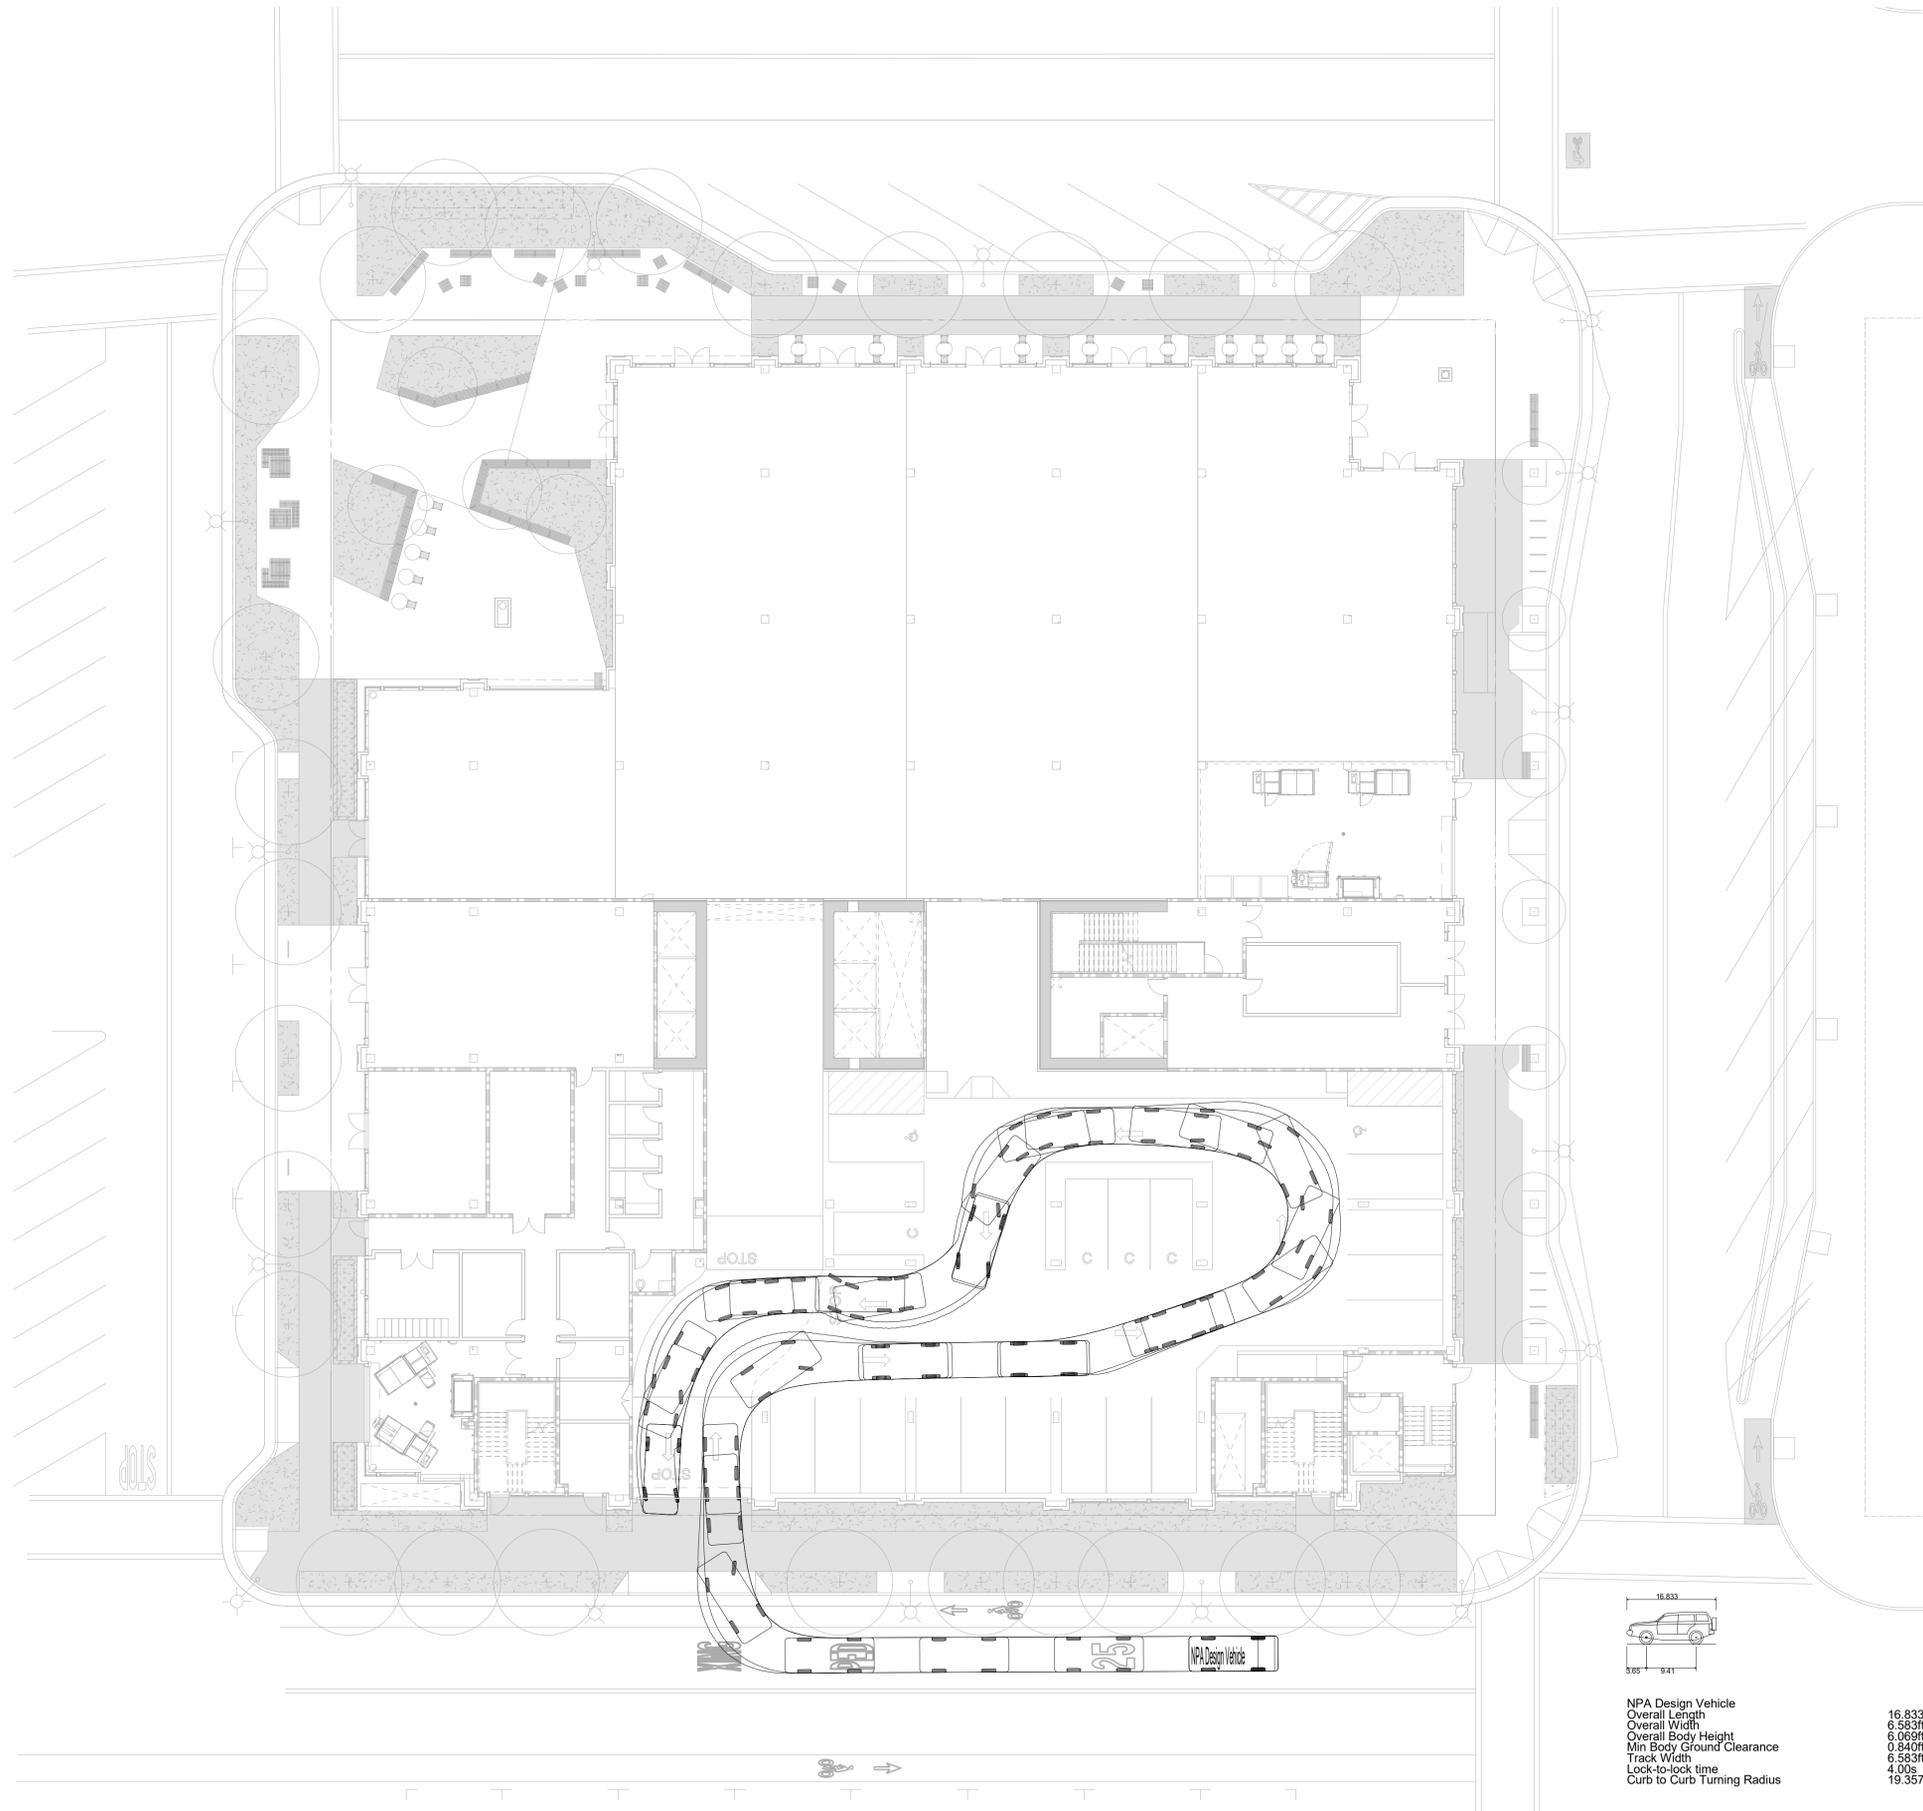

NPA Design Vehicle	16.833ft
Overall Length	6.563ft
Overall Width	6.089ft
Overall Body Height	0.840ft
Min Body Ground Clearance	6.563ft
Track Width	4.00s
Lock-to-lock time	19.357ft
Curb to Curb Turning Radius	

ISSUES AND REVISIONS

No.	Date	Description
A	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00



SHEET TITLE
LEVEL B1 & B2 VEHICLE TURNING ANALYSIS

SCALE
1/16" = 1'-0"





SHEET NUMBER

A-232

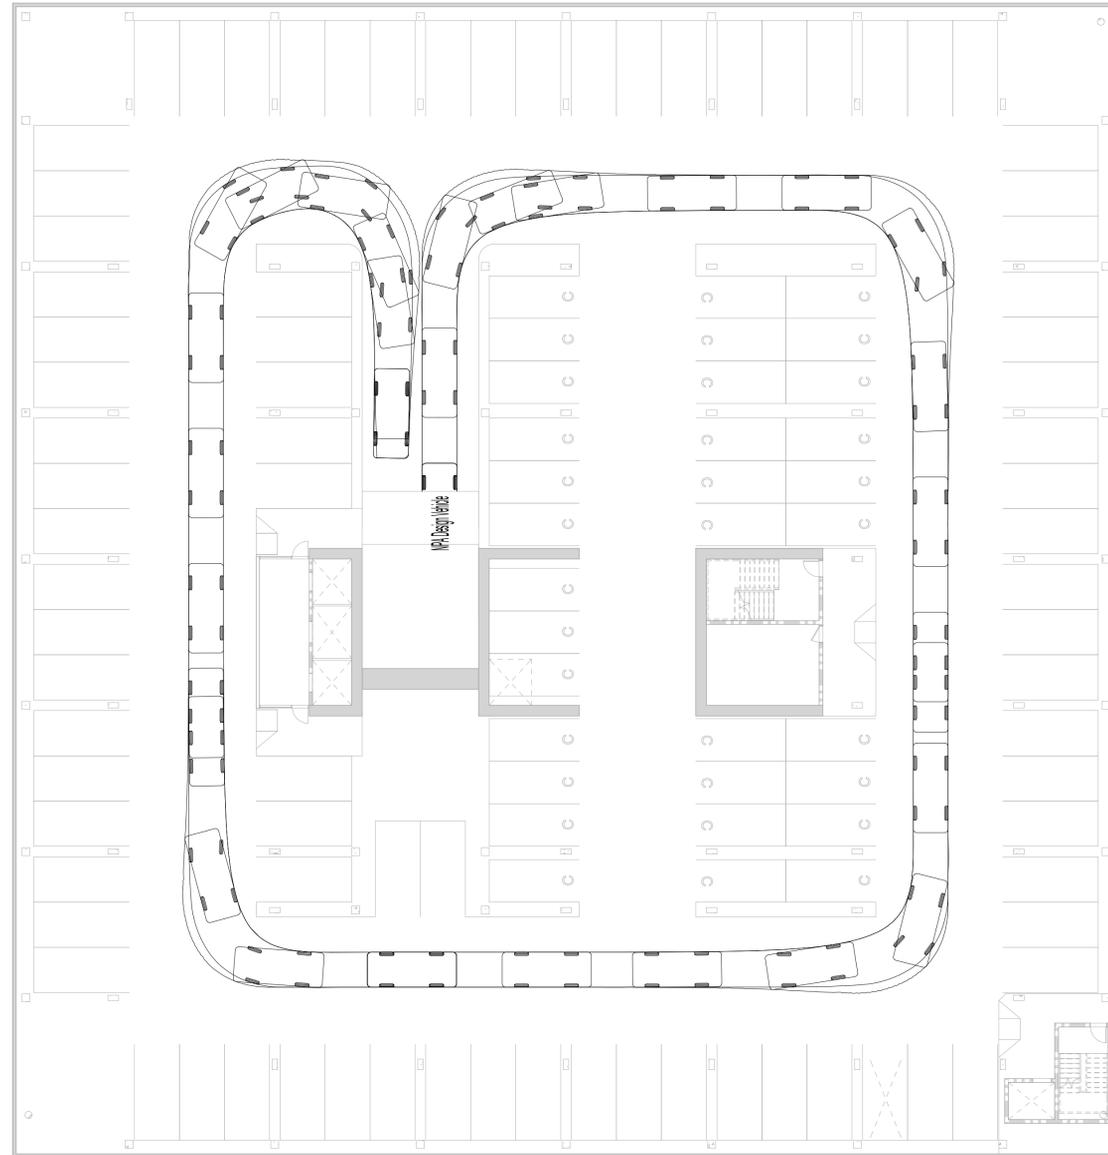

NPA Design Vehicle
Overall Length 16.833ft
Overall Width 6.583ft
Overall Body Height 6.069ft
Min Body Ground Clearance 0.840ft
Track Width 6.583ft
Lock-to-lock time 4.00s
Curb to Curb Turning Radius 19.357ft

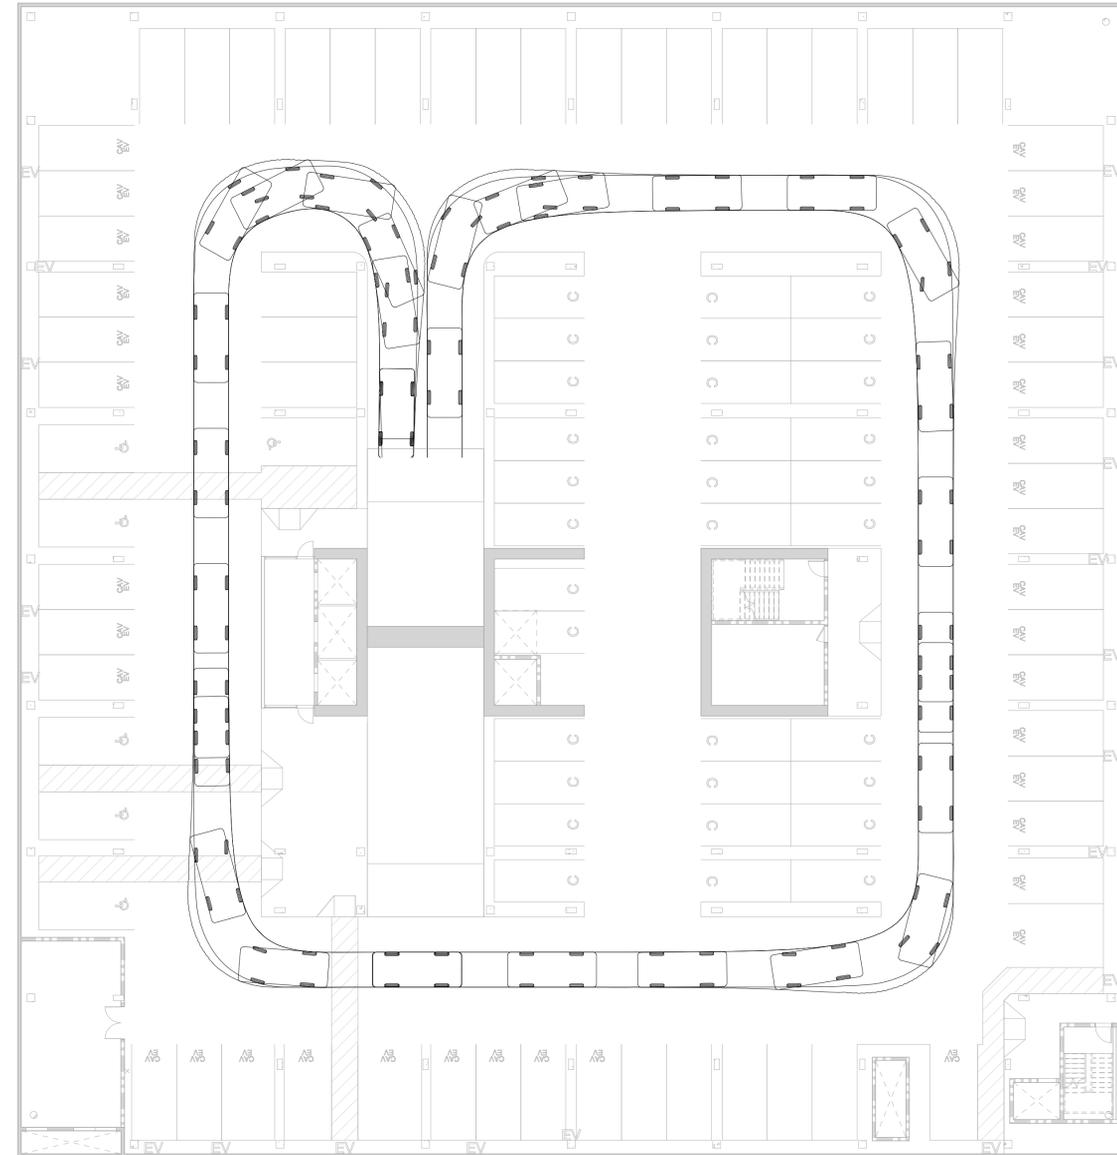

NPA Design Vehicle
Overall Length 16.833ft
Overall Width 6.583ft
Overall Body Height 6.069ft
Min Body Ground Clearance 0.840ft
Track Width 6.583ft
Lock-to-lock time 4.00s
Curb to Curb Turning Radius 19.357ft

② LEVEL B2 - VEHICLE TURNING ANALYSIS
1/16" = 1'-0"

① LEVEL B1 - VEHICLE TURNING ANALYSIS
1/16" = 1'-0"



1 VIEW FROM FOURTH AVENUE
3/32" = 1'-0"

FACADE TYPE 1

- 1A. WOOD STOREFRONT WINDOW SYSTEM WITH METAL AND WOOD CANOPY
- 1B. WOOD STOREFRONT WINDOW SYSTEM WITH DIVIDED TRANSOM LITES AND FABRIC AWNING
- 1C. RECESSED METAL STOREFRONT WINDOW SYSTEM WITH PROFILED METAL HEADERS AND JAMBS AND GLASS CANOPY

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
RENDERING

SCALE
3/32" = 1'-0"

SHEET NUMBER

A-301



- FACADE TYPE 2**
- 2A. WOOD STOREFRONT WINDOW SYSTEM WITH METAL AND WOOD CANOPY
 - 2B. WOOD STOREFRONT WINDOW SYSTEM
 - 2C. RECESSED METAL STOREFRONT WINDOW SYSTEM WITH PROFILED METAL HEADERS AND JAMBS AND GLASS CANOPY
 - 2D. WOOD "NANAWALL" SYSTEM WITH WOOD SOFFIT AND CLADDING
 - 2E. VINE-COVERED WALL

① VIEW FROM ELLSWORTH AVENUE
3/32" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
RENDERING

SCALE
3/32" = 1'-0"

SHEET NUMBER

A-302



FACADE TYPE 3

- 3A. WOOD STOREFRONT WINDOW SYSTEM WITH DIVIDED TRANSOM LITES AND FABRIC AWNING
- 3B. WOOD STOREFRONT WINDOW SYSTEM
- 3C. RECESSED VINE-COVERED WALL

① VIEW FROM FIFTH AVENUE
3/32" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
RENDERING

SCALE
3/32" = 1'-0"

SHEET NUMBER

A-303



FACADE TYPE 4

4A. RECESSED METAL STOREFRONT WINDOW SYSTEM WITH PROFILED METAL HEADERS AND JAMBS AND GLASS CANOPY

4B. WOOD WINDOW SYSTEM WITH METAL AND WOOD CANOPY

4C. WOOD STOREFRONT WINDOW SYSTEM WITH DIVIDED TRANSOM LITES AND FABRIC AWNING

① VIEW FROM B STREET
3/32" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set
E	04/22/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
RENDERING

SCALE
3/32" = 1'-0"

SHEET NUMBER

A-304



ISSUES AND REVISIONS

No.	Date	Description
A	03/19/21	Pre-App Resubmittal
B	10/15/21	Planning Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
RENDERING

SCALE
3/32" = 1'-0"

SHEET NUMBER

A-305

① VIEW OF FOURTH AVENUE RETAIL
3/32" = 1'-0"



GL-4: RESIDENTIAL WINDOWS



GL-2: SPANDREL GLASS



GL-1: CLEAR GLASS



WD-1: WOOD



MTL-2

GL-4

BR-1

GL-2

GL-1

BR-1

GL-2

MTL-2

GL-1

GL-3

BR-1

BR-1

GL-1

WD-1

GL-1

BR-1

BR-1


GL-1

WD-1


GL-1

BR-1

CON-1

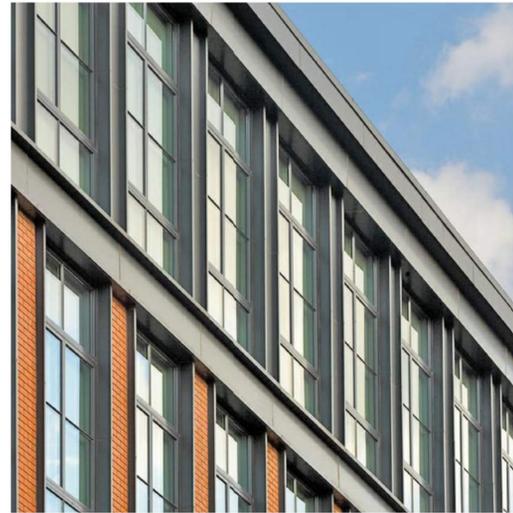


MTL-1: PAINTED ALUMINUM TRIM

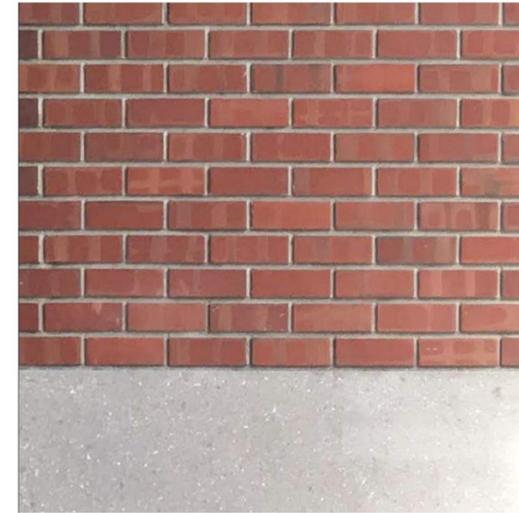

CON-1: CONCRETE BASE



MTL-2: PAINTED ALUMINUM PANELS

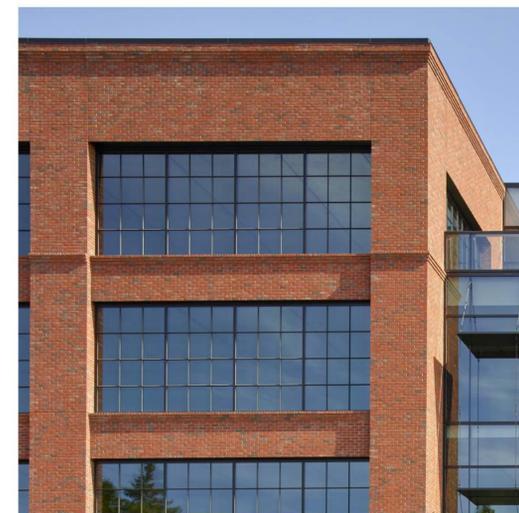

BR-1: RED BRICK

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
MATERIALS


SCALE
3/16" = 1'-0"

SHEET NUMBER

A-306

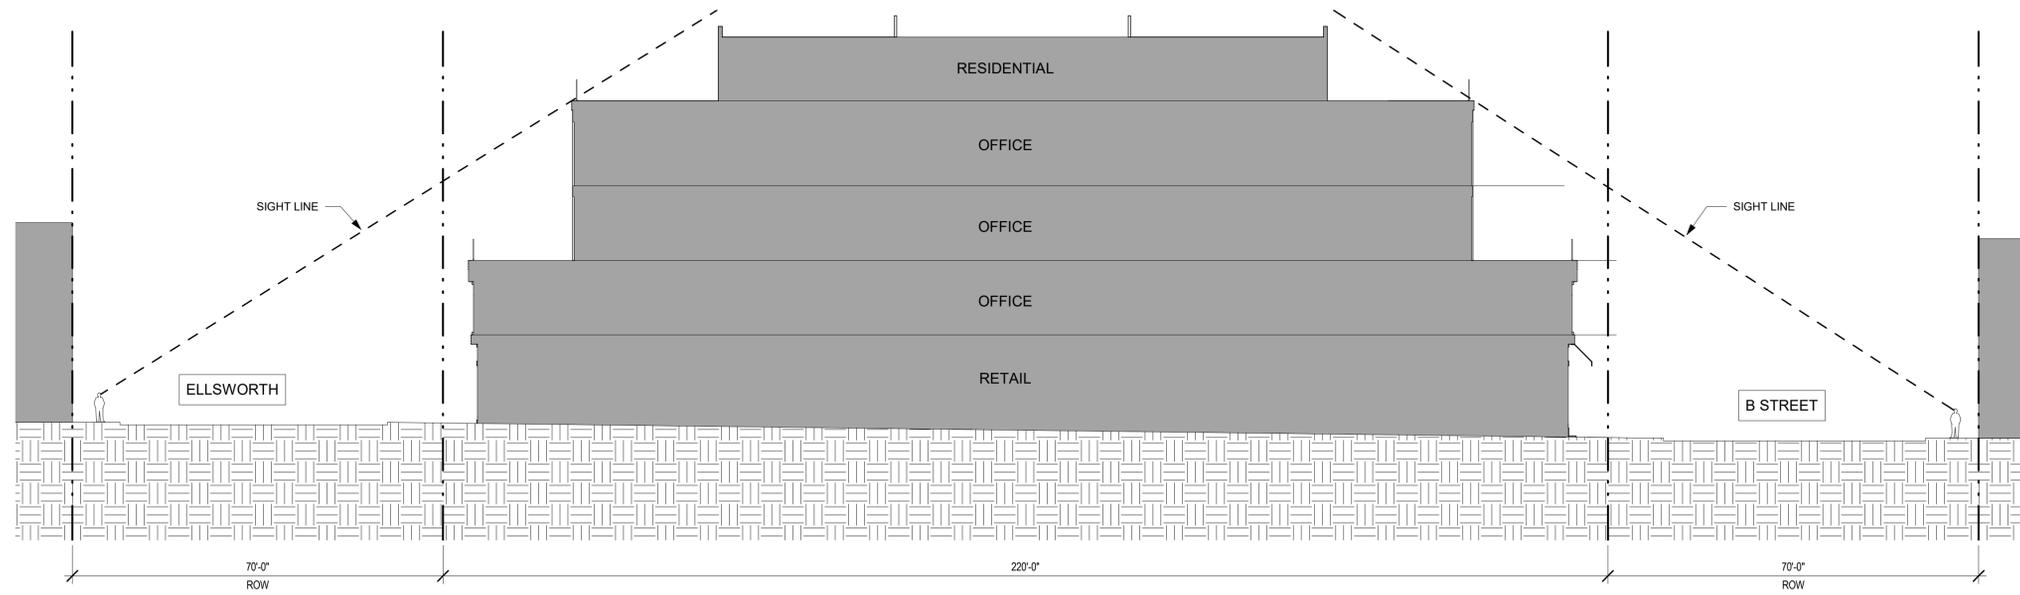

② Site Section 2
1/16" = 1'-0"

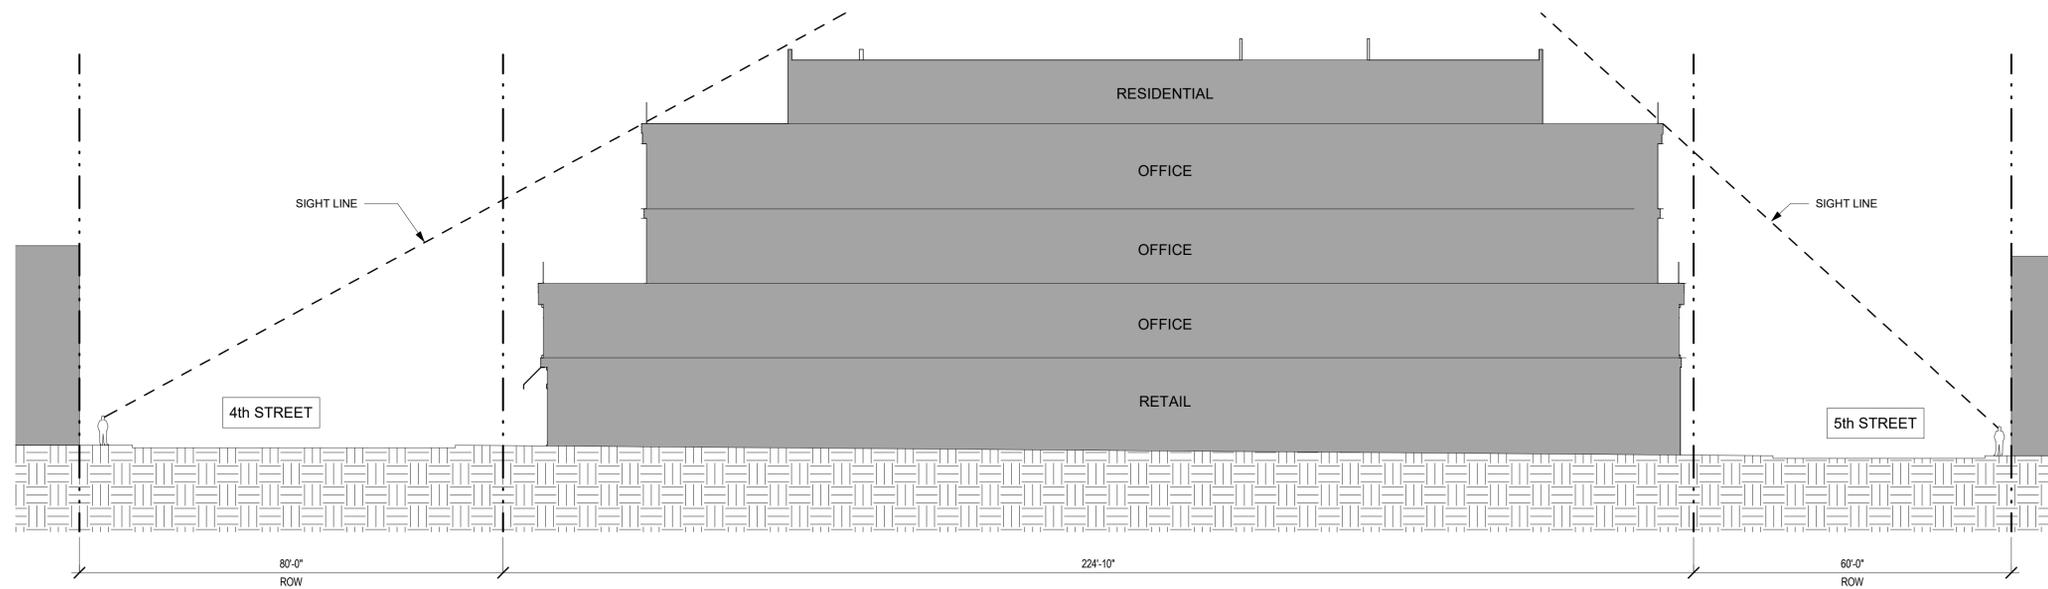

① Site Section 1
1/16" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	10/21/20	Pre-App Resubmittal
B	03/19/21	Pre-App Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LINE OF SIGHT DIAGRAMS

SCALE
1/16" = 1'-0"

SHEET NUMBER

A-307



② South - 5th Street
3/32" = 1'-0"

*(E) ELEVATION TO REMAIN

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set
E	02/04/22	Planning Resubmittal
F	04/22/22	Planning Resubmittal
G	06/15/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
BUILDING ELEVATIONS

SCALE
3/32" = 1'-0"

SHEET NUMBER

A-311



① North - 4th Street
3/32" = 1'-0"

*(E) ELEVATION TO REMAIN



② West - Ellsworth
3/32" = 1'-0"



① East - B Street
3/32" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	10/15/21	Planning Application Set
E	02/04/22	Planning Resubmittal
F	04/22/22	Planning Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
BUILDING ELEVATIONS


SCALE
3/32" = 1'-0"

SHEET NUMBER

A-312

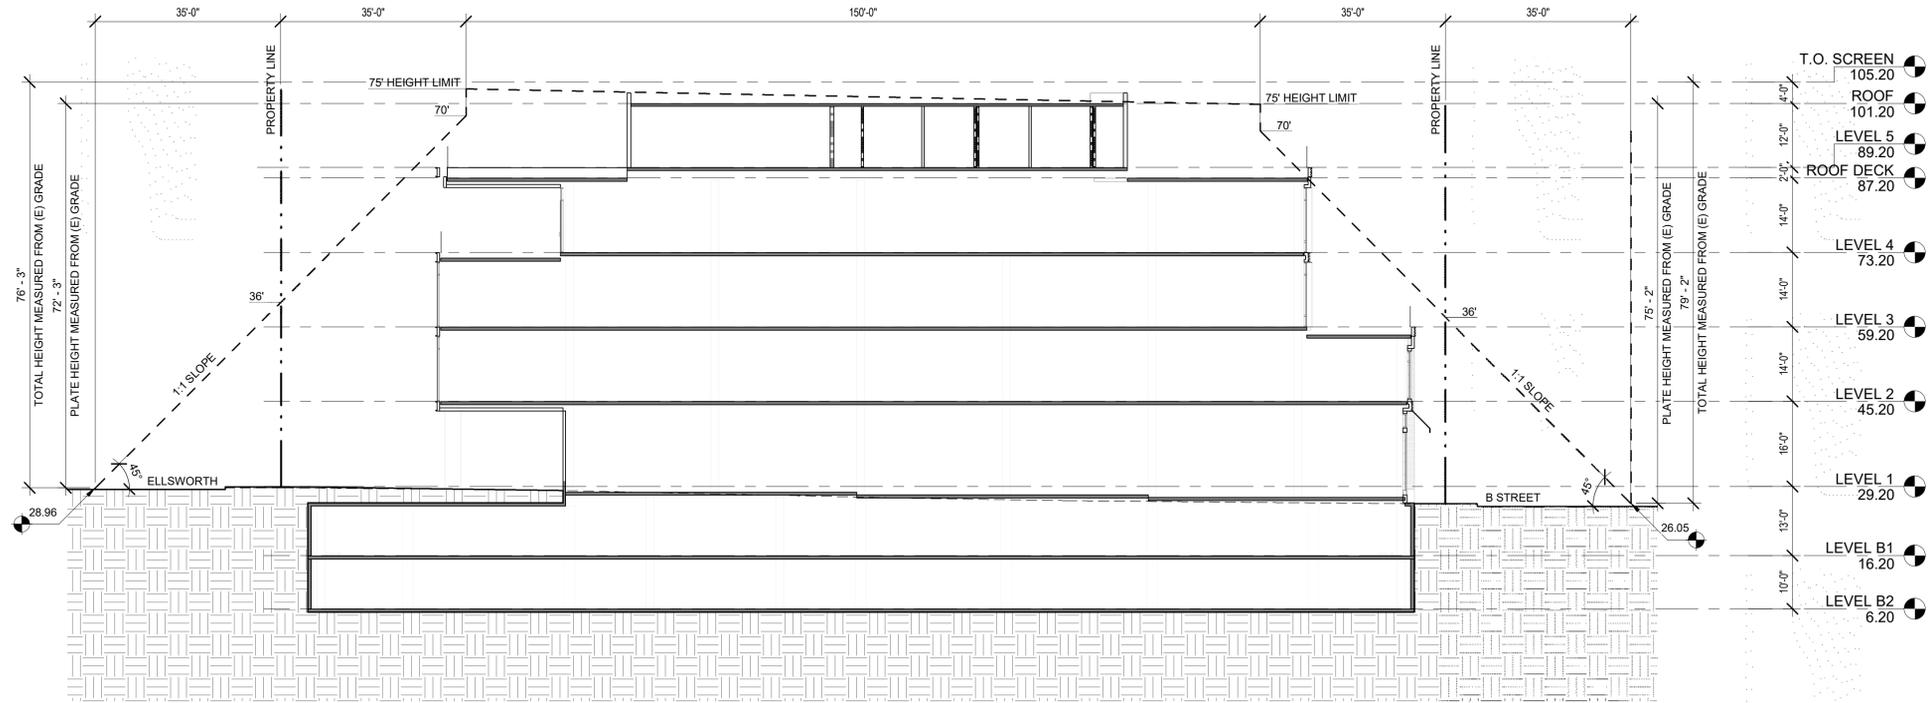

② Section 2
1/16" = 1'-0"

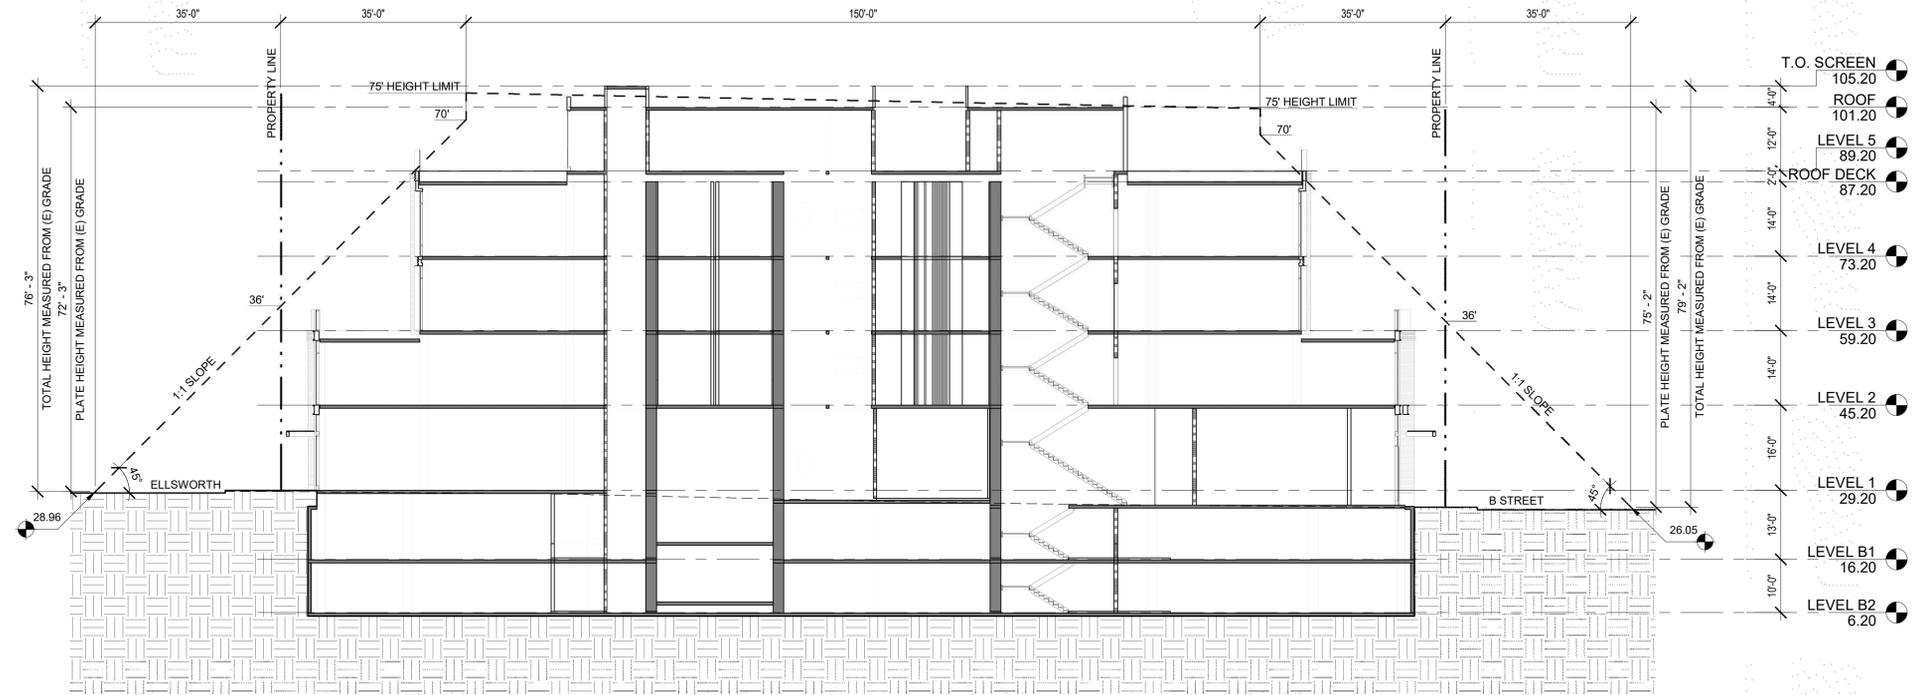

① Section 1
1/16" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	02/04/22	Planning Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
BUILDING SECTIONS


SCALE
1/16" = 1'-0"

SHEET NUMBER

A-321

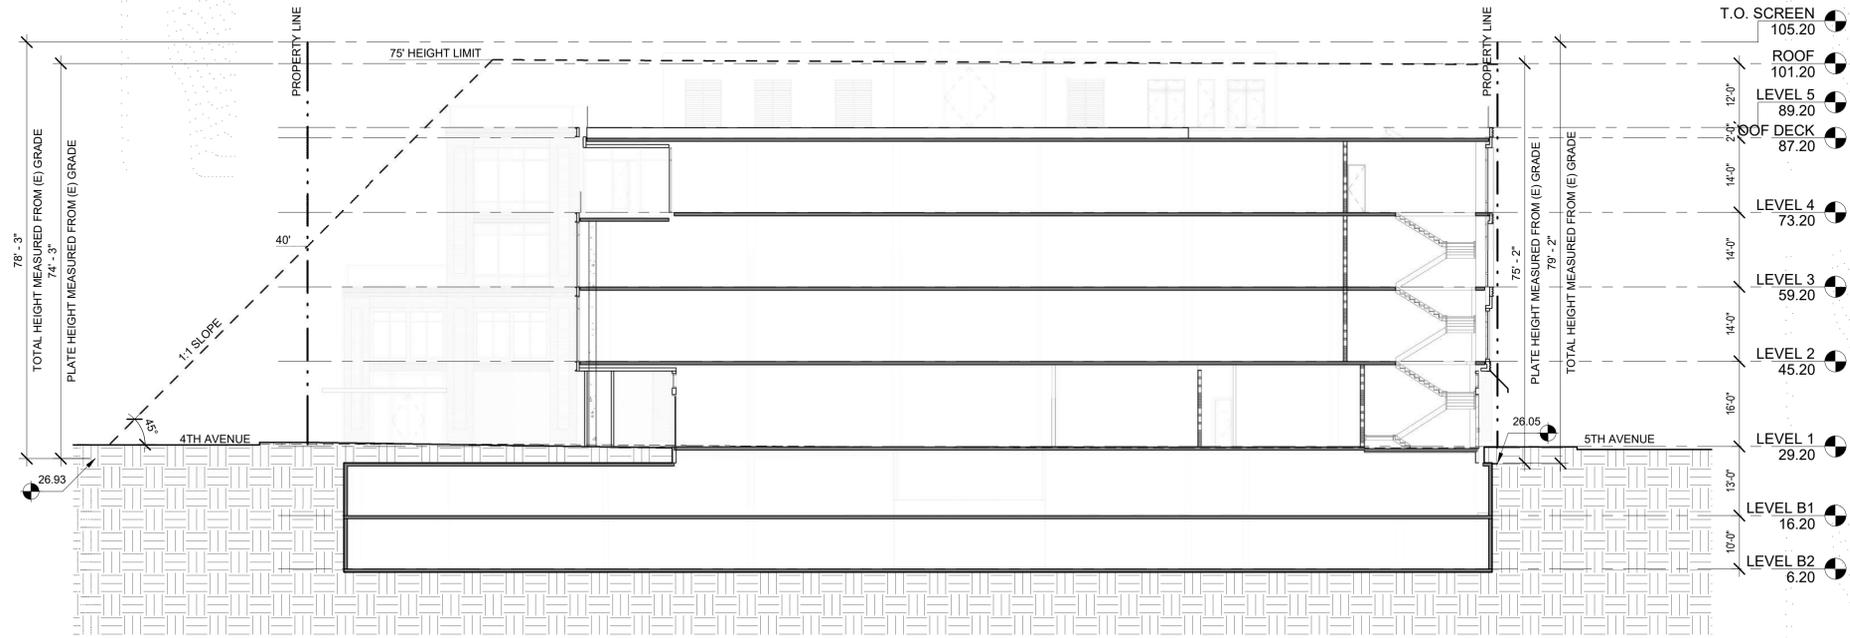

② Section 4
1/16" = 1'-0"

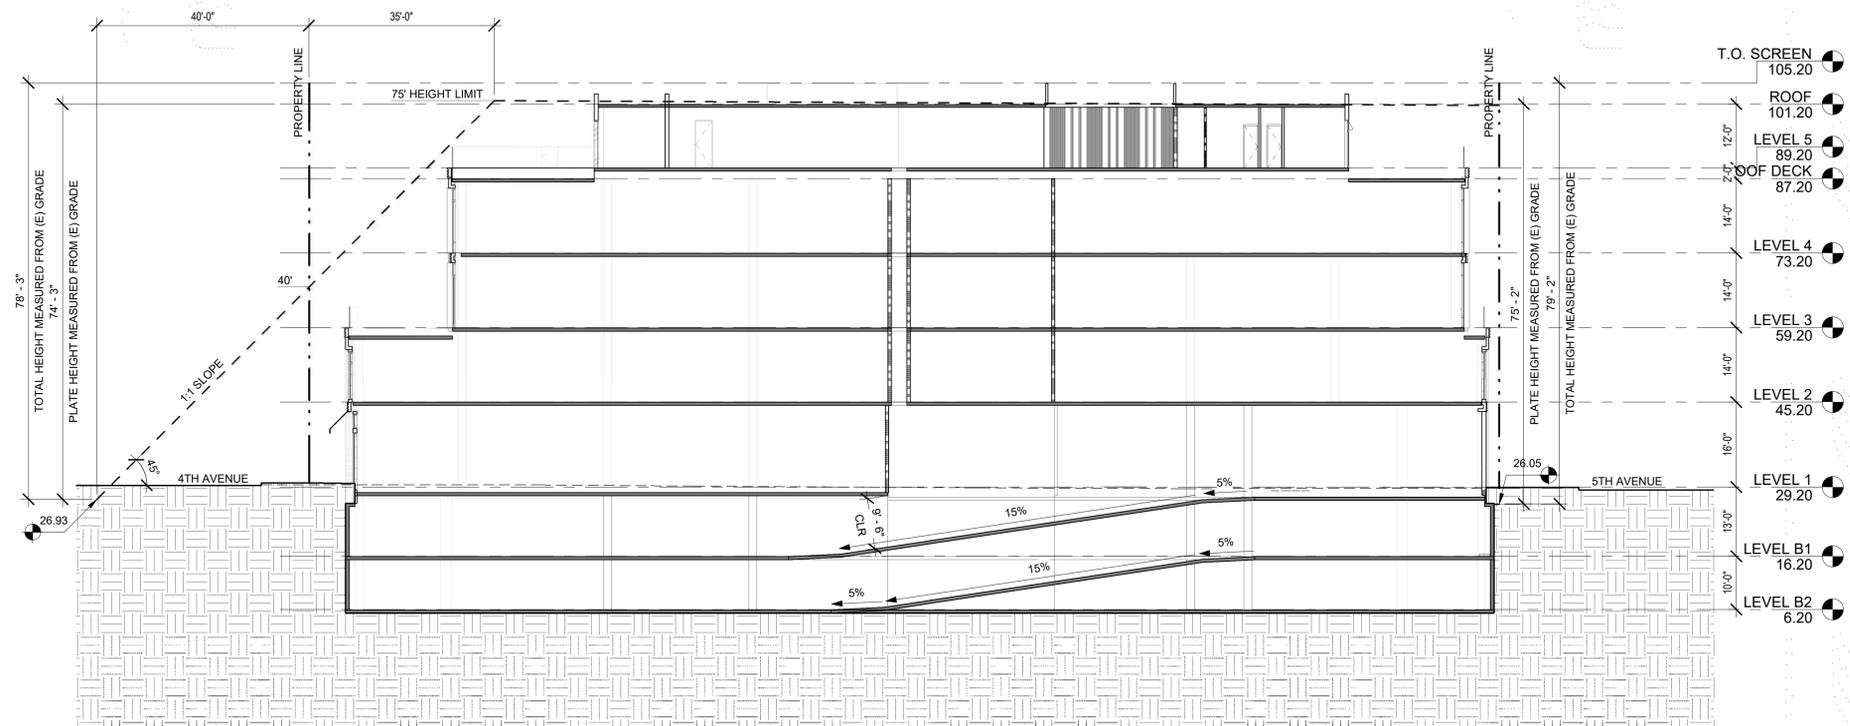

① Section 3
1/16" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal
D	02/04/22	Planning Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
BUILDING SECTIONS

SCALE
1/16" = 1'-0"

SHEET NUMBER

A-322

ISSUES AND REVISIONS

No.	Date	Description
A	03/19/21	Pre-App Resubmittal
B	04/22/22	Planning Resubmittal







PROJECT NUMBER
16010.00

SHEET TITLE
ENLARGED ELEVATIONS AND SECTIONS

SCALE
As indicated

SHEET NUMBER

A-401

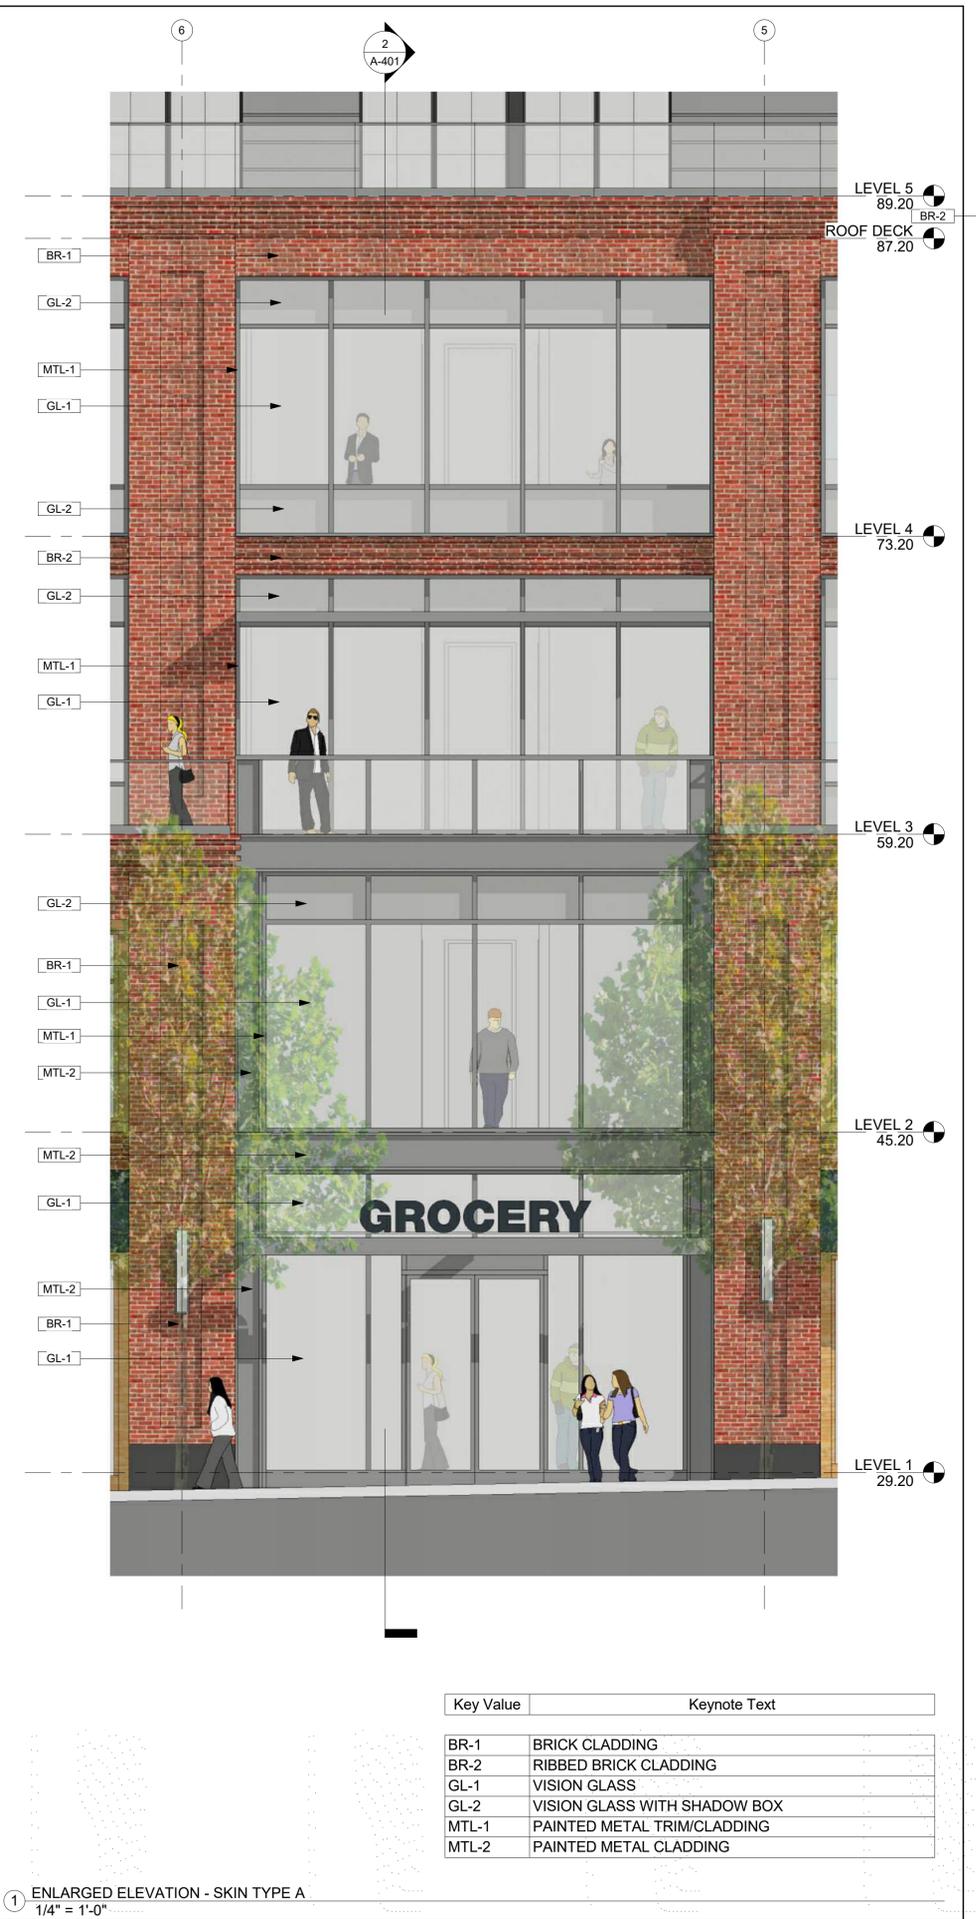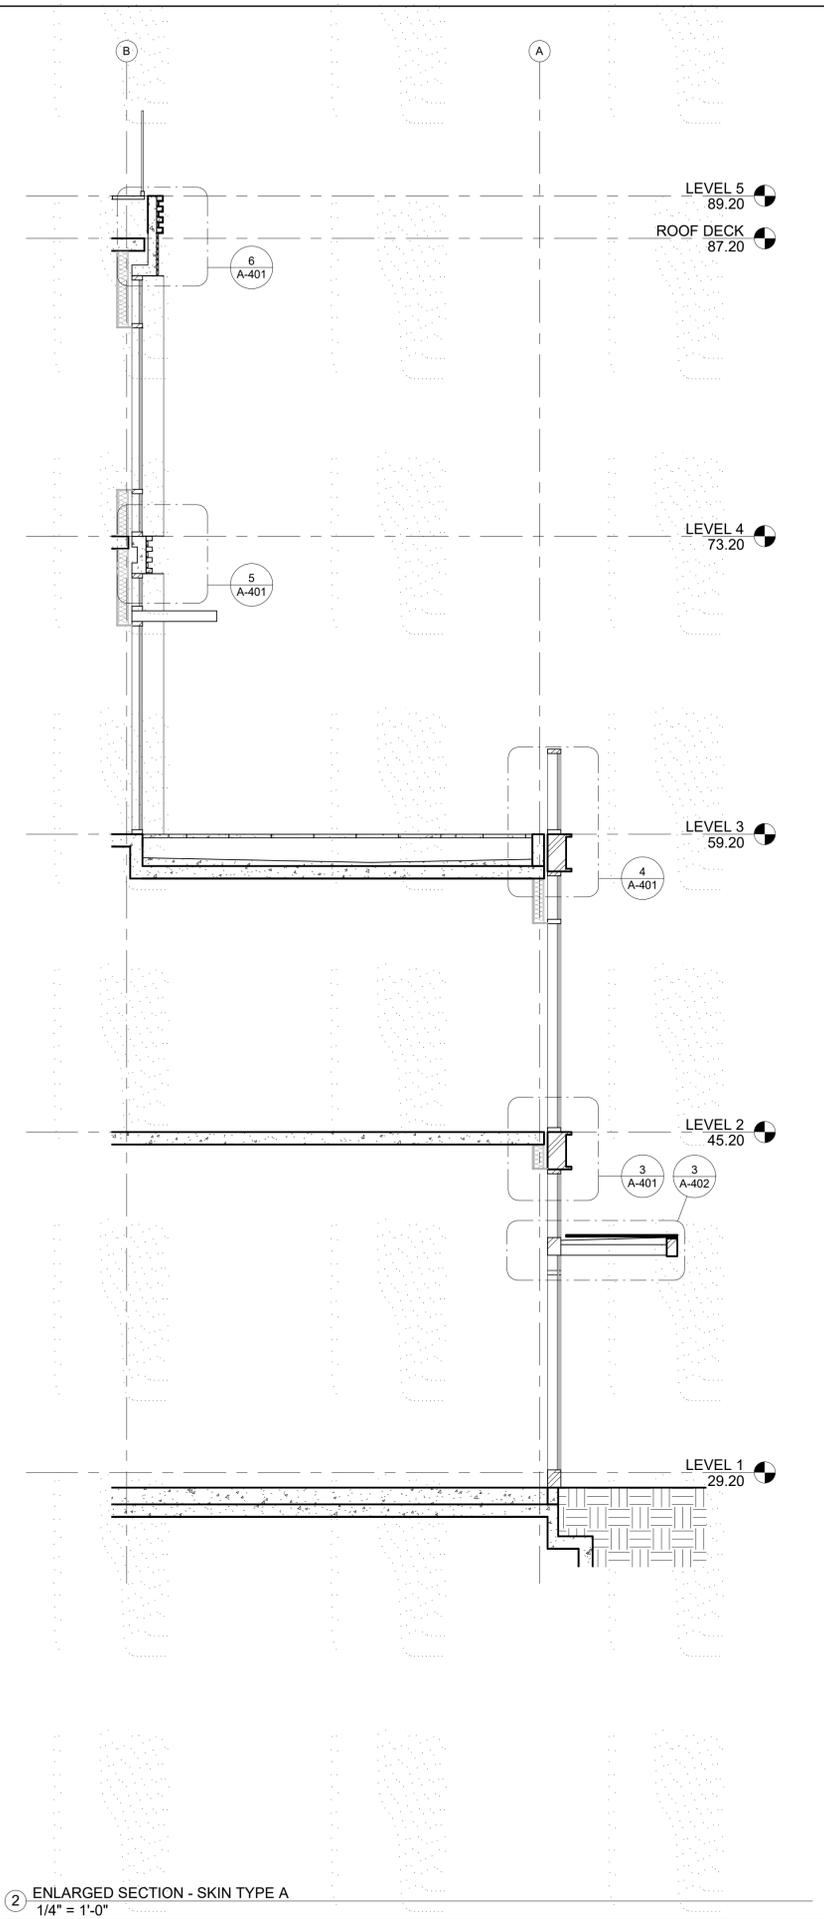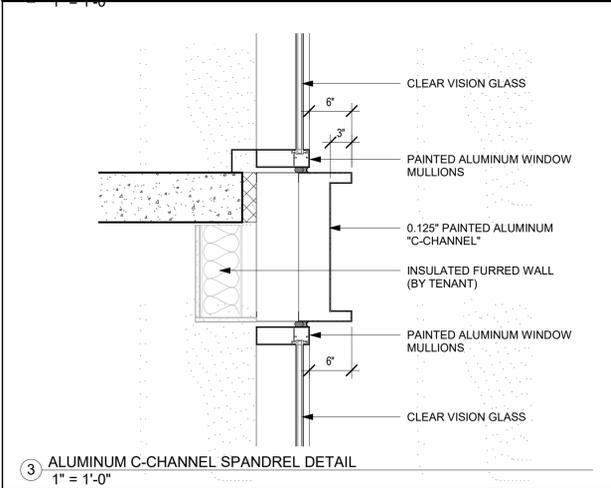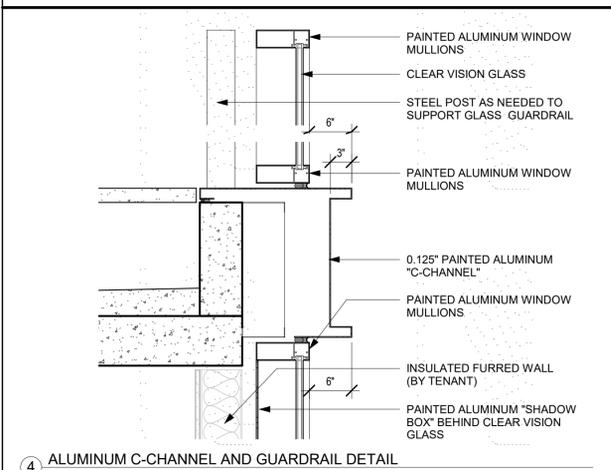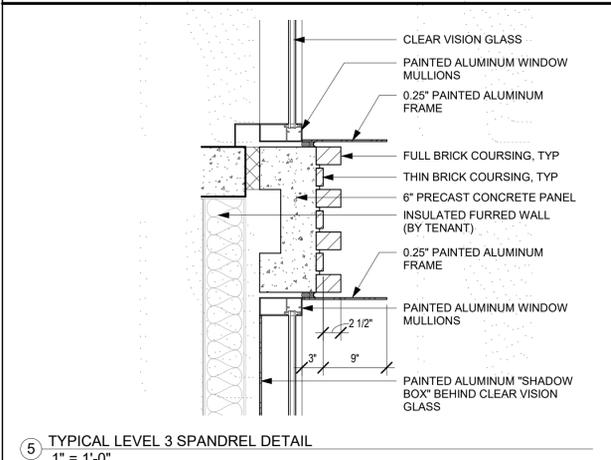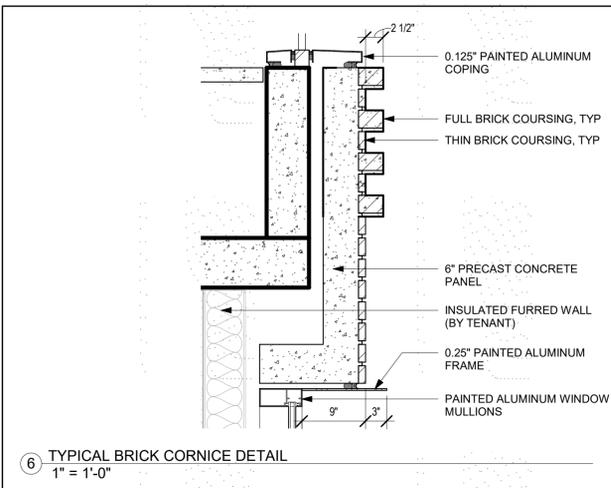

Key Value	Keynote Text
BR-1	BRICK CLADDING
BR-2	RIBBED BRICK CLADDING
GL-1	VISION GLASS
GL-2	VISION GLASS WITH SHADOW BOX
MTL-1	PAINTED METAL TRIM/CLADDING
MTL-2	PAINTED METAL CLADDING

ISSUES AND REVISIONS

No.	Date	Description
A	03/19/21	Pre-App Resubmittal
B	04/22/22	Planning Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
ENLARGED ELEVATIONS AND SECTIONS


SCALE
As indicated

SHEET NUMBER


A-402

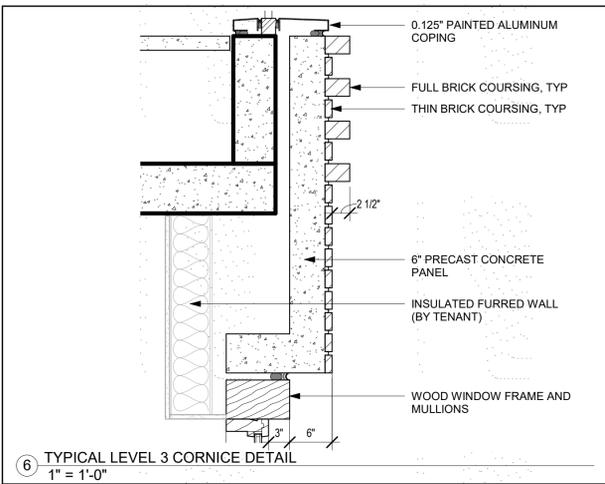


6 TYPICAL LEVEL 3 CORNICE DETAIL
1" = 1'-0"

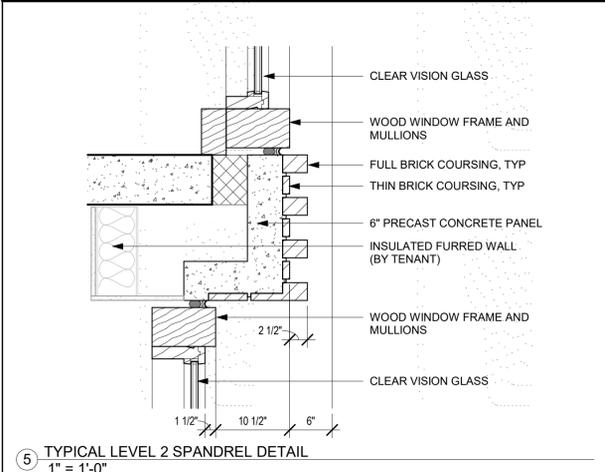


5 TYPICAL LEVEL 2 SPANDREL DETAIL
1" = 1'-0"

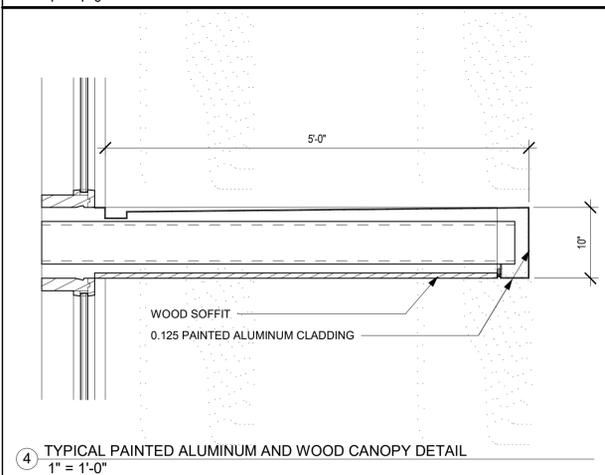

4 TYPICAL PAINTED ALUMINUM AND WOOD CANOPY DETAIL
1" = 1'-0"

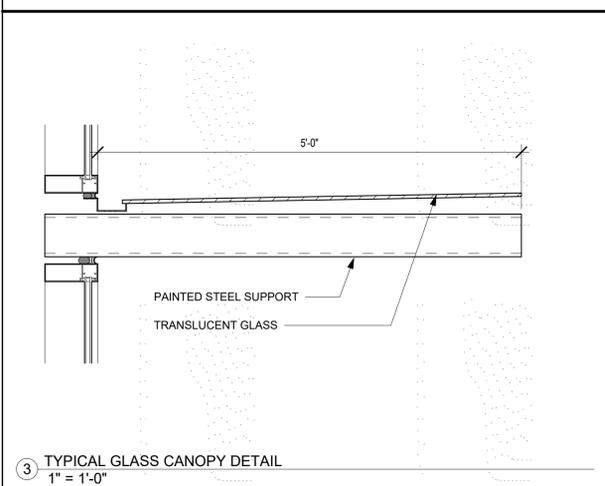

3 TYPICAL GLASS CANOPY DETAIL
1" = 1'-0"

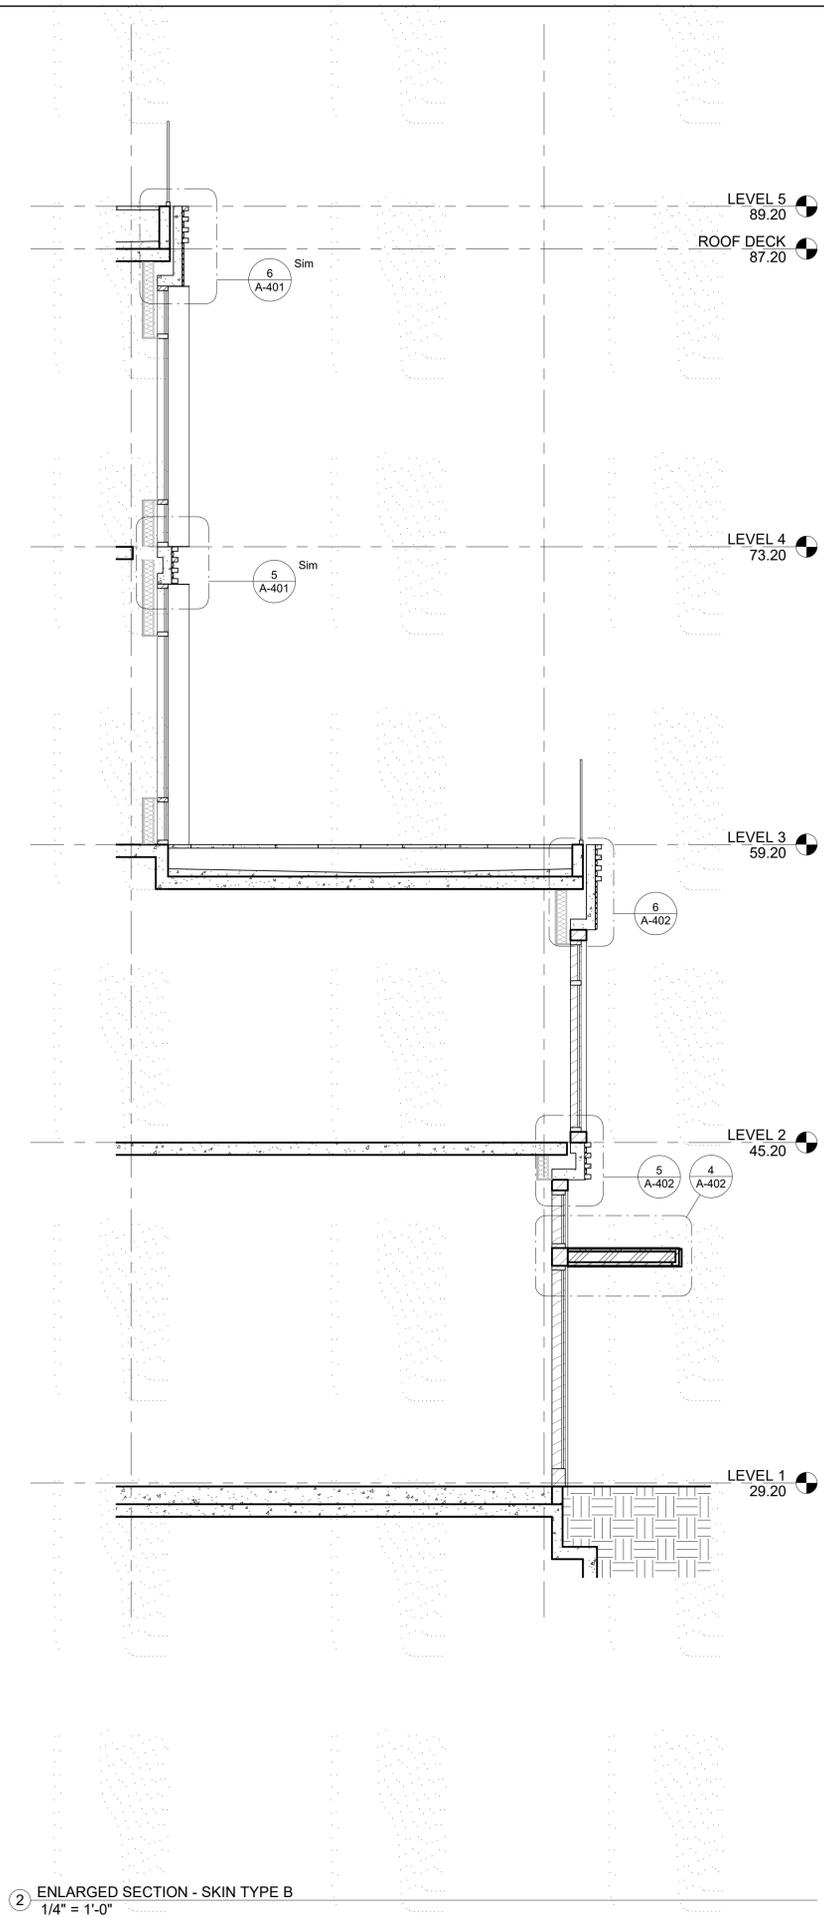

2 ENLARGED SECTION - SKIN TYPE B
1/4" = 1'-0"



1 ENLARGED SECTION - SKIN TYPE B
1/4" = 1'-0"

Key Value	Keynote Text
BR-1	BRICK CLADDING
BR-2	RIBBED BRICK CLADDING
GL-1	VISION GLASS
GL-2	VISION GLASS WITH SHADOW BOX
MTL-1	PAINTED METAL TRIM/CLADDING
WD-1	WOOD TRIM/CLADDING

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal


PROJECT NUMBER
A19538-1

SHEET TITLE
**EXISTING
CONDITIONS
PLAN**

SCALE
AS SHOWN

SHEET NUMBER

C1.00



NOTES

- THIS IS NOT A BOUNDARY SURVEY. NO LIABILITY IS ASSUMED, BY KIER & WRIGHT, FOR THE EXISTENCE OF ANY EASEMENTS, ENCUMBRANCES, DISCREPANCIES IN BOUNDARY, OR TITLE DEFECTS NOT MENTIONED IN SAID DOCUMENTS AND THEREFORE NOT SHOWN ON THIS DRAWING. PROPERTY LINE PLOT ONLY (NO EASEMENTS SHOWN)
- ALL DISTANCES AND ELEVATIONS SHOWN HEREON ARE IN FEET AND DECIMALS THEREOF.
- THE TYPES, LOCATIONS, SIZES AND/OR DEPTHS OF EXISTING UNDERGROUND UTILITIES AS SHOWN ON THIS TOPOGRAPHIC SURVEY WERE OBTAINED FROM SOURCES OF VARYING RELIABILITY. THE CONTRACTOR IS CAUTIONED THAT ONLY ACTUAL EXCAVATION WILL REVEAL THE TYPES, EXTENT, SIZES, LOCATIONS AND DEPTHS OF SUCH UNDERGROUND UTILITIES. (A REASONABLE EFFORT HAS BEEN MADE TO LOCATE AND DELINEATE ALL KNOWN UNDERGROUND UTILITIES). HOWEVER, THE ENGINEER CAN ASSUME NO RESPONSIBILITY FOR THE COMPLETENESS OR ACCURACY OF ITS DELINEATION OF SUCH UNDERGROUND UTILITIES WHICH MAY BE ENCOUNTERED, BUT WHICH ARE NOT SHOWN ON THESE DRAWINGS.
- A REQUEST WAS MADE TO PACIFIC GAS & ELECTRIC COMPANY FOR INFORMATION REGARDING THE LOCATION OF THEIR FACILITIES NEAR THIS SITE. AS OF DECEMBER 13, 2019, THEY HAD NOT RESPONDED WITH THIS INFORMATION. UNTIL WE RECEIVE THIS INFORMATION AND ARE ABLE TO DELINEATE THESE FACILITIES, ALL PARTIES SHOULD CONSIDER THIS SURVEY AS PRELIMINARY WITH REGARDS TO THE LOCATION OF THE UTILITY FACILITIES. UPON RECEIPT OF THIS INFORMATION KIER & WRIGHT WILL UPDATE THIS SURVEY AND REISSUE IT.

5. THE SUBJECT PROPERTY IS SHOWN ON THE FEDERAL EMERGENCY MANAGEMENT AGENCY (FEMA) FLOOD INSURANCE RATE MAP (FIRM) FOR SAN MATEO COUNTY, CALIFORNIA, MAP NUMBER 060810154G FOR COMMUNITY NUMBER 060328 (CITY OF SAN MATEO), WITH AN EFFECTIVE DATE OF APRIL 5, 2019, AS BEING LOCATED IN FLOOD ZONE "X NO SCREEN". ACCORDING TO FEMA THE DEFINITION OF ZONE "X NO SCREEN" IS: AREAS OF MINIMAL FLOOD HAZARD

INFORMATION WAS OBTAINED FROM THE CITY OF SAN MATEO, PUBLIC WORKS DEPARTMENT ON DECEMBER 17, 2019.

6. BENCHMARK:
CITY OF SAN MATEO BENCHMARK 082-001; RAMSET NAIL AND WASHER, TOP OF CURB WESTERLY END AND WESTERLY RETURN AT B STREET AND 4TH AVENUE.
ELEVATION: 26.693 DATUM: SAN MATEO DATUM +100


7. BASIS OF BEARINGS:
THE BEARING OF SOUTH 48° 30' 00" WEST TAKEN ON THE MONUMENT LINE OF EAST FOURTH AVENUE AS SHOWN ON THAT CERTAIN PARCEL MAP FILED FOR RECORD ON JUNE 10, 1996, IN BOOK 69 OF PARCEL MAPS AT PAGES 22, NO. 350 OF SAN MATEO COUNTY RECORDS WAS TAKEN AS THE BASIS FOR ALL BEARINGS SHOWN HEREON.

8. CORNER RECORD NOTE:
THE DEVELOPER AND/OR CONTRACTOR SHALL BE RESPONSIBLE FOR THE PREPARATION AND FILING OF PRE-CONSTRUCTION AND POST-CONSTRUCTION CORNER RECORDS FOR ANY MONUMENTS OR PROPERTY CORNERS SHOWN HEREON THAT MAY BE DESTROYED DURING IMPROVEMENTS TO THE SUBJECT PROPERTY AS DEFINED IN SECTION 8771(B) OF THE PROFESSIONAL LAND SURVEYORS ACT.

LEGEND

	BUILDING LINE
	MONUMENT LINE
	CONCRETE/BLOCK/RETAINING WALL
	CONCRETE CURB
	CONCRETE CURB & GUTTER
	DRIVEWAY
	EASEMENT LINE
	ELECTRIC LINE
	FENCE LINE
	GAS LINE-VALVE & METER
	LOT LINE
	MONUMENT/MONUMENT LINE
	PROPERTY LINE
	SANITARY SEWER LINE-MANHOLE & CLEANOUT
	SIDEWALK
	SPOT ELEVATION
	STORM DRAIN LINE-MANHOLE & CATCH BASIN
	TELEPHONE LINE
	WATER LINE & VALVE
	ACCESSIBLE PARKING SYMBOL
	BACKFLOW PREVENTION DEVICE
	ELECTROLINER
	FIRE HYDRANT
	GAS METER
	TRANSFORMER
	TRAFFIC SIGNAL POLE
	TRAFFIC SIGN
	TREE
	UTILITY BOX
	WATER VALVE

PREPARED BY: [Signature]
RODNEY A. STEWART II P.L.S. 9225
No. 9225
LICENSED LAND SURVEYOR
STATE OF CALIFORNIA

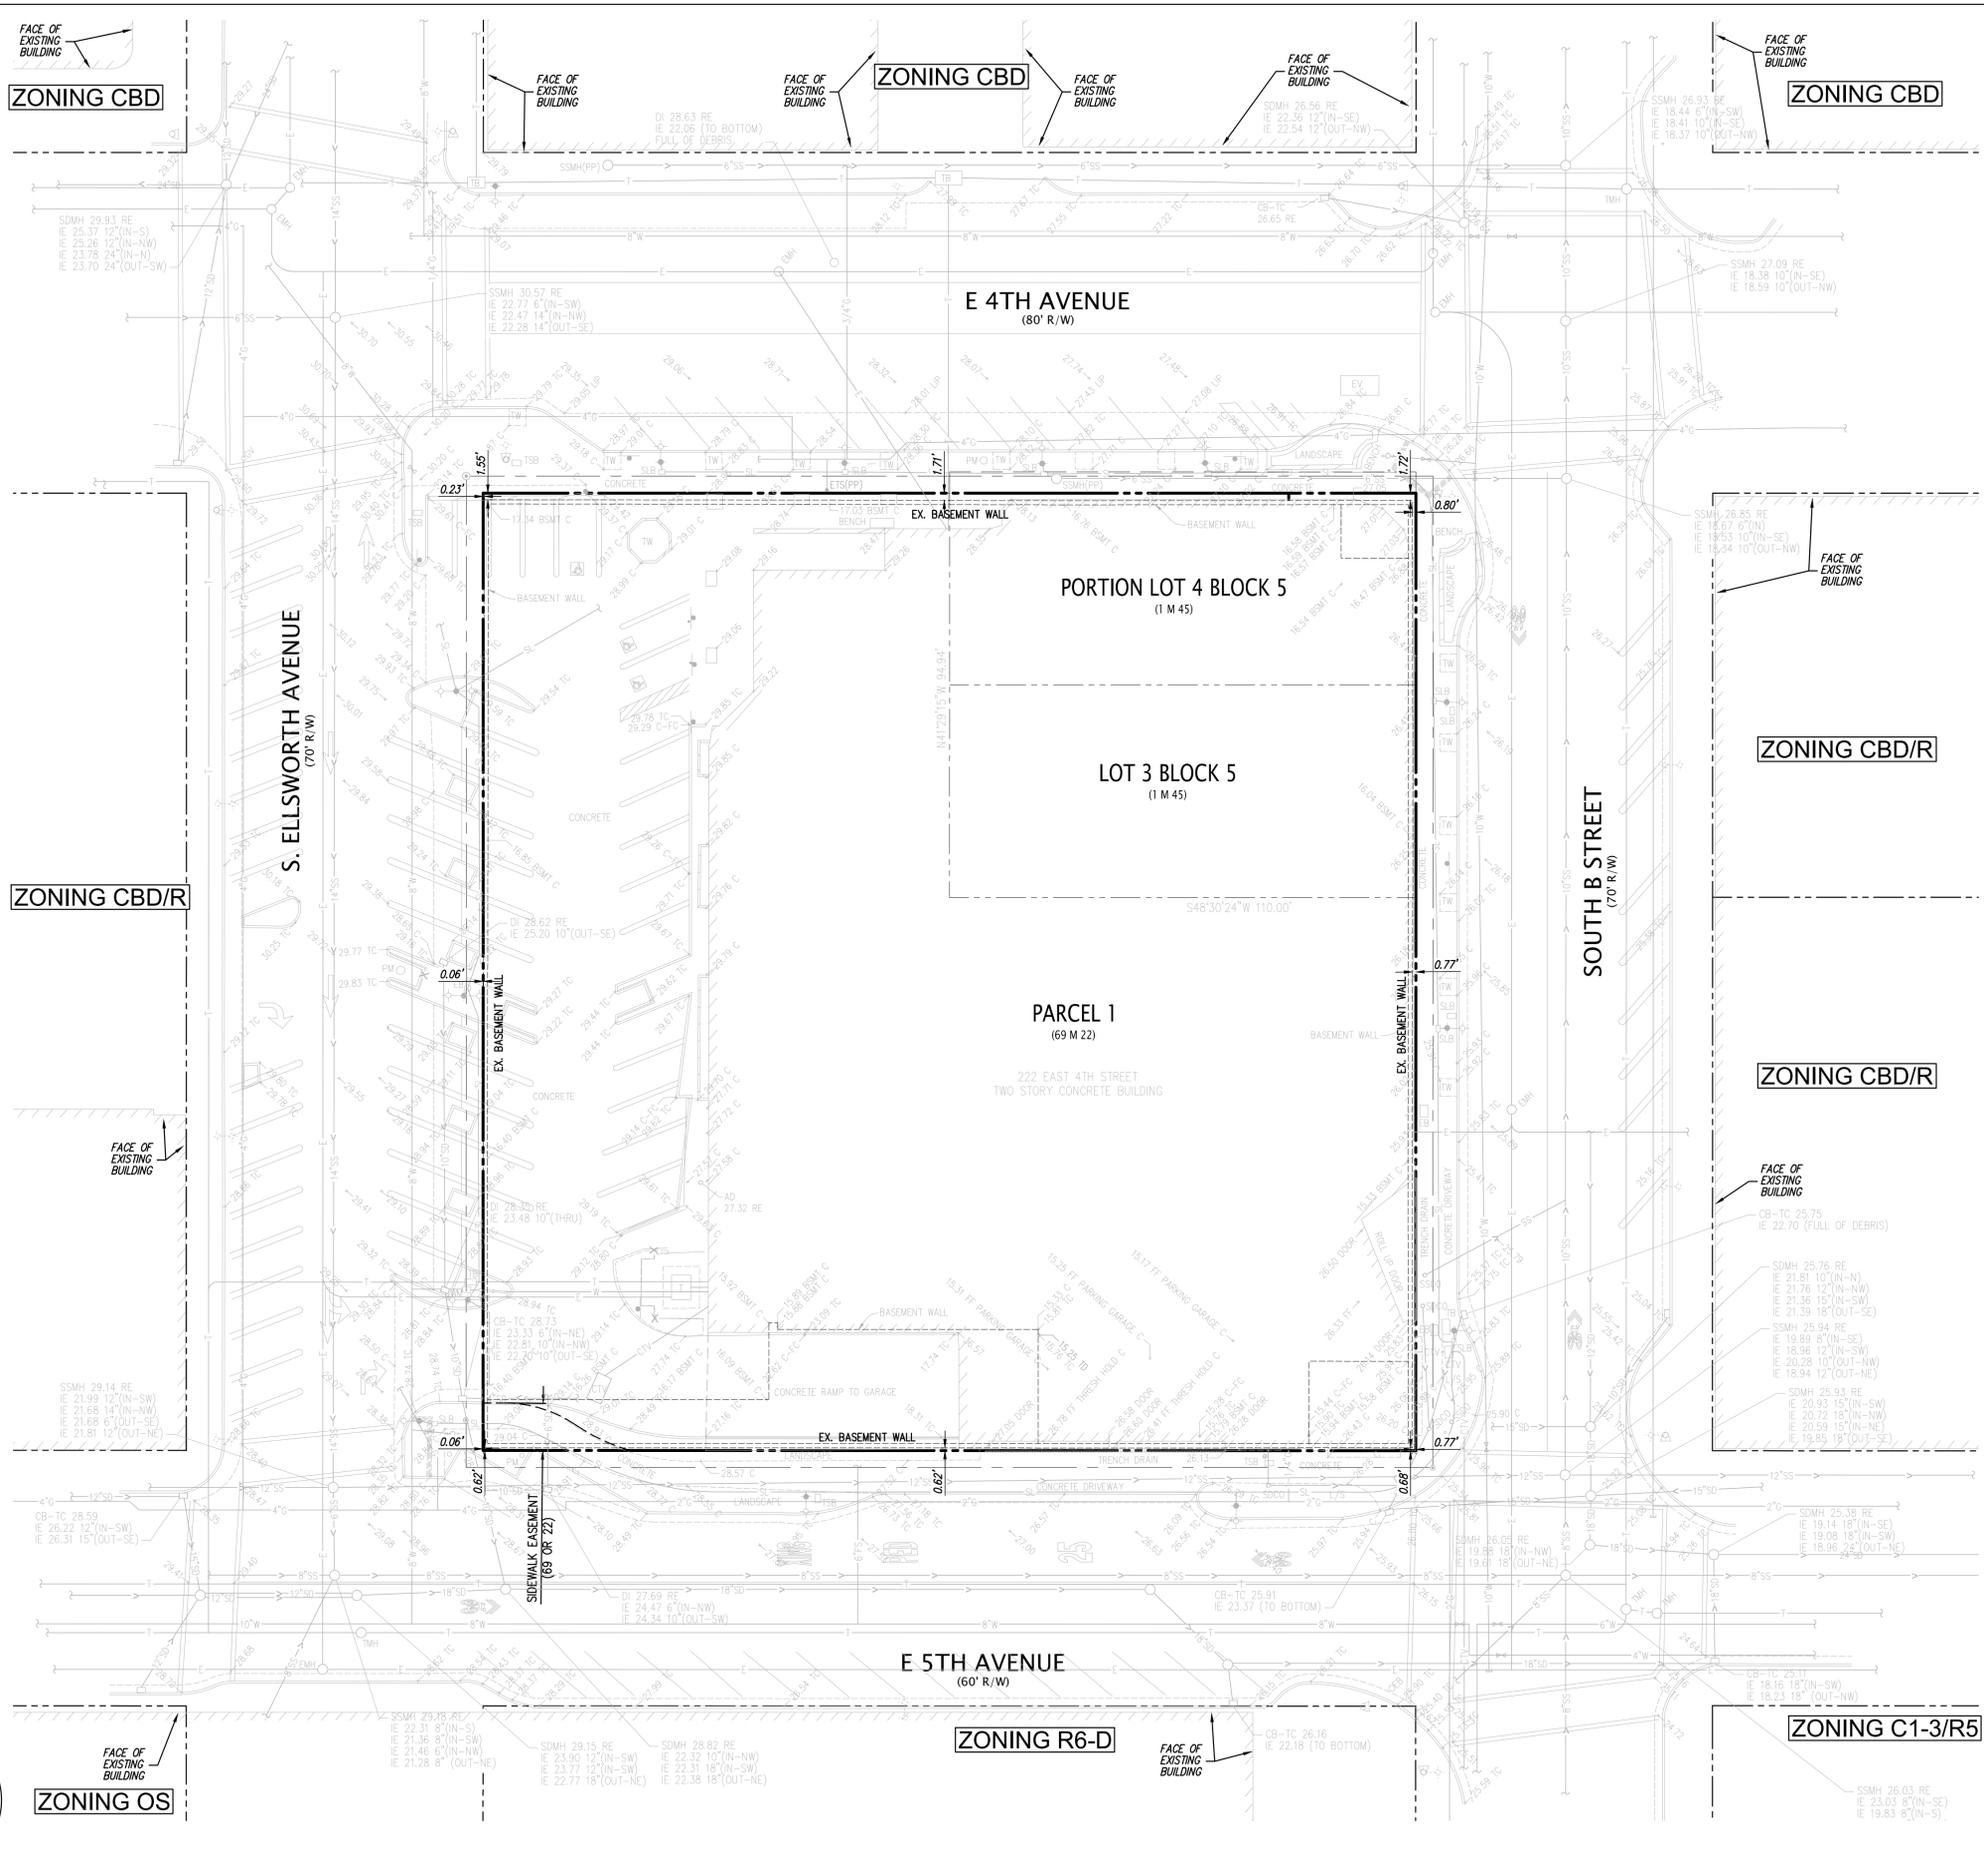

Z:\2019\A19538-1\DWG\entitlements\pdr_permit\A19538-1-PC-TS.dwg 6-17-22 08:07:17 AM tkunusun

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal


PROJECT NUMBER
A19538-1

SHEET TITLE
**DEMOLITION
PLAN**

SCALE
AS SHOWN

SHEET NUMBER

C1.01




NOTES

1. REMOVE ALL TREES AND SHRUBS WITHIN PROJECT LIMIT OF WORK.
2. REMOVE EXISTING BUILDING, BELOW GRADE PARKING STRUCTURE AND FOUNDATION IN ENTIRETY.
3. REMOVE ALL CONCRETE, AC PAVEMENT AND BASE ROCK SUBGRADE WITHIN PROJECT LIMIT OF WORK.
4. REMOVE ALL LANDSCAPING AND IRRIGATION WITHIN LIMIT OF WORK.
5. ALL UNUSED WATER LATERALS SHALL BE REMOVED AND CAPPED AT THE MAIN.
6. CONTRACTOR SHALL COORDINATE REMOVAL OF BIKE RACKS ALONG THE PROJECT FRONTAGE WITH PUBLIC WORKS.

LEGEND

- ✕ ✕ ✕ UNDERGROUND UTILITIES TO BE REMOVED
- / — / — UNDERGROUND UTILITIES TO BE ABANDONED
- ⌈ ⌋ PLUG AND CAP END
- ① REMOVE CONCRETE CURB & GUTTER
- ② REMOVE CONCRETE CURB
- ③ REMOVE CONCRETE & BASE ROCK
- ④ REMOVE ASPHALT & BASE ROCK
- ⑤ REMOVE EXISTING UTILITY IN ENTIRETY
- ⑥ REMOVE EXISTING UTILITY STRUCTURE
- ⑦ PROTECT EXISTING UTILITY IN PLACE
- ⑧ REMOVE EXISTING PARKING METER STATION
- ⑨ REMOVE PLANTER WALL
- ⑩ REMOVE SIGN
- ⑪ REMOVE EXISTING CURB, GUTTER, SIDEWALK AND RAMP. PROTECT ALL TRAFFIC POLES, BOXES & PUSH BUTTONS.

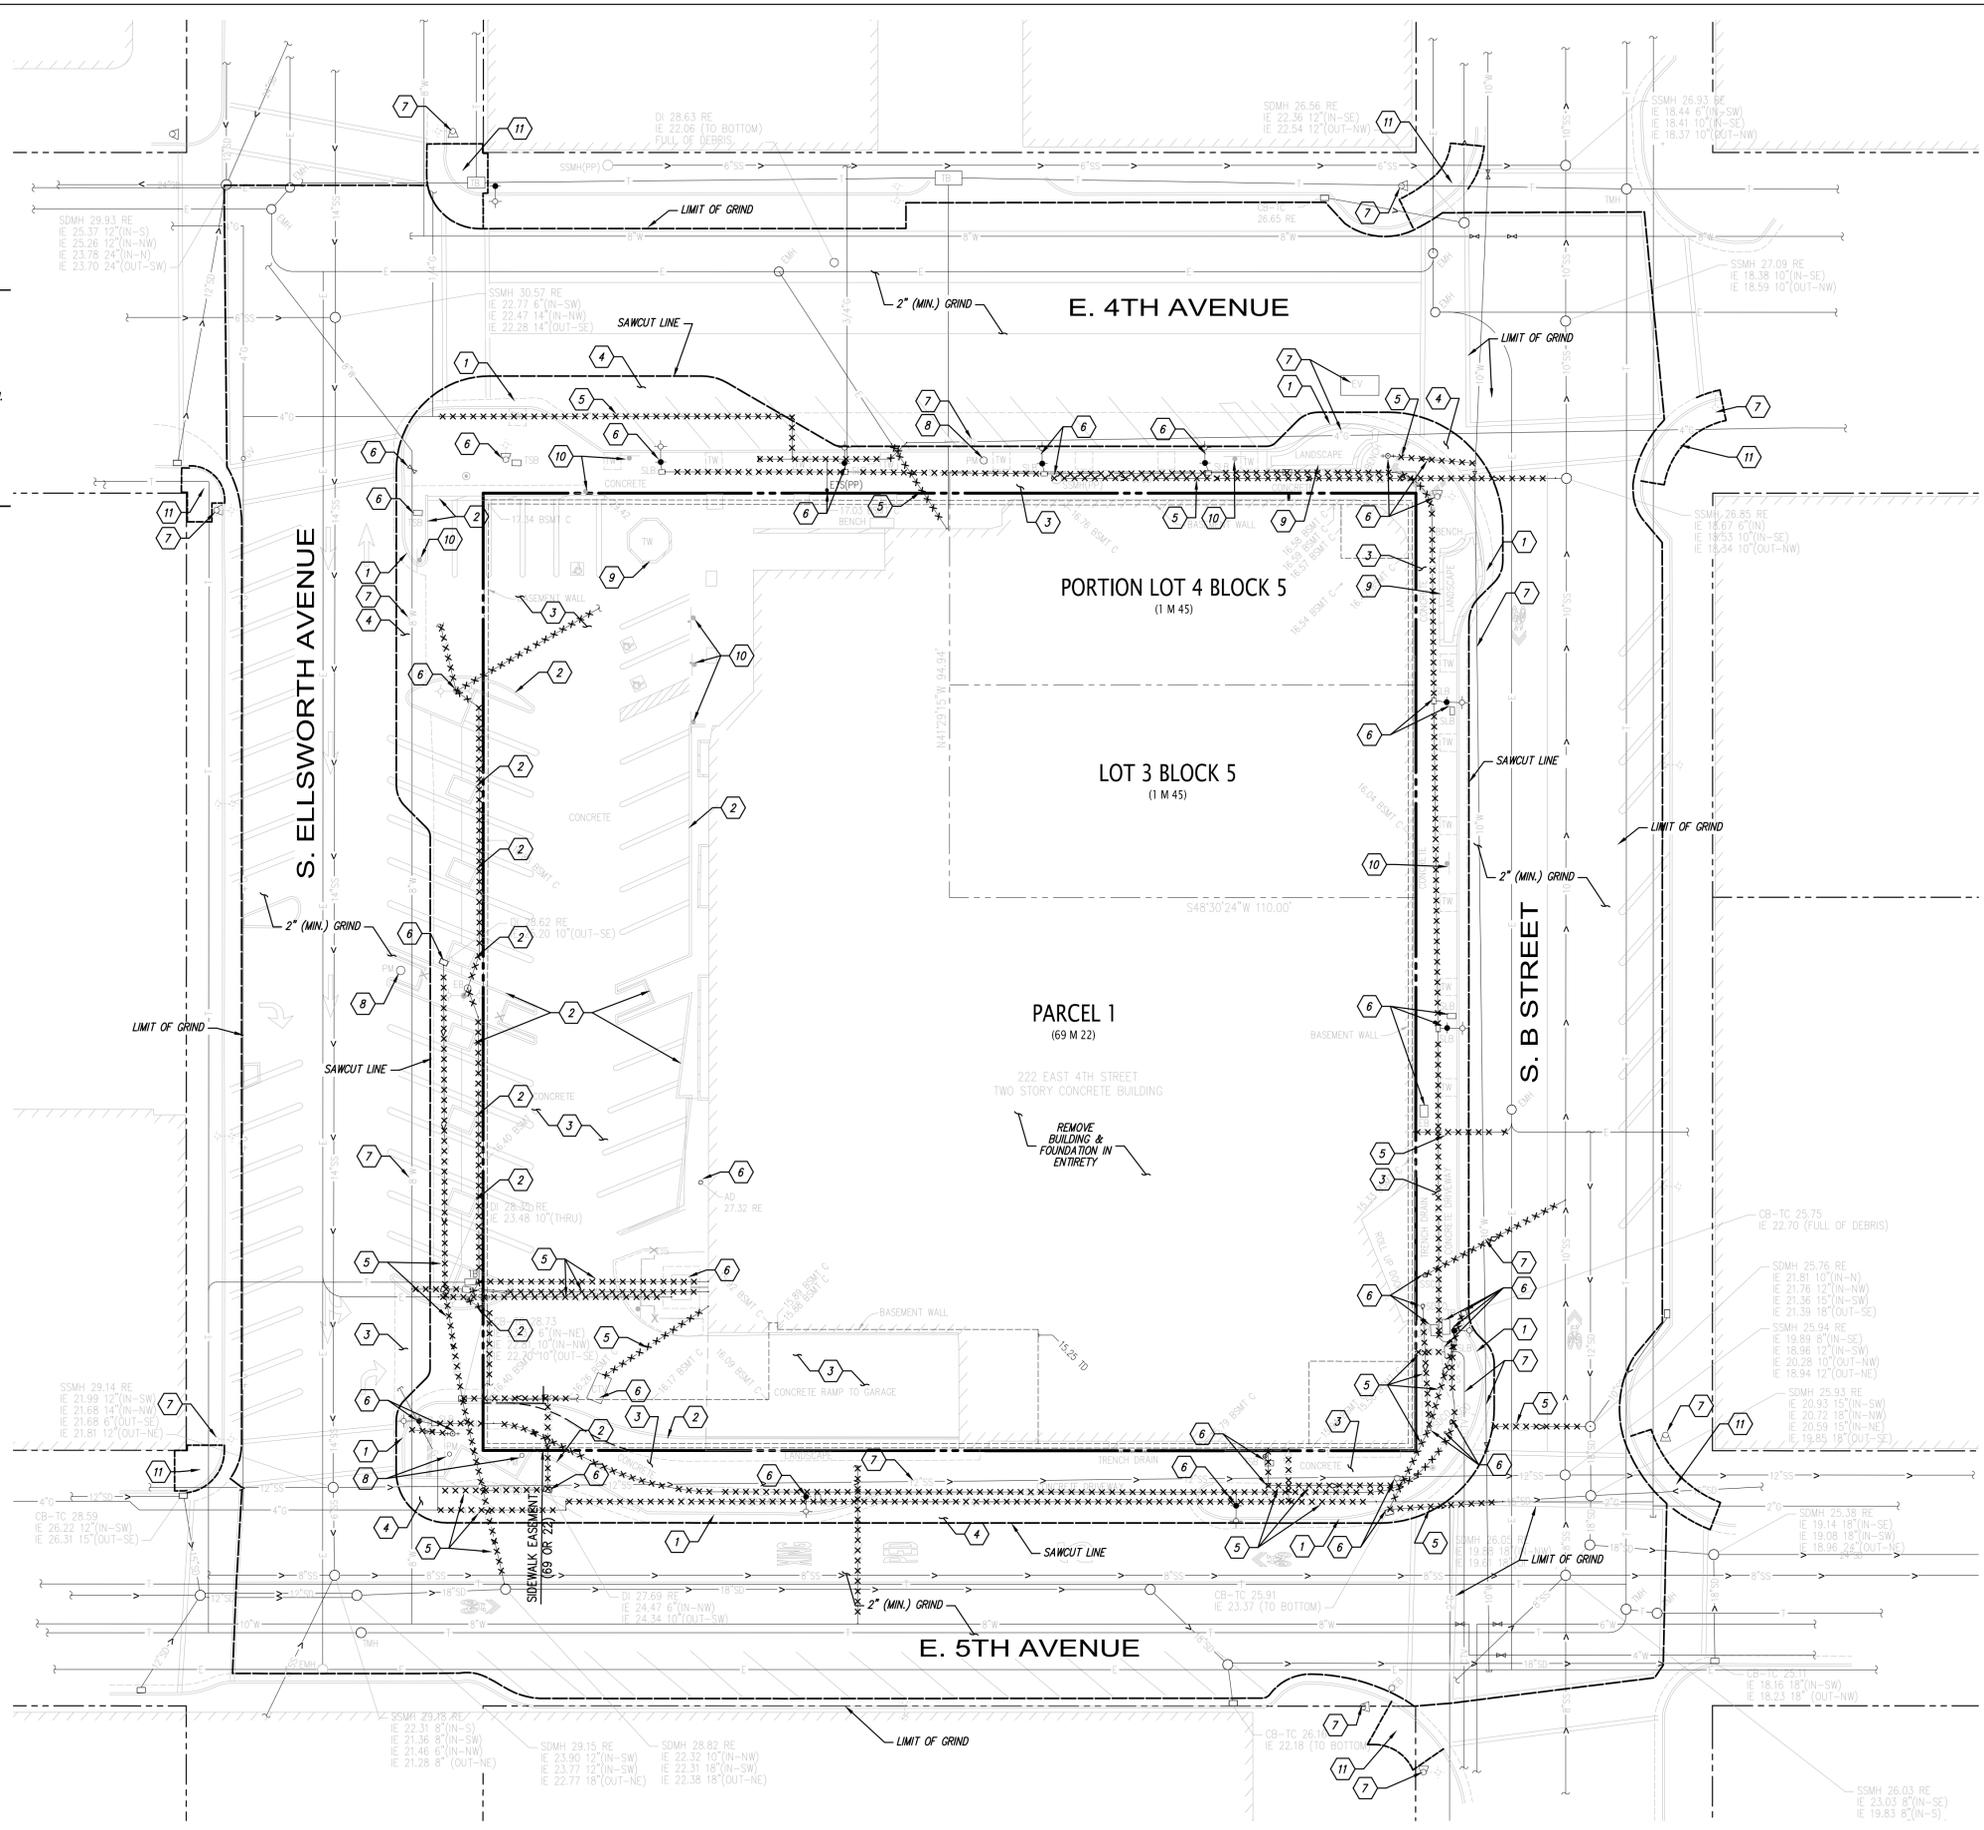

Z:\2019\A19538-1\DWG\entitlements\pd_permit\A19538-1_PG-TS.dwg 6-17-22 08:07:19 AM tknudsen

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal


PROJECT NUMBER
A19538-1

SHEET TITLE
**PRELIMINARY
STREET
LAYOUT PLAN**

SCALE
AS SHOWN

SHEET NUMBER

C2.00



KEYNOTES

- 1 ADA RAMP SHALL BE UPGRADED TO MEET CALTRANS STANDARD PLAN AB8A.
- 2 EXISTING STRIPING SYMBOL TO BE REMOVED.
- 3 PROJECT SHALL REMOVE EXISTING PAY STATION FOR CONSTRUCTION AND REINSTALL POST-CONSTRUCTION UTILIZING CITY'S VENDOR.

STRIPING NOTES

1. SIGNING AND STRIPING SHALL CONFORM TO THE LATEST EDITION OF THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (CA MUTCD), THE LATEST EDITION OF THE STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION (CALTRANS) STANDARD SPECIFICATIONS, STANDARD PLANS, SIGN SPECIFICATIONS, SPECIAL PROVISIONS, AND THE LATEST EDITION OF THE CITY SAN MATEO SPECIFICATIONS.
2. ANY EXISTING SIGNING AND STRIPING THAT CONFLICTS WITH THE NEW SIGNING AND STRIPING SHALL BE REMOVED.
3. ALL PERMANENT STRIPING/PAVEMENT MARKINGS AS SHOWN ON THIS PLAN SHALL BE THERMOPLASTIC.

EXISTING PARKING SUMMARY

DESCRIPTION	STALLS
E. 4TH AVENUE	21
S. B STREET	13
E. 5TH AVENUE	16
S. ELLSWORTH AVENUE	30
TOTAL	80



NOTE: PARKING COUNT INCLUDES STALLS ON BOTH SIDES OF THE STREET

PROPOSED PARKING SUMMARY

DESCRIPTION	STALLS
E. 4TH AVENUE	15
S. B STREET	8
E. 5TH AVENUE	8
S. ELLSWORTH AVENUE	22
TOTAL	53

STALLS LOST DUE TO DEVELOPMENT	21
STALLS LOST DUE TO BIKE LANES	6
TOTAL STALLS REMOVED	27

- NOTES:
1. PARKING COUNT INCLUDES STALLS ON BOTH SIDES OF THE STREET.
 2. LOST PARKING STALL DUE TO BIKE LANE REQUIREMENTS ARE LOCATED ON THE SOUTHERLY PORTION OF E. 5TH AVENUE.

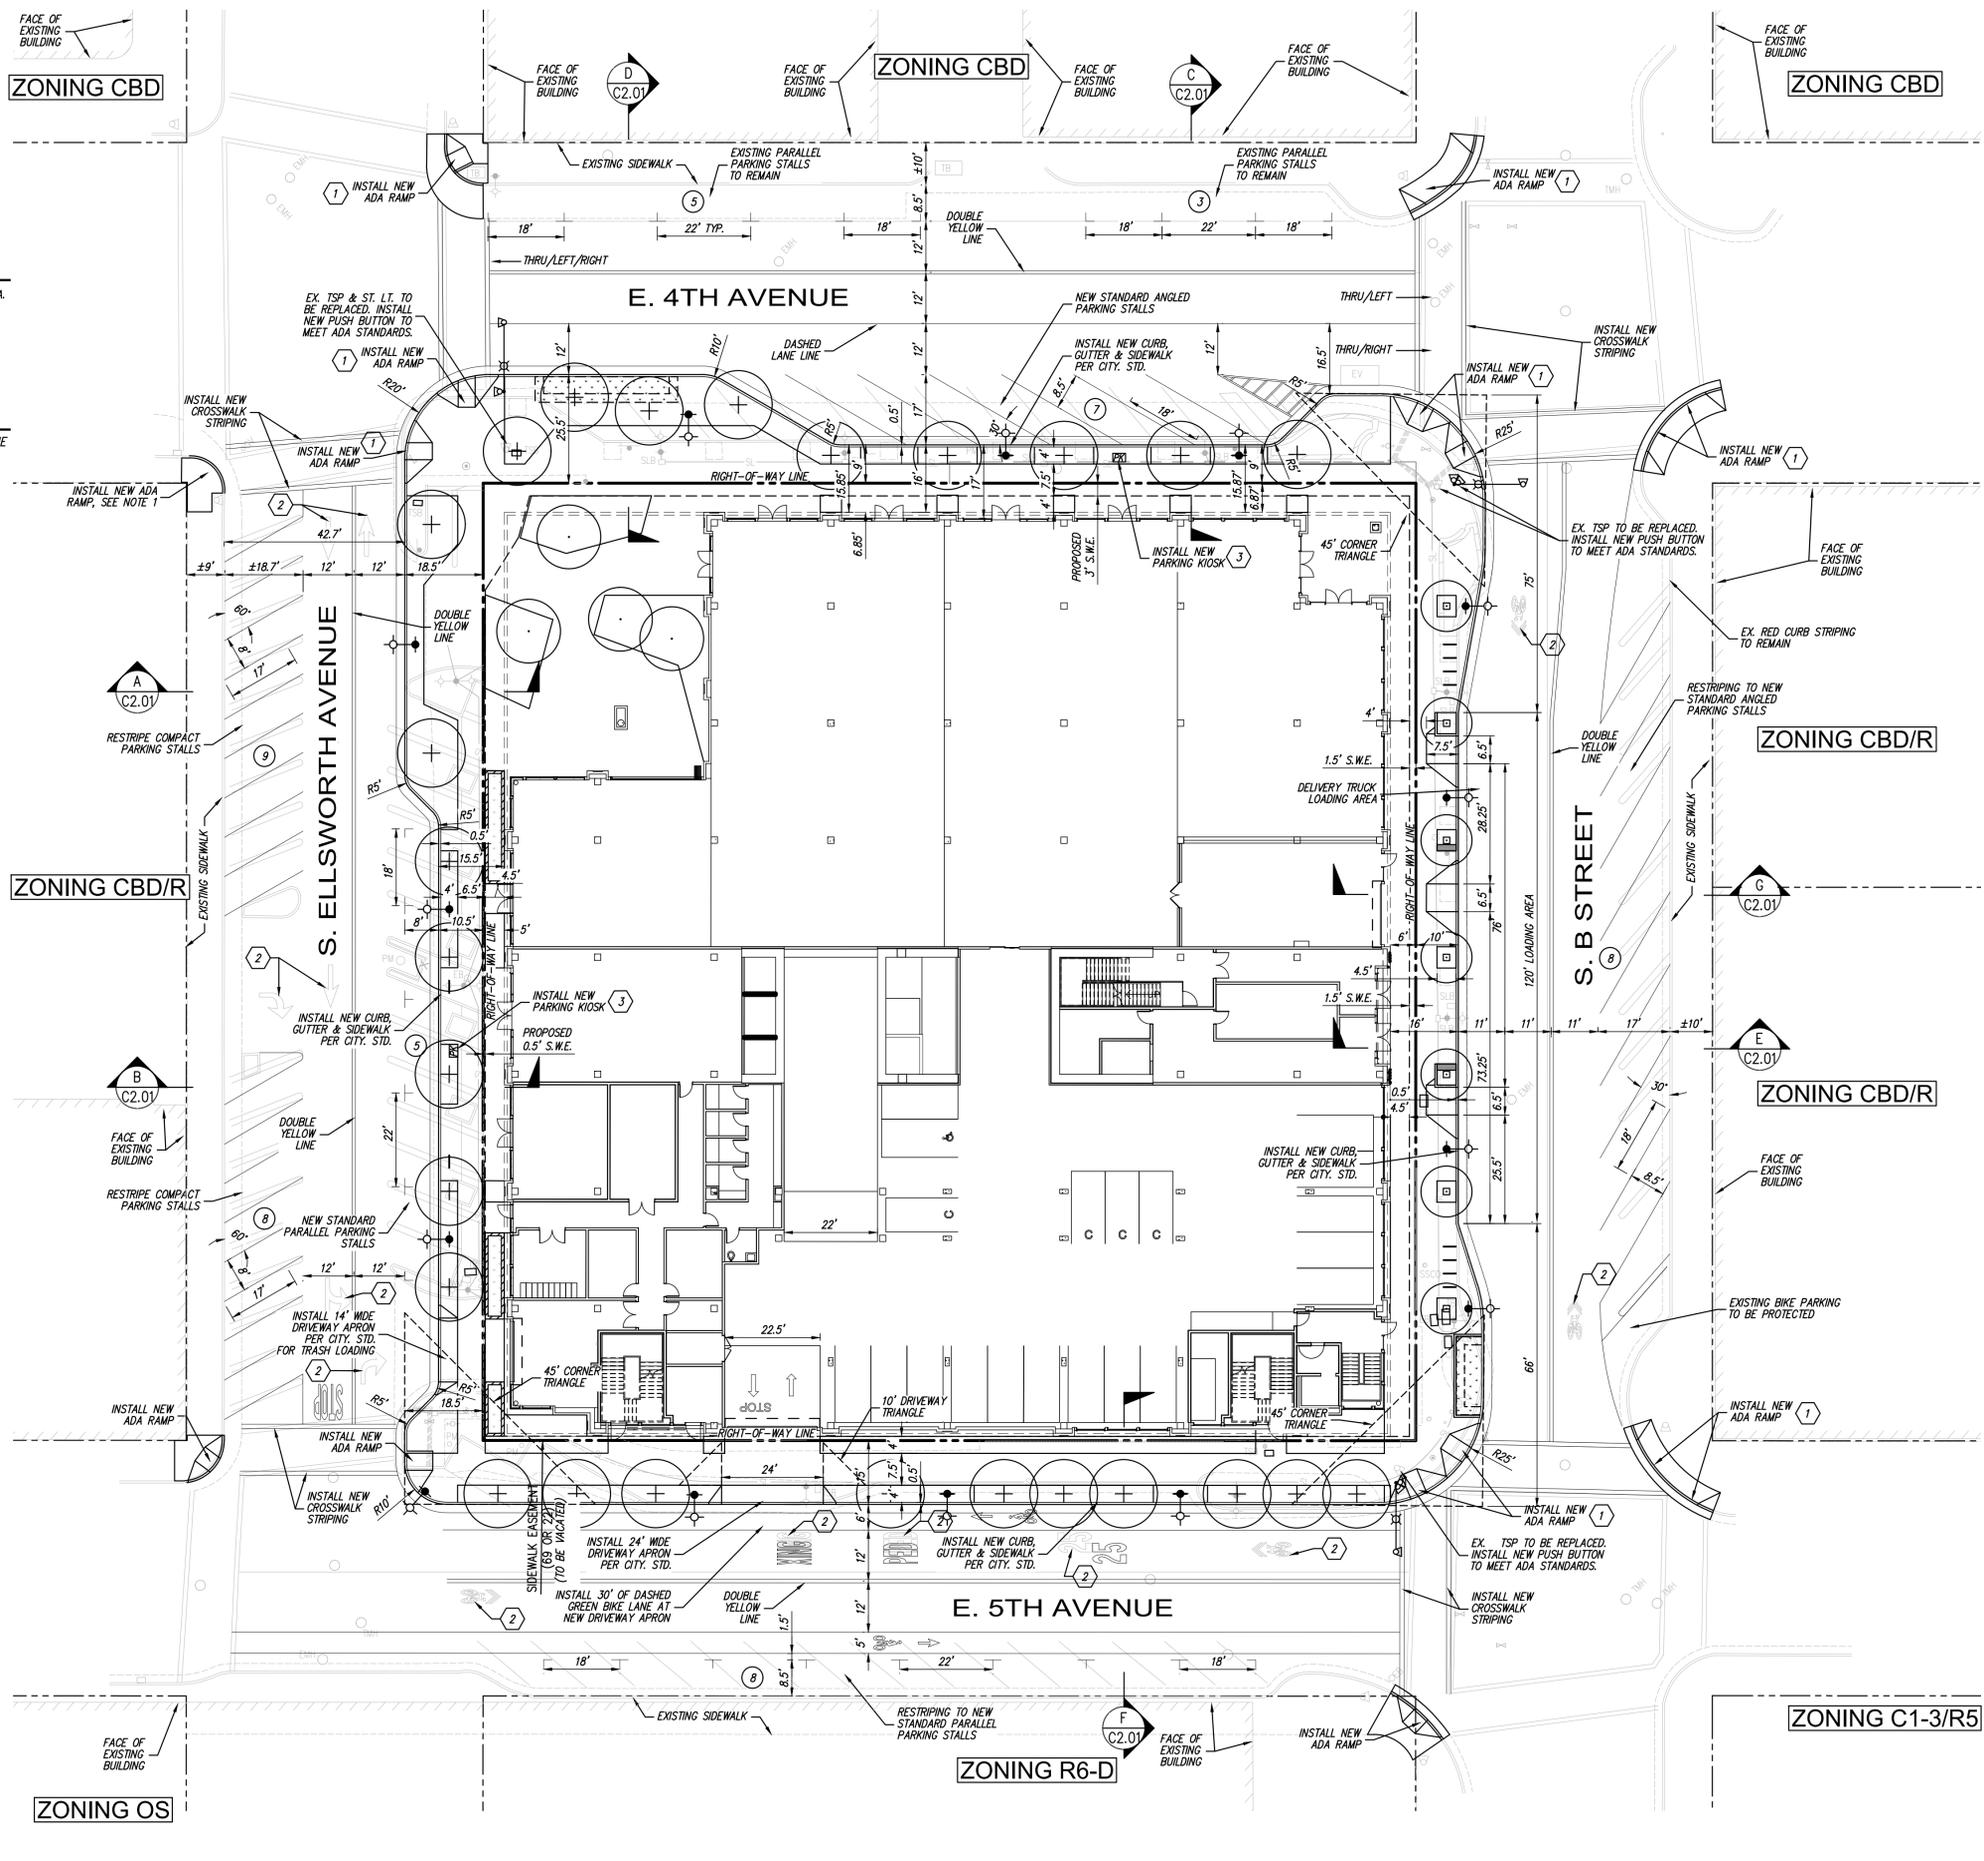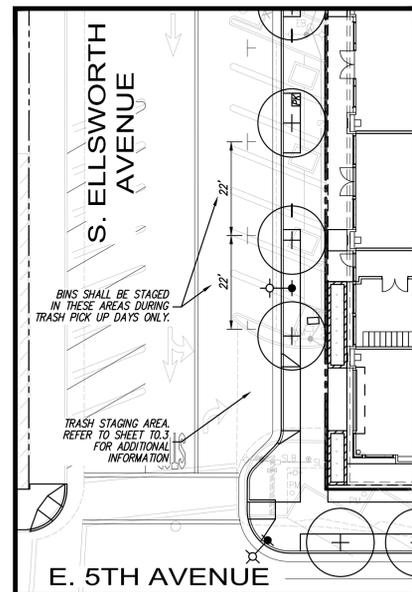

Z:\2019\A19538-1\DWG\ENVIRONMENTAL\VD PERMIT\A19538-1-PC-SP.dwg 6-17-22 08:47:08 AM mkenudsen

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal








PROJECT NUMBER
A19538-1

SHEET TITLE
TYPICAL SECTIONS

SCALE
AS SHOWN

SHEET NUMBER

C2.01

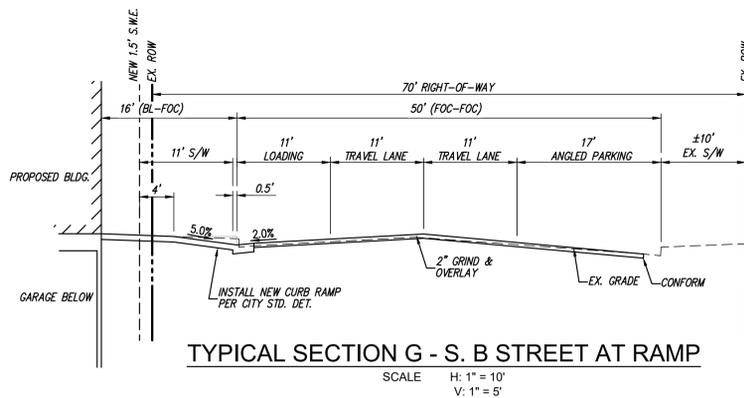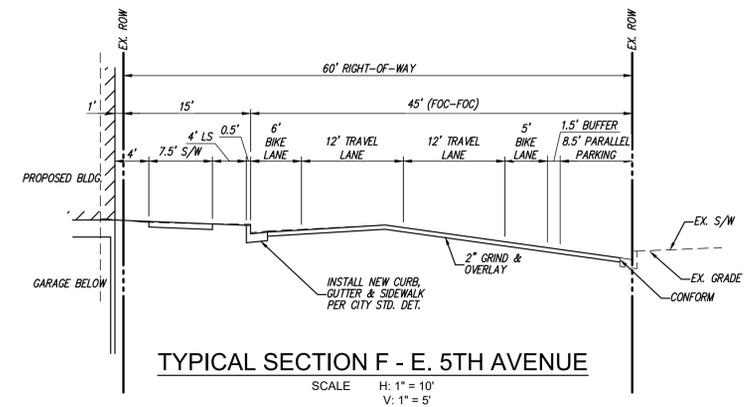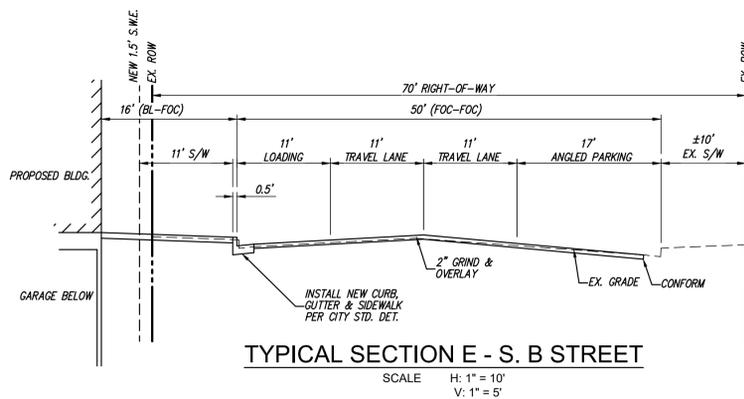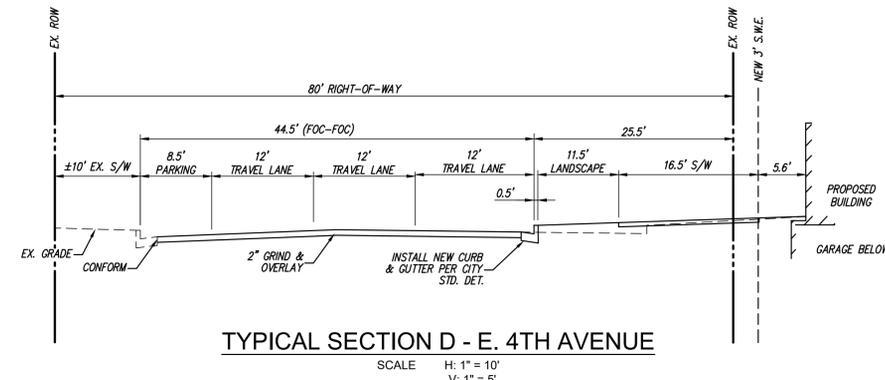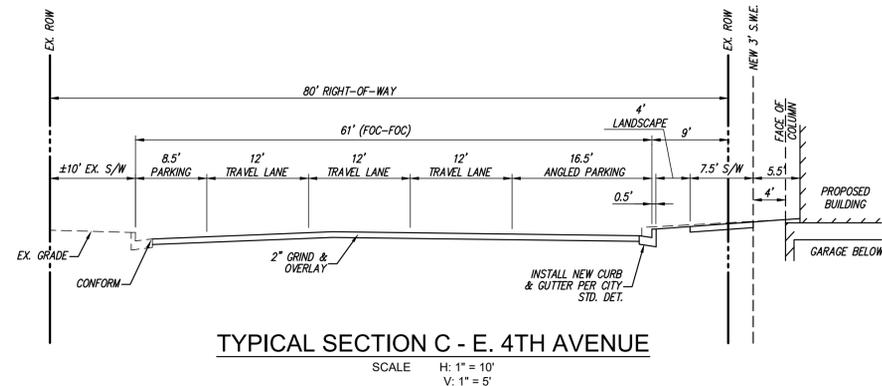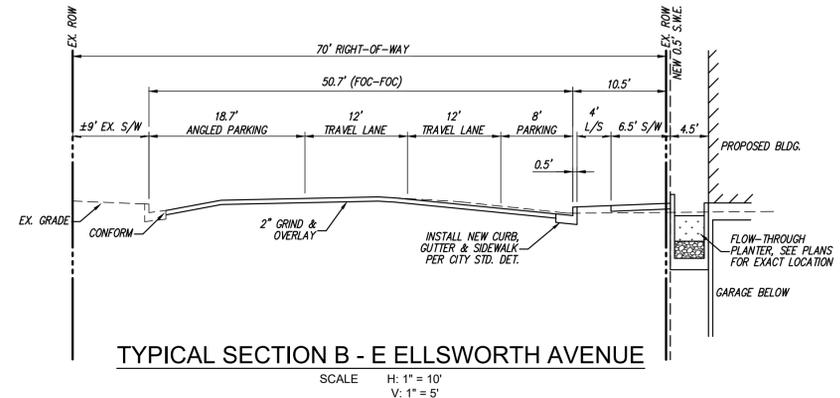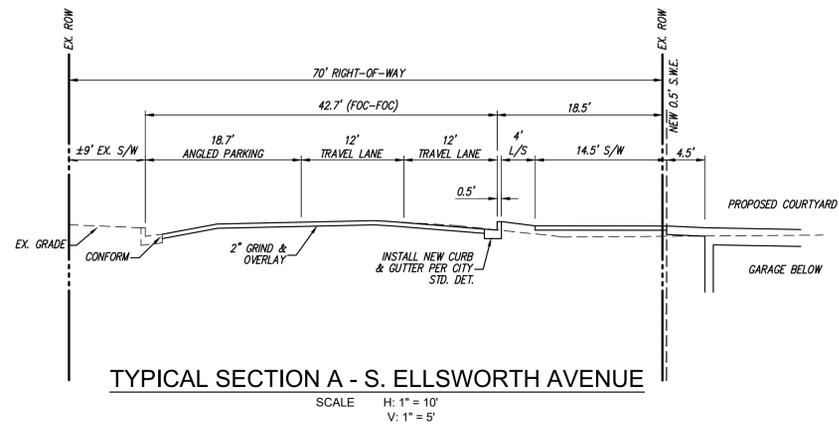

Z:\2019\A19538-1\DWG\ENTITLEMENTS\VD PERMIT\A19538-1-FC-5F.dwg 6-17-22 08:49:39 AM mkrudstein

ISSUES AND REVISIONS


No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

PROJECT NUMBER
A19538-1

SHEET TITLE
**PRELIMINARY
GRADING,
DRAINAGE
PLAN**
SCALE
AS SHOWN


SHEET NUMBER

C3.00

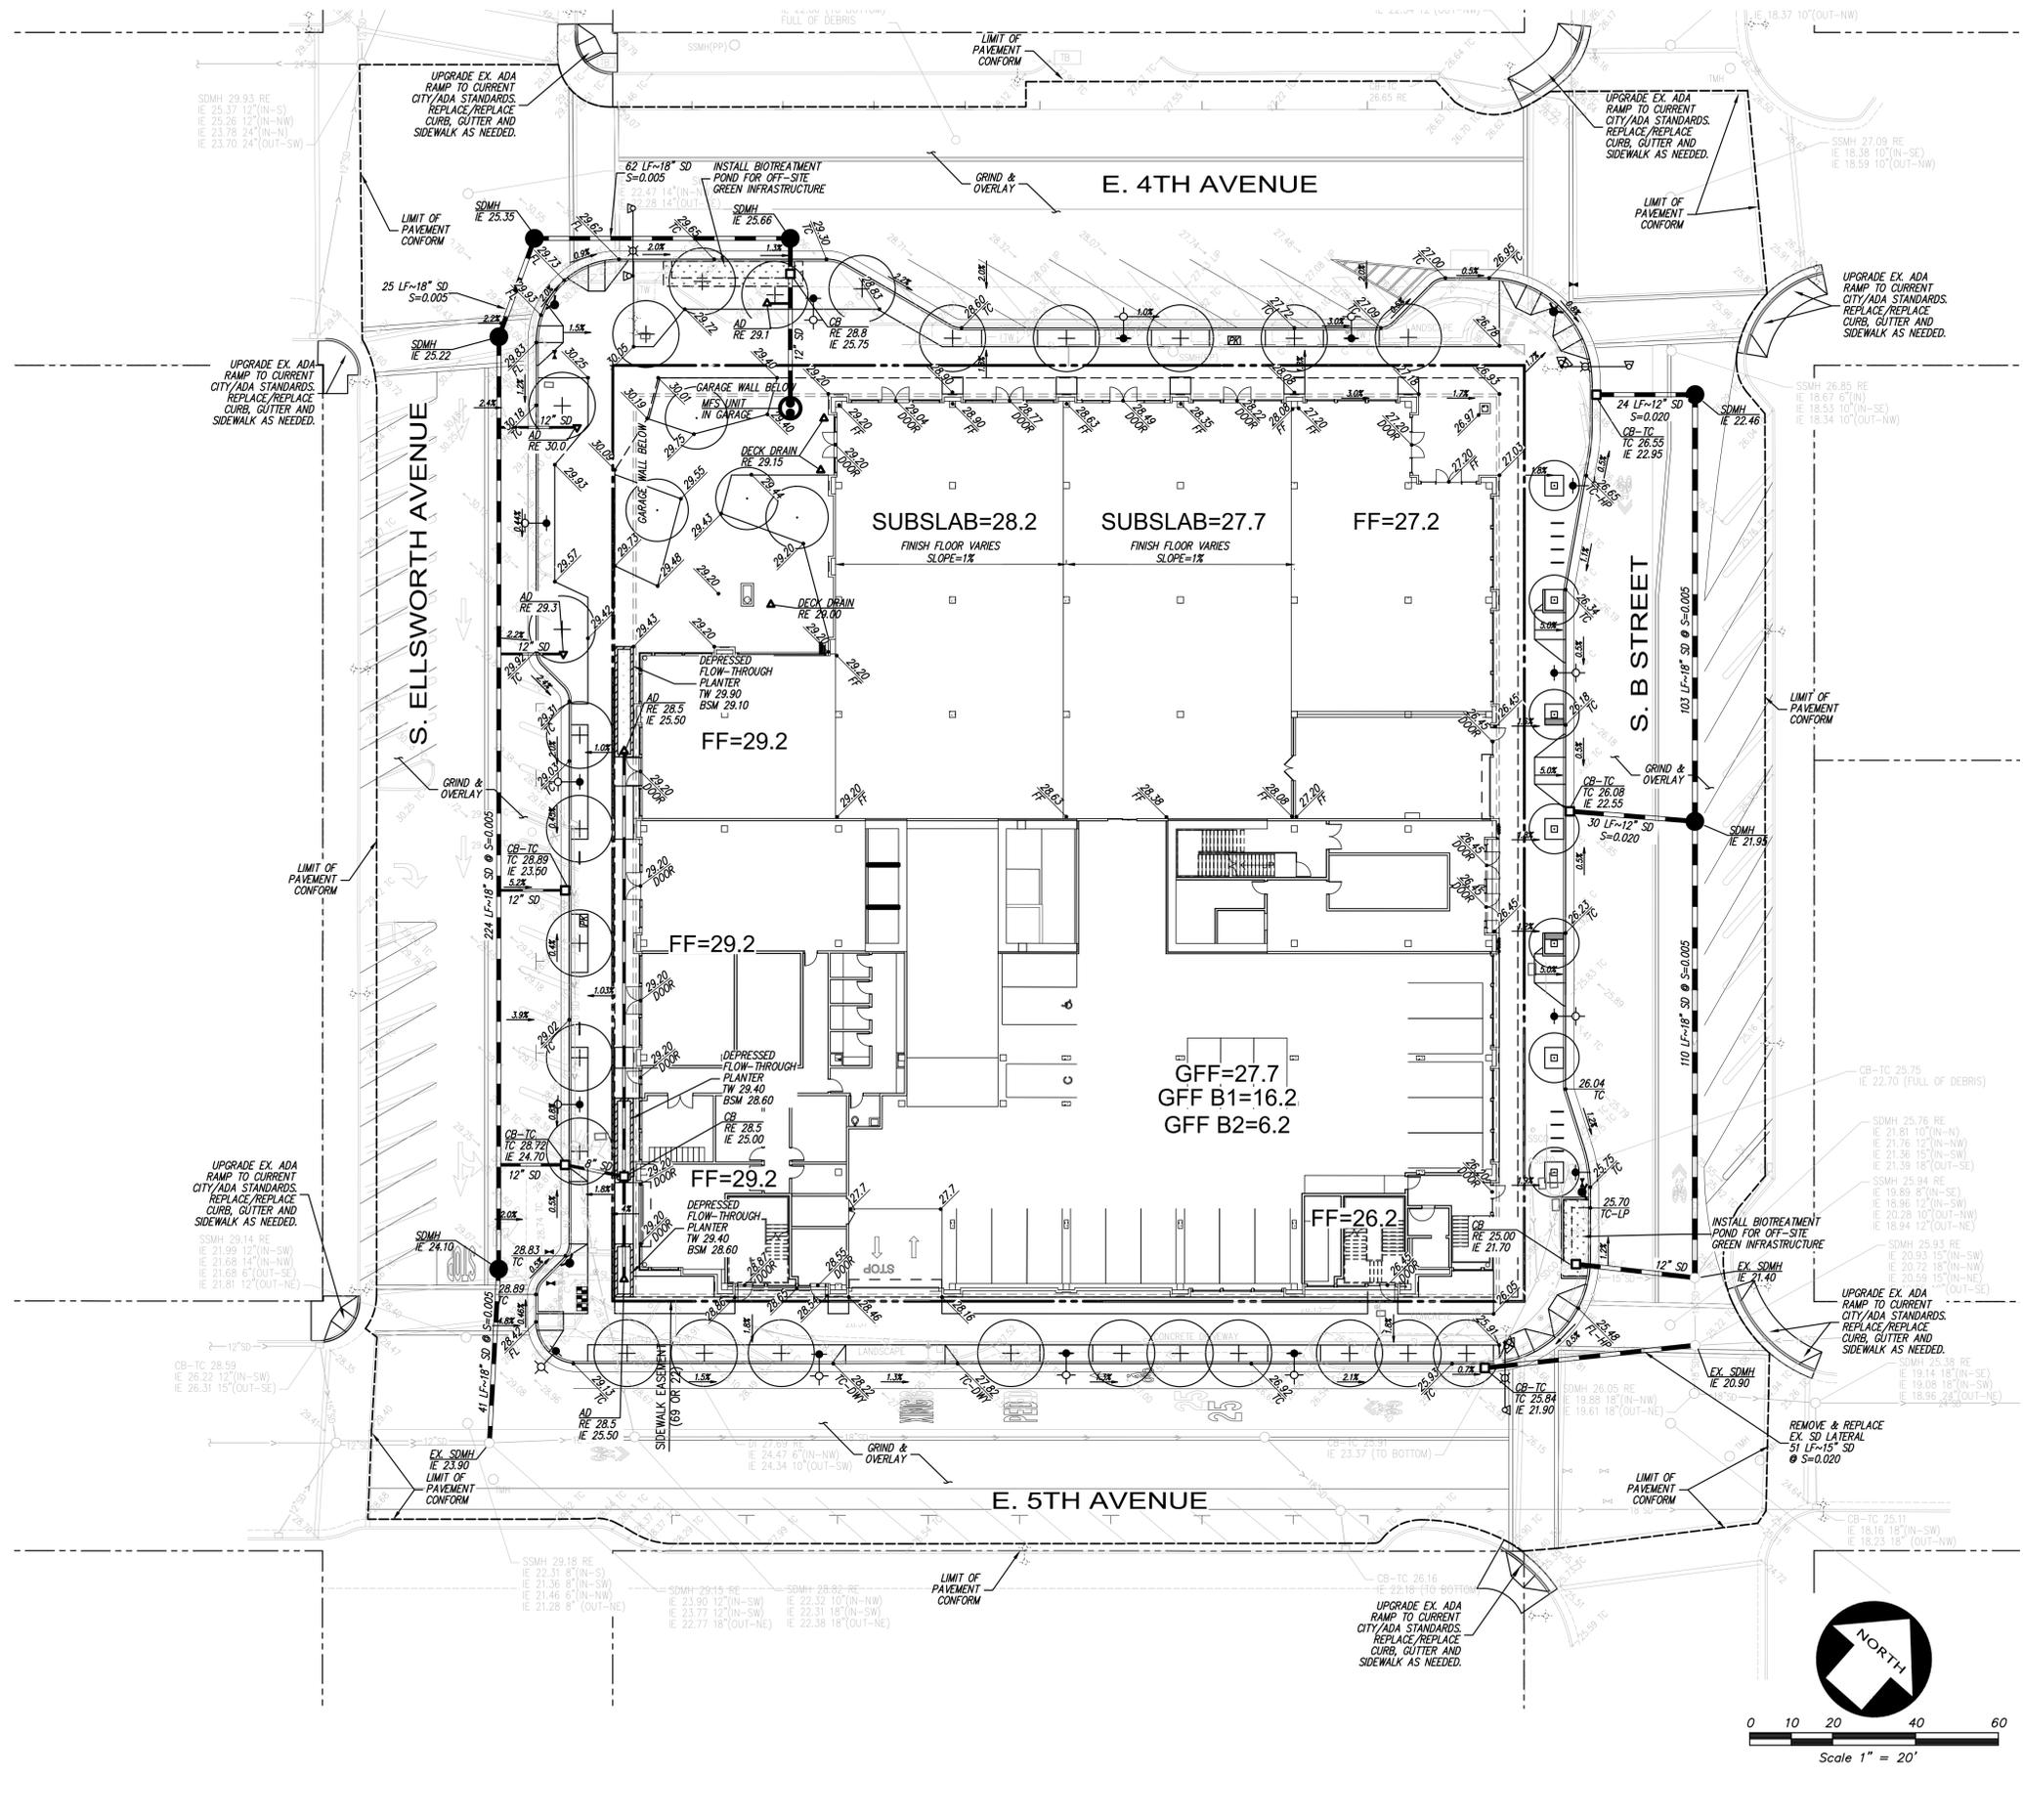

LEGEND

AD	AREA DRAIN
BSM	BIO SOIL MIX
FL	FLOW LINE
GFF	GARAGE FINISHED FLOOR
HP	HIGH POINT
IE	INVERT
RE	RIM ELEVATION
TC	TOP OF CURB
TW	TOP OF WALL
—○—	STORM DRAIN LINE
—○—	AREA DRAIN
—○—	STORM DRAIN CATCH BASIN
—○—	STORM DRAIN JUNCTION BOX
—○—	STORM DRAIN MANHOLE
—○—	BACK FLOW PREVENTION DEVICE
—○—	FIRE DEPARTMENT CONNECTION
—○—	FIRE HYDRANT & VALVE
—○—	POST INDICATOR VALVE
—○—	SANITARY SEWER MANHOLE
—○—	SINGLE CHECK VALVE
—○—	STORM DRAIN MANHOLE
—○—	WATER METER



Z:\2019\A19538-1\DWG\ENTITLEMENTS\VD_PERMIT\A19538-1-FC-GP.dwg 6--17--22 09:42:35 AM mkenutson

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

PROJECT NUMBER
A19538-1

SHEET TITLE
**PRELIMINARY
UTILITY PLAN**

SCALE
AS SHOWN

SHEET NUMBER

C4.00

EXISTING PROJECT SEWER FLOWS

COMMERCIAL: $0.00685\text{CFS}/\text{ACRE} \times 1.377\text{AC} = 0.0094\text{ CFS}$
 $0.0094\text{ CFS} = 6,075\text{ GAL/DAY}$
 TOTAL: $6,075\text{ GAL/DAY (DRY CONDITIONS)}$
 PEAK TOTAL: $6,075 \times 2.5 = 15,188\text{ GAL/DAY}$

* PER CITY OF SAN MATEO SSMP ELEMENT 5 - DESIGN & PERFORMANCE STANDARDS.

PROPOSED PROJECT SEWER FLOWS

COMMERCIAL: $0.00685\text{CFS}/\text{ACRE} \times 3.389\text{AC} = 0.0232\text{ CFS}$
 $0.0232\text{ CFS} = 14,995\text{ GAL/DAY}$
 TOTAL: $14,995\text{ GAL/DAY (DRY CONDITIONS)}$
 PEAK TOTAL: $14,995 \times 2.5 = 37,488\text{ GAL/DAY}$

* PER CITY OF SAN MATEO SSMP ELEMENT 5 - DESIGN & PERFORMANCE STANDARDS.

NET PROJECT SEWER FLOWS

NET TOTAL: $14,995 - 6,075 = 8,920\text{ GAL/DAY}$
 $8,920\text{ GAL/DAY (DRY CONDITIONS)}$
 NET PEAK TOTAL: $37,488 - 15,188 = 22,300\text{ GAL/DAY}$
 $22,300\text{ GAL/DAY (PEAK CONDITIONS)}$

PROPOSED PROJECT WATER FLOWS

OFFICE: $(14,995\text{ GAL/DAY}) / 0.95 = 15,784\text{ GAL/DAY}$
 TOTAL: $15,784\text{ GAL/DAY (DRY CONDITIONS)}$
 PEAK TOTAL: $15,784 \times 2.5 = 39,460\text{ GAL/DAY}$



* VALUES ARE BASED ON THE ASSUMPTION THAT 90% OF POTABLE WATER USAGE ENTERS THE PUBLIC SANITARY SEWER

NOTE:

1. GAS METERS SHALL BE LOCATED WITHIN THE BUILDING.
2. ALL HYDRANTS ALONG THE PROJECT FRONTAGE SHALL BE CLOW MODEL 960. EXISTING HYDRANTS TO BE PROTECTED SHALL BE UPGRADED.
3. TRASH CAPTURE DEVICE SHALL BE INSTALLED ON DOWNSTREAM PRIVATE CATCH BASIN PRIOR TO DISCHARGING TO PUBLIC SYSTEM.

LEGEND

AD	AREA DRAIN
BSM	BIO SOIL MIX
FL	FLOW LINE
GFF	GARAGE FINISHED FLOOR
HP	HIGH POINT
IE	INVERT
RE	RIM ELEVATION
TC	TOP OF CURB
TW	TOP OF WALL
STORM DRAIN LINE	
▲	AREA DRAIN
○	STORM DRAIN CATCH BASIN
□	STORM DRAIN JUNCTION BOX
○	STORM DRAIN MANHOLE
○	BACK FLOW PREVENTION DEVICE
○	FIRE DEPARTMENT CONNECTION
○	FIRE HYDRANT & VALVE
○	POST INDICATOR VALVE
○	SANITARY SEWER MANHOLE
○	SINGLE CHECK VALVE
○	STORM DRAIN MANHOLE
○	WATER METER

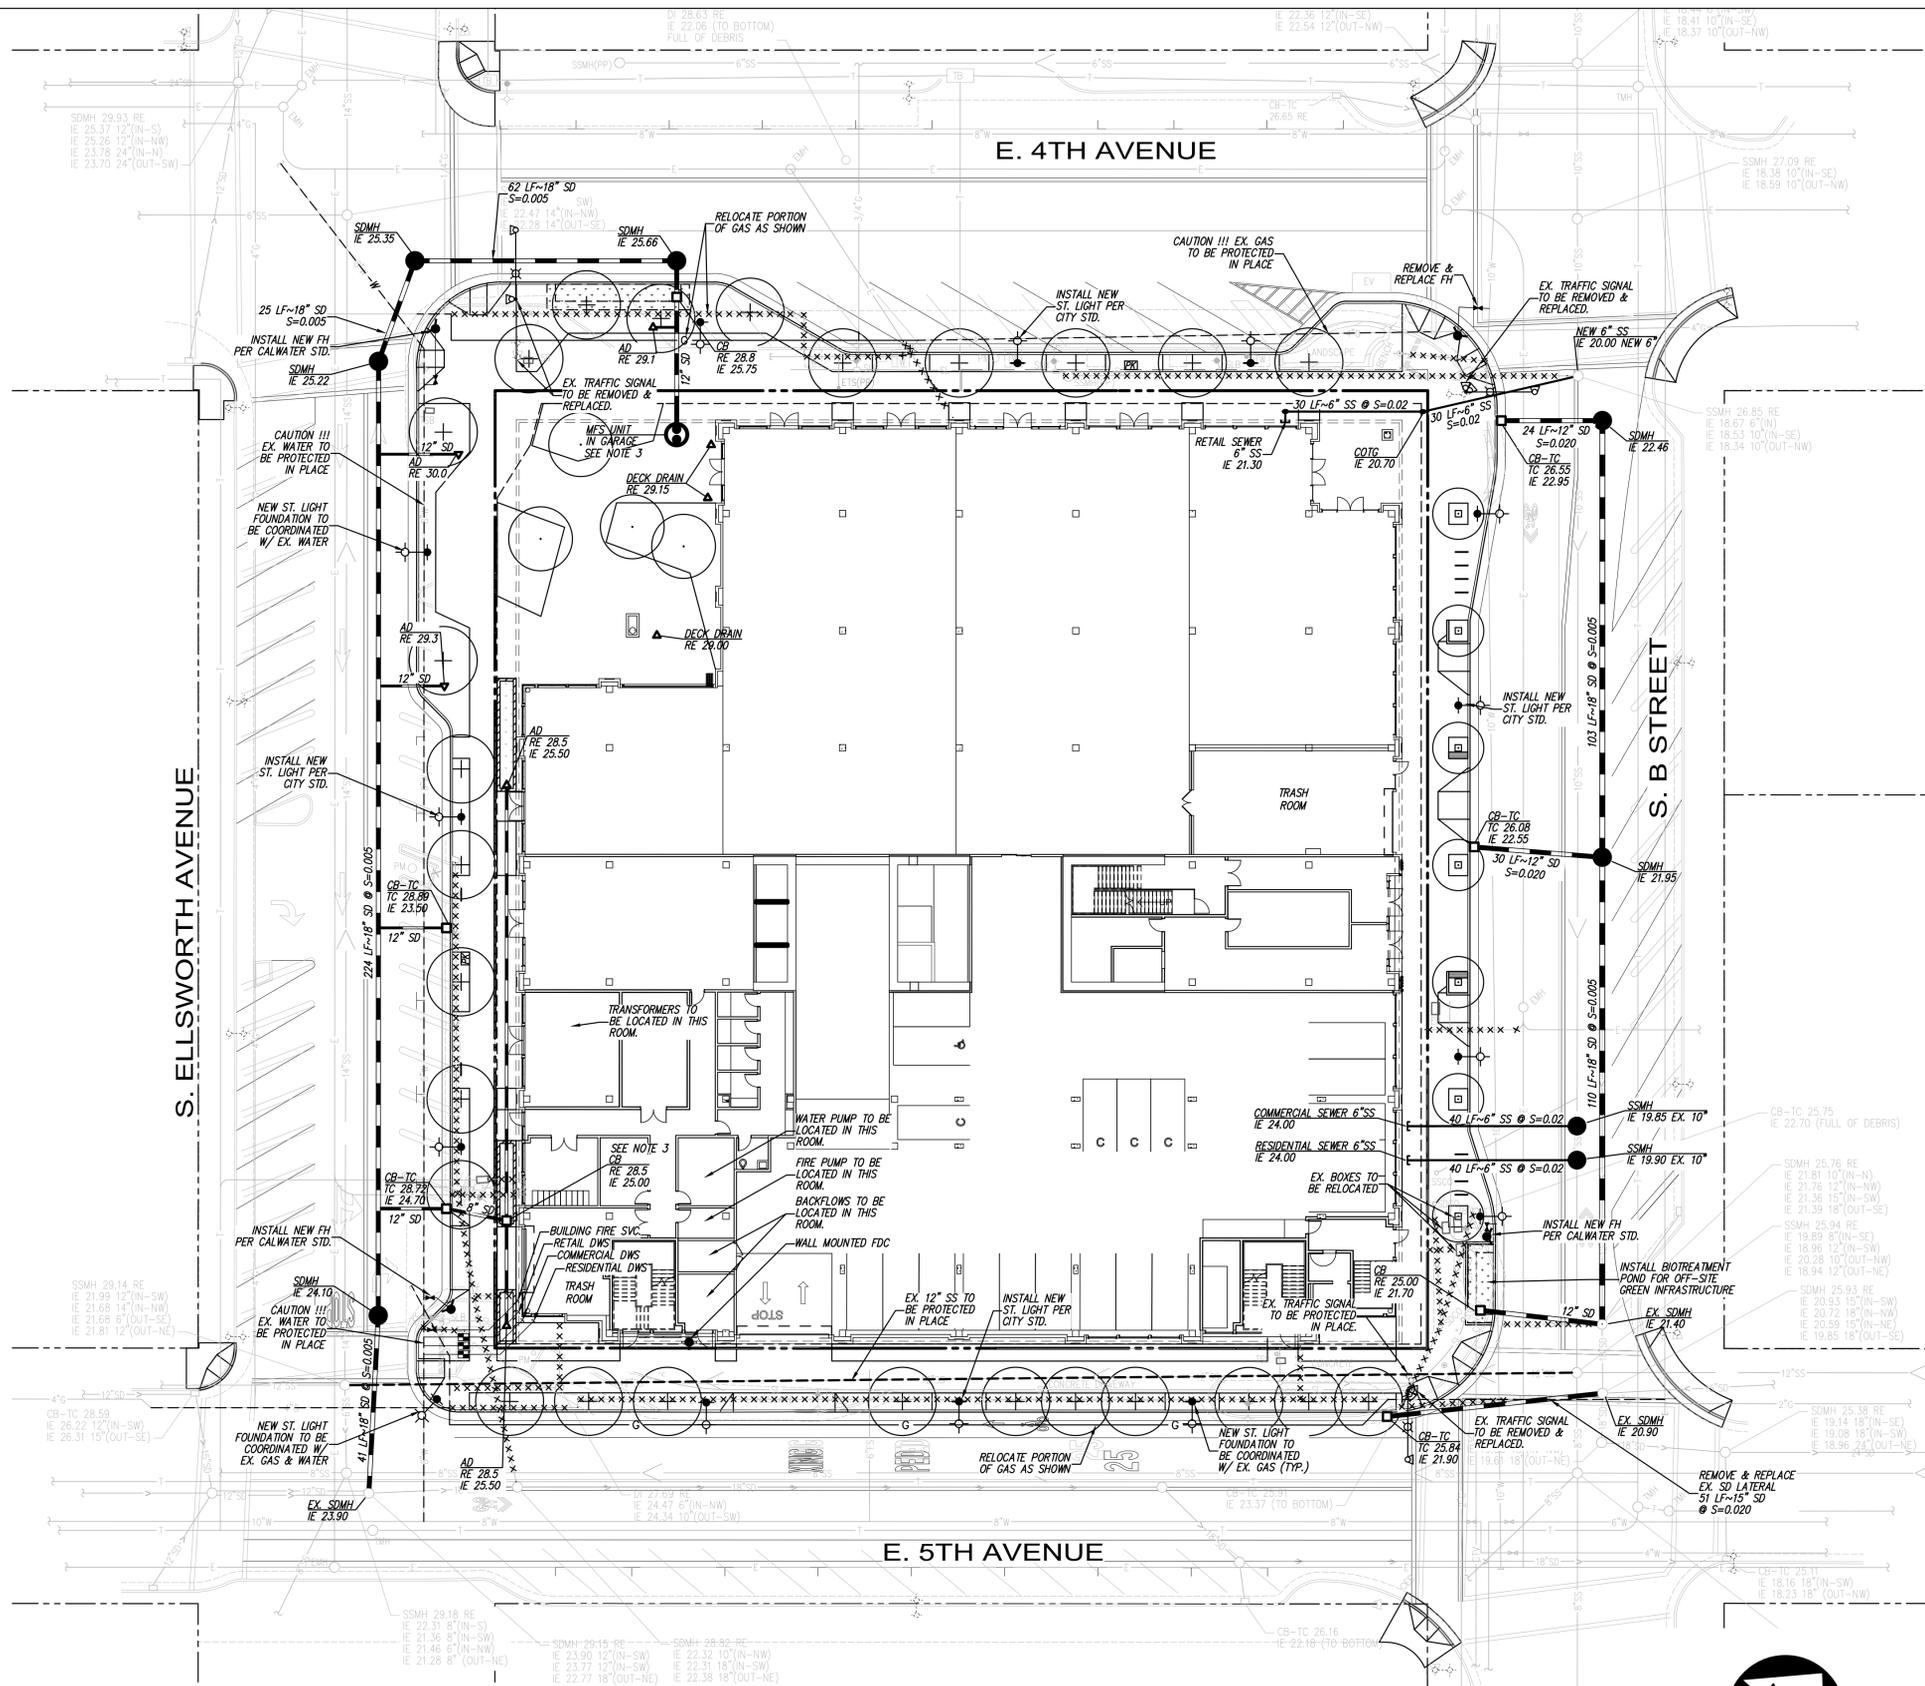

Z:\2019\A19538-1\DWG\ELEMENTS\VD_PERMIT\A19538-1-FC-GP.dwg 6-17-22 09:43:09 AM mkenudsen

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

PROJECT NUMBER
A19538-1

SHEET TITLE
**PRELIMINARY
STORM WATER
QUALITY
CONTROL PLAN**
SCALE
AS SHOWN

SHEET NUMBER

C5.00

**FLOW-THROUGH PLANTER INSPECTION
AND MAINTENANCE CHECKLIST**

Defect	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
1. Vegetation	Vegetation is dead, diseased and/or overgrown.	Vegetation is healthy and attractive in appearance.
2. Soil	Soil too deep or too shallow.	Soil is at proper depth (per soil specifications) for optimum filtration and flow.
3. Mulch	Mulch is missing or patchy in appearance. Areas of bare earth are exposed, or mulch layer is less than 3 inches in depth.	All bare earth is covered, except mulch is kept 6 inches away from trunks of trees and shrubs. Mulch is even in appearance, at a depth of 3 inches.
4. Sediment, Trash and Debris Accumulation	Sediment, trash and debris accumulated in the flow-through planter. Planter does not drain as specified.	Sediment, trash and debris removed from flow-through planter and disposed of properly. Planter drains within 3-4 hours.
5. Clogs	Soil too deep or too shallow. Sediment, trash and debris accumulated in the flow-through planter. Planter does not drain within five days after rainfall.	Planter drains per design specifications.
6. Downspouts and Sheet Flow	Flow to planter is impeded. Downspouts are clogged or pipes are damaged. Splash blocks and rocks in need of repair, replacement or replenishment.	Downspouts and sheet flow is conveyed efficiently to the planter.
7. Overflow Pipe	Does not safely convey excess flows to storm drain. Piping damaged or disconnected.	Overflow pipe conveys excess flow to storm drain efficiently.
8. Structural Soundness	Planter is cracked, leaking or falling apart.	Cracks and leaks are repaired and planter is structurally sound.
9. Miscellaneous	Any condition not covered above that needs attention in order for the flow-through planter to function as designed.	Meet the design specifications.

**NON-PROPRIETARY MEDIA FILTER INSPECTION
AND MAINTENANCE CHECKLIST**

Defect	Conditions When Maintenance is Needed	Results Expected When Maintenance is Performed
1. Sediment, trash and debris accumulation	Sediment, trash and debris accumulated in the sedimentation basin, riser pipe and filter bed. Filter does not drain as specified.	Sediment, trash and debris removed from sedimentation basin, riser pipe and filter bed and disposed of properly. Filter drains per design specifications.
2. Standing water	Non-proprietary media filter does not drain within five days after rainfall.	Clogs removed from sedimentation basin, riser pipe and filter bed. Filter drains per design specifications.
3. Mosquitoes	Evidence of mosquito larvae in non-proprietary media filter.	Clogs removed from sedimentation basin, riser pipe and filter bed. Filter drains per design specifications.
4. Filter bed	Overall media depth 300 millimeters (12 inches) or less.	Media depth restored to 450 millimeters (18 inches).
5. Miscellaneous	Any condition not covered above that needs attention in order for the non-proprietary media filter to function as designed.	Meet the design specifications.

MEDIA FILTER SIZING

DMA #	1	A=	14204 s.f.	A=	0.32608 acre
C Value	0.9	Area* (s.f.)	13,138	Weighted C Value	0.892
	0.8		1,066		
	0.7		0		
	0.1		0		




Rainfall Intensity (i)
i = 0.2

* Input Values by hand or use Table at the bottom of the spreadsheet.


Q = C x i x A
Q = 0.0582048 cfs

Manufacturer: **Kristari/Oldcastle**
Cartridge Height: **18 in.**
Cartridge Media (if applicable): **Perk Filter**
G.U.L.D. Cartridge Treatment Flowrate (CTF): **10.2 gpm/cartridge**

Cartridges = [Q x (449 gpm/cfs)] / CTF
Cartridges = **2,562,151** (round up)
Cartridges Required = **3**
Treatment Flow Rate Capacity = **0.068151 cfs**

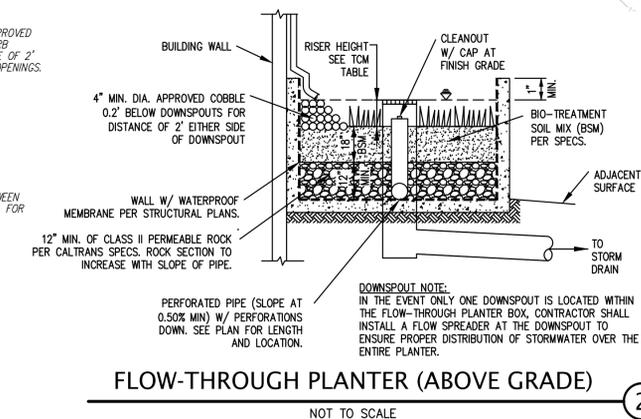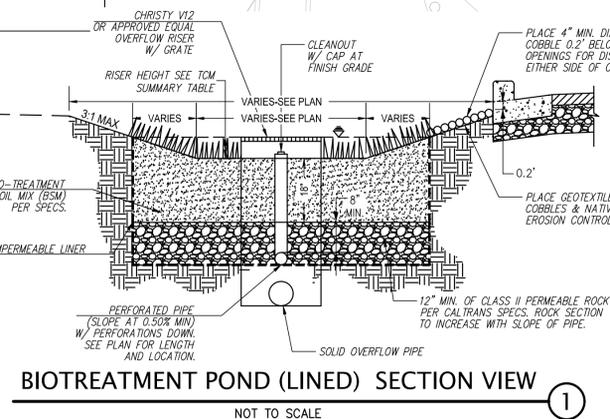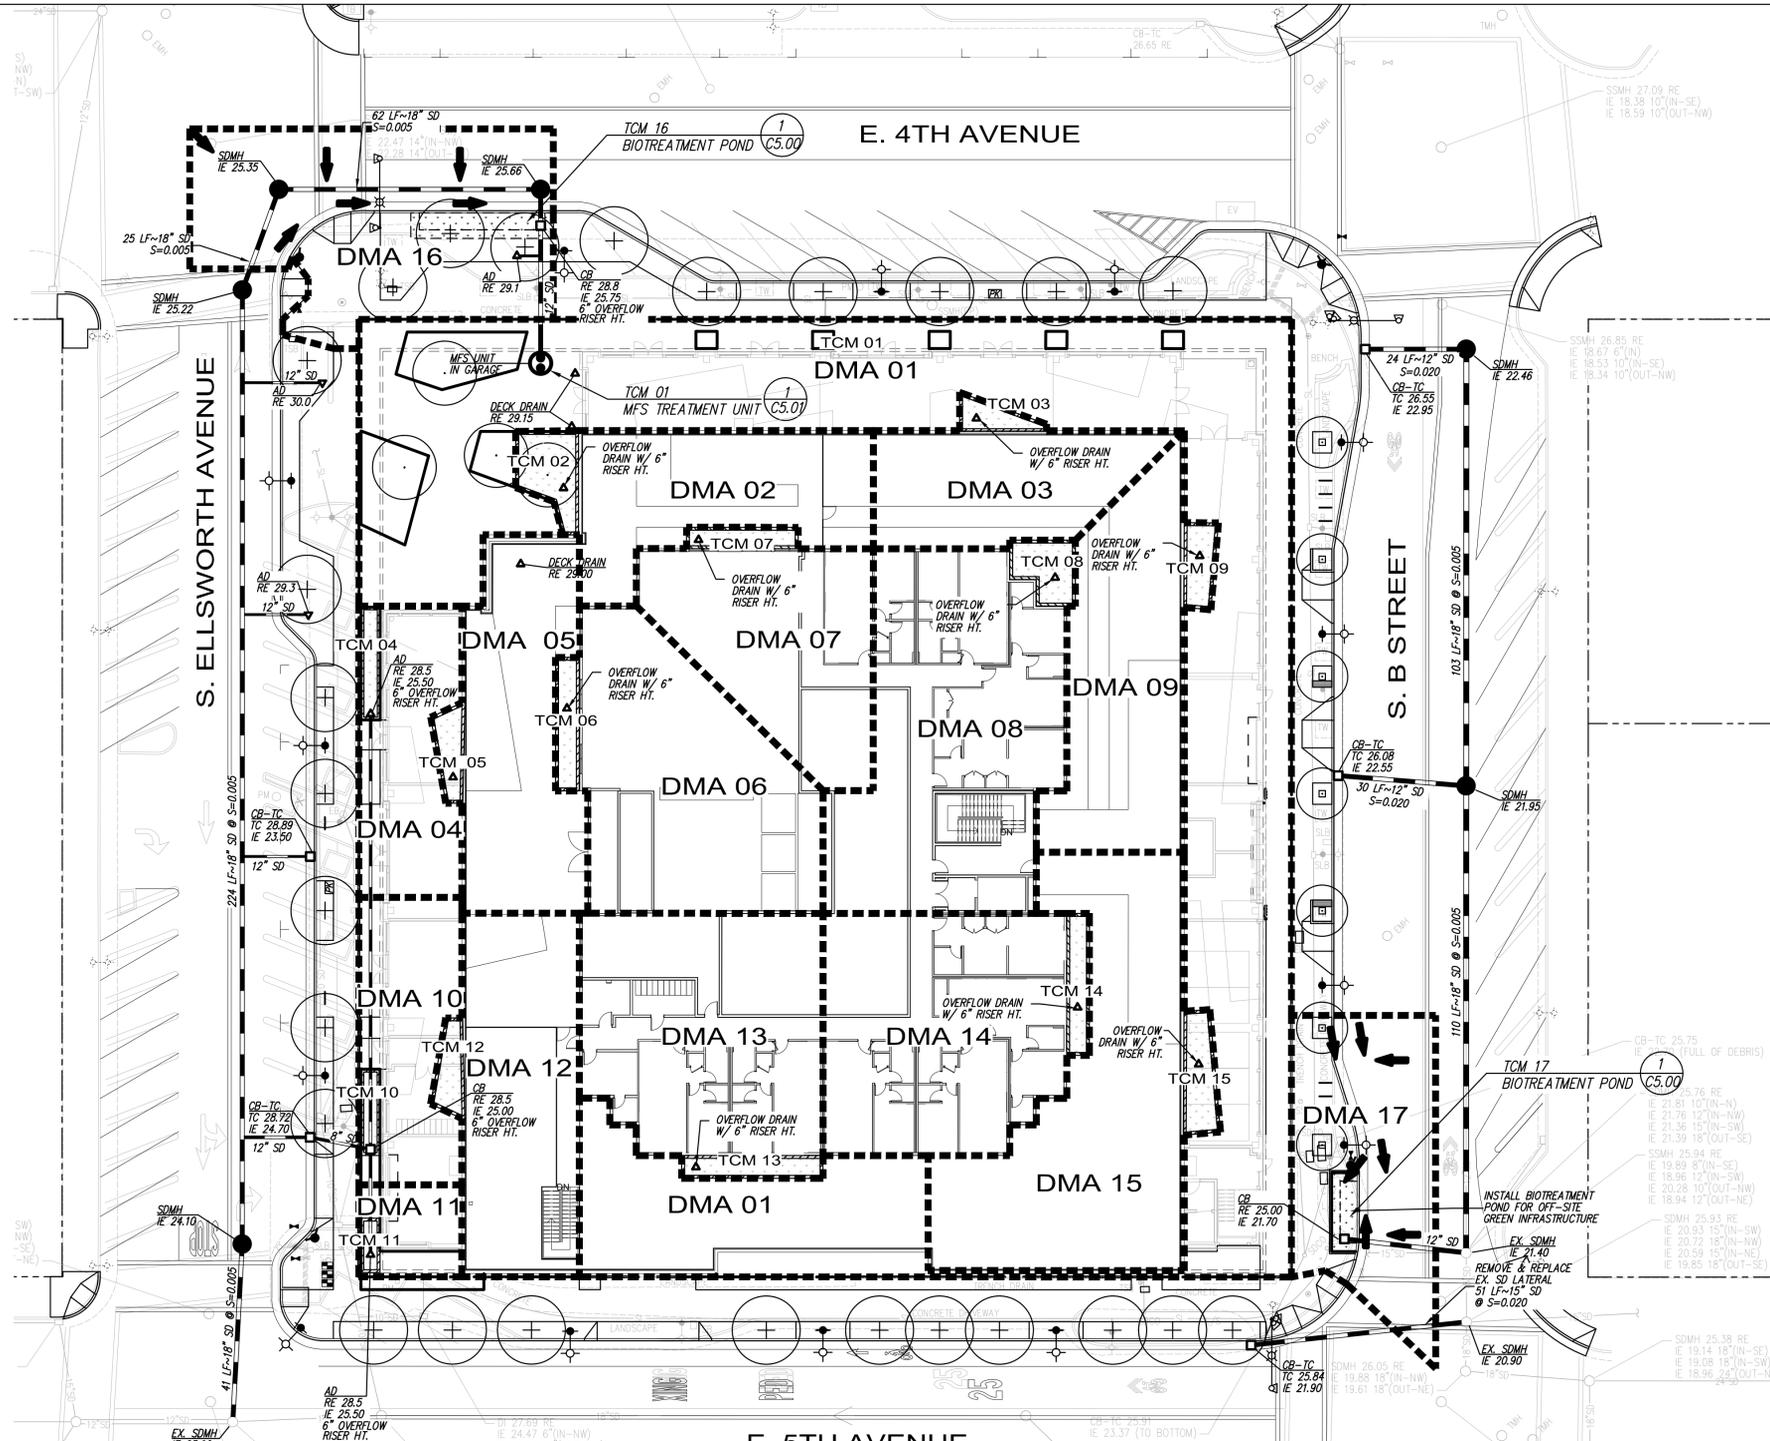

- NOTES**
- NON-LID TREATMENT MEASURES SHALL BE SIZED TO TREAT LID DMAs IF THERE IS NOT DUAL PIPING WITHIN THE BUILDING FOOTPRINT. FINAL MFS UNIT SIZING WILL BE ADJUSTING DURING BUILDING PERMIT STAGE IF NECESSARY.
 - THE PROJECT IS EXEMPT FROM HYDROMODIFICATION REQUIREMENTS PER THE C.3 TECHNICAL GUIDANCE DOCUMENT AS IT IS NOT LOCATED WITHIN A SUBWATERSHED AREA LESS THAN 65% IMPERVIOUSNESS ON THE HM APPLICABILITY MAP.
 - ALL LID TREATMENT MEASURES WITHIN THE DEVELOPMENT PROPERTY LINE CONSIST OF FLOW-THROUGH PLANTERS PER DETAIL 2 ON SHEET C5.00.

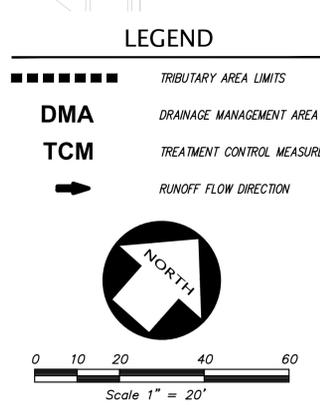

Z:\2019\A19538-1\DWG\entitlements\pdr_permit\A19538-1-PC-SWM.dwg 6-17-22 08:08:28 AM kmudsen

Manufactured Stormwater Treatment Measure Maintenance Plan
for
222 E. 4TH STREET
February 2020

Manufactured Stormwater Treatment Measures are **PROPRIETARY** treatment devices that tend to be installed below ground and operate using some type of proprietary filter media, hydrodynamic separation, or sedimentation and screening. Common examples of manufactured treatment measures include manufactured media filters, inlet filters or drain inserts, oil/water separators and hydrodynamic separators. In August 2004, the Regional Water Board's Executive Office wrote a letter stating that a project relying on inlet filters or oil/water separators as the sole treatment measure would be unlikely to meet the maximum extent practicable standard of the National Pollutant Discharge Elimination System Permit. See the Countywide C.3 Technical Guidance (www.flowstobay.org) for more information.

Project Address: 222 E. 4th Street

Assessor's parcel #: APN 034-017-176

Property Owner: Lane Partners Phone No.: (650)-838-0100

Designated Contact: Marcus Gilmour Phone No.: (650)-838-0100

Mailing Address: 644 Menlo Avenue 2nd Floor, Menlo Park, CA 94025

The property contains one Oldcastle Perk Filter located as described below and as shown in the attached site plan.

Perk Filter is located at Southeasterly corner of property.

I. Routine Maintenance Activities

The principal maintenance objective is to prevent sediment buildup and clogging, which reduces pollutant removal efficiency and may lead to failure of the manufactured treatment measure. Routine maintenance activities, and the frequency at which they will be conducted, are shown in Table 1.

No.	Maintenance Task	Frequency of Task
1	Inspect for standing water, sediment, trash and debris.	Monthly during rainy season
2	Remove sediment, trash and debris from sedimentation basin, riser pipe and filter bed, using vector truck method. Dispose of sediment, trash, filters and debris properly.	As needed
3	Ensure that manufactured treatment measure drains completely within five days.	After major storm events and as needed.
4	Inspect outlets to ensure proper drainage.	Monthly during rainy season, or as needed after storm events

5	Follow manufacturer's guidelines for maintenance and cartridge replacement.	As per manufacturer's specifications.
6	Inspect manufactured treatment measure, using the attached inspection checklist.	Monthly, or after large storm events, and after removal of accumulated debris or material

II. Prohibitions

Trees and other large vegetation shall be prevented from growing adjacent to the manufactured treatment measure to prevent damage.

Standing water shall not remain in the treatment measures for more than five days, to prevent mosquito generation. Should any mosquito issues arise, contact the San Mateo County Mosquito Abatement District (SMCMAD), as needed for assistance. Mosquito larvicides shall be applied only when absolutely necessary, as indicated by the SMCMAD, and then only by a licensed professional or contractor. Contact information for SMCMAD is provided below.

III. Mosquito Abatement Contact Information


San Mateo County Mosquito Abatement District
1351 Rollins Road
Burlingame, CA 94010
PH: (650) 344-8592
FAX: (650) 344-3843
Email: info@smcmad.org

IV. Inspections

The attached Treatment Measure Inspection and Maintenance Checklist shall be used to conduct inspections monthly (or as needed), identify needed maintenance, and record maintenance that is conducted.

DMA #	TCM #	Location	Treatment Type	LID or Non-LID	Sizing Method	Drainage Area (s.f.)	Impervious Area (s.f.)	Permeous Area (Permeable Pavement) (s.f.)	Permeous Area (Other) (s.f.)	% On-Site Area Treated by LID or Non-LID TCM	Bioretention Area (s.f.)	Bioretention Area Provided (s.f.)	Overflow Riser Height (in)	Storage Depth Required (ft)	Storage Depth Provided (ft)	# of Cartridges Required	# of Cartridges Provided	Media Type	Cartridge Height (inches)	# of Credit Trees	Treatment Credit (s.f.)	Comments
1	N/A	Onsite	Proprietary Media Filter System (MFS)	Non-LID	N/A	14,204	13,138	0	1,066	28.71%	N/A	N/A	N/A	N/A	N/A	3	3		18	N/A	N/A	
2	2	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	2,243	2,024	0	219	4.53%	81 sf	81	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
3	3	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	1,728	1,649	0	79	3.49%	66 sf	66	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
4	4	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	1,535	1,455	0	80	3.10%	58 sf	58	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
5	5	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	2,386	2,286	0	100	4.82%	91 sf	91	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
6	6	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	3,314	3,186	0	128	6.70%	127 sf	127	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
7	7	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	2,351	2,259	0	92	4.75%	90 sf	90	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
8	8	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	4,102	3,942	0	160	8.29%	158 sf	158	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
9	9	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	2,577	2,466	0	111	5.21%	99 sf	99	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
10	10	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	1,515	1,455	0	60	3.06%	58 sf	58	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
11	11	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	525	343	0	182	1.06%	14 sf	14	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
12	12	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	2,490	2,390	0	100	5.03%	96 sf	96	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
13	13	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	3,306	3,178	0	128	6.68%	127 sf	127	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
14	14	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	3,306	3,178	0	128	6.68%	127 sf	127	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
15	15	Onsite	Flow-Through planter (concrete lined) w/ underdrain	LID	3. Flow-Volume Combo	3,885	3,716	0	169	7.85%	149 sf	149	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A	
						Totals:	49,467	46,665	0	2,802	100.00%											


DMA #	TCM #	Location	Treatment Type	LID or Non-LID	Sizing Method	Drainage Area (s.f.)	Impervious Area (s.f.)	Permeous Area (Permeable Pavement) (s.f.)	Permeous Area (Other) (s.f.)	% On-Site Area Treated by LID or Non-LID TCM	Bioretention Area (s.f.)	Bioretention Area Provided (s.f.)	Overflow Riser Height (in)	Storage Depth Required (ft)	Storage Depth Provided (ft)	# of Cartridges Required	# of Cartridges Provided	Media Type	Cartridge Height (inches)	# of Credit Trees	Treatment Credit (s.f.)	Comments	
16	16	Onsite	Bioretention unlined w/ underdrain	LID	2C. Flow: 4% Method **	1,922	1,652	0	270	45.26%	66 sf	66	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A		
17	17	Onsite	Bioretention unlined w/ underdrain	LID	2C. Flow: 4% Method **	2,325	1,765	0	560	54.74%	71 sf	71	6	6	6	N/A	N/A	N/A	N/A	N/A	N/A		
						Totals:	4,247	3,417	0	830	100.00%												

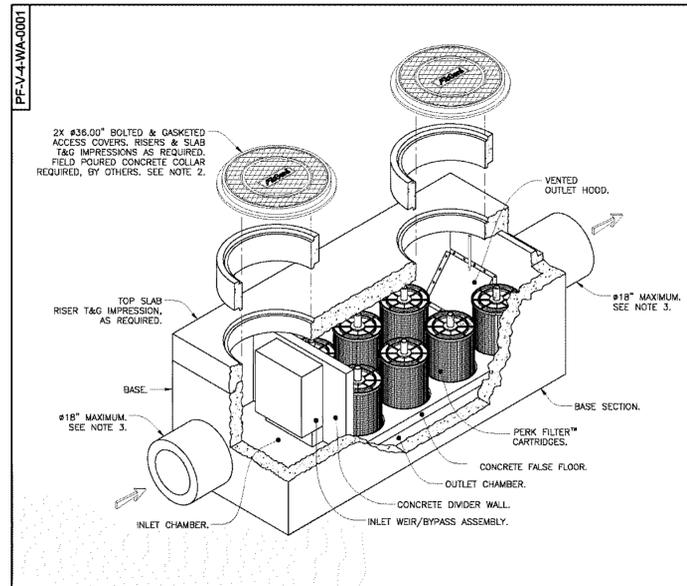

- Notes:
- Precast concrete structure shall be manufactured in accordance with ASTM Designation C857 and C858.
 - Filter system shall be supplied with traffic rated (H20) bolted & gasketed Ø36" circular access covers with risers as required. Shallow applications may require configurations with (H20) bolted & gasketed square/rectangular access hatches. Field poured concrete collars required, by others.
 - Inlet & outlet pipe(s) (Ø 18" maximum) may enter device on all three sides of the inlet & outlet chambers respectively.
 - Inlet chamber shall be supplied with a drain-down device designed to remove standing water between storm events.
 - For depths less than specified minimums contact Oldcastle® Stormwater Solutions for engineering assistance.

Perk Filter™
4' Wide Concrete Vault
Washington State GULD
Three to Seven Cartridges / Stacks

Oldcastle®
Stormwater Solutions
7821 Southpark Plaza, Suite 200 | Littleton, CO 80120 | PH: 800.878.8819 | oldcastlestormwater.com
THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE STORMWATER SOLUTIONS, INC. IT IS LOANED TO YOU FOR YOUR PROJECT ONLY. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE STORMWATER SOLUTIONS, INC. ALL RIGHTS RESERVED.
DRAWING NO: PF-V-4-WA-0001 | D | ECD-0122 | JPR 10/31/14 | JPR 3/2/11 | SHEET 1 OF 2

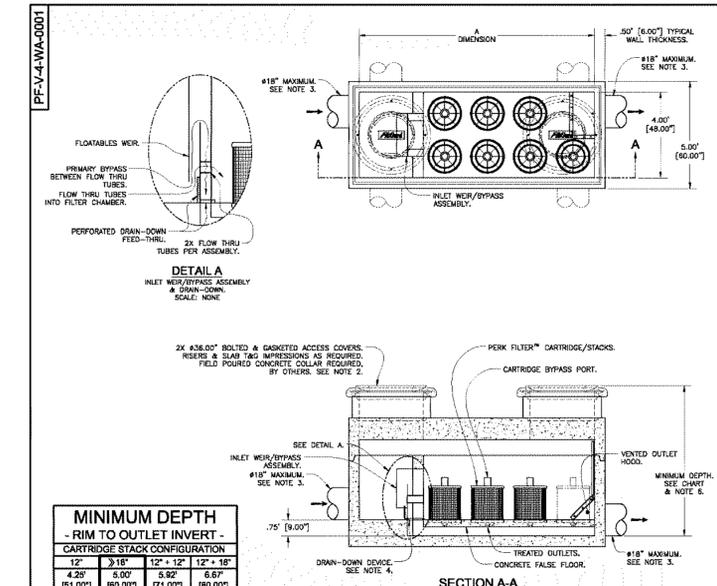

MINIMUM DEPTH - RIM TO OUTLET INVERT - CARTRIDGE STACK CONFIGURATION	
CARTRIDGE STACK QUANTITY	MINIMUM DEPTH (ft)
3	4.28' [81.00"]
4	5.00' [80.00"]
5	5.82' [71.00"]
6	6.67' [80.00"]

4' VAULT TREATMENT FLOW RATES, TOTAL FLOW CAPACITIES & MAXIMUM HEAD LOSS										
CARTRIDGE STACK QUANTITY	DIMENSION A (DIM- FEET)	9" & 12"		12" & 12"		12" & 18"		TREATMENT FLOW RATE (GPM/CFD)	TOTAL FLOW CAPACITY (CFD)	
		TREATMENT FLOW RATE (GPM/CFD)	TOTAL FLOW CAPACITY (CFD)	TREATMENT FLOW RATE (GPM/CFD)	TOTAL FLOW CAPACITY (CFD)	TREATMENT FLOW RATE (GPM/CFD)	TOTAL FLOW CAPACITY (CFD)			
3	7	20.4 / 0.045	2.9	30.6 / 0.068	4.3	40.8 / 0.091	5.0	51.0 / 0.114	6.7	
4	9	27.2 / 0.061	2.9	40.8 / 0.091	4.4	54.4 / 0.121	5.0	66.0 / 0.152	6.8	
5	9	34.0 / 0.078	2.9	51.0 / 0.114	4.4	66.0 / 0.152	5.1	85.0 / 0.190	6.8	
6	11	40.8 / 0.091	3.0	61.2 / 0.136	4.5	81.6 / 0.185	5.1	102.0 / 0.227	6.9	
7	11	47.6 / 0.106	3.0	71.4 / 0.159	4.5	96.2 / 0.212	5.2	116.0 / 0.265	7.0	
MAXIMUM HEAD LOSS		1.7 FEET				2.9 FEET		3.5 FEET		


Perk Filter™
4' Wide Concrete Vault
Washington State GULD
Three to Seven Cartridges / Stacks

Oldcastle®
Stormwater Solutions
7821 Southpark Plaza, Suite 200 | Littleton, CO 80120 | PH: 800.878.8819 | oldcastlestormwater.com
THIS DOCUMENT IS THE PROPERTY OF OLDCASTLE STORMWATER SOLUTIONS, INC. IT IS LOANED TO YOU FOR YOUR PROJECT ONLY. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF OLDCASTLE STORMWATER SOLUTIONS, INC. ALL RIGHTS RESERVED.
DRAWING NO: PF-V-4-WA-0001 | D | ECD-0122 | JPR 10/31/14 | JPR 3/2/11 | SHEET 2 OF 2

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

Z:\2019\A19538-1\DWG\entitlements\pd_permit\A19538-1-PC-SWM.dwg 6-17-22 08:08:30 AM kmudsen

Z:\2019\A19538-1\DWG\entitlements\pad_permit\A19538-1-1-PC-SWM.dwg 6-17-22 08:08:32 AM kmudsen

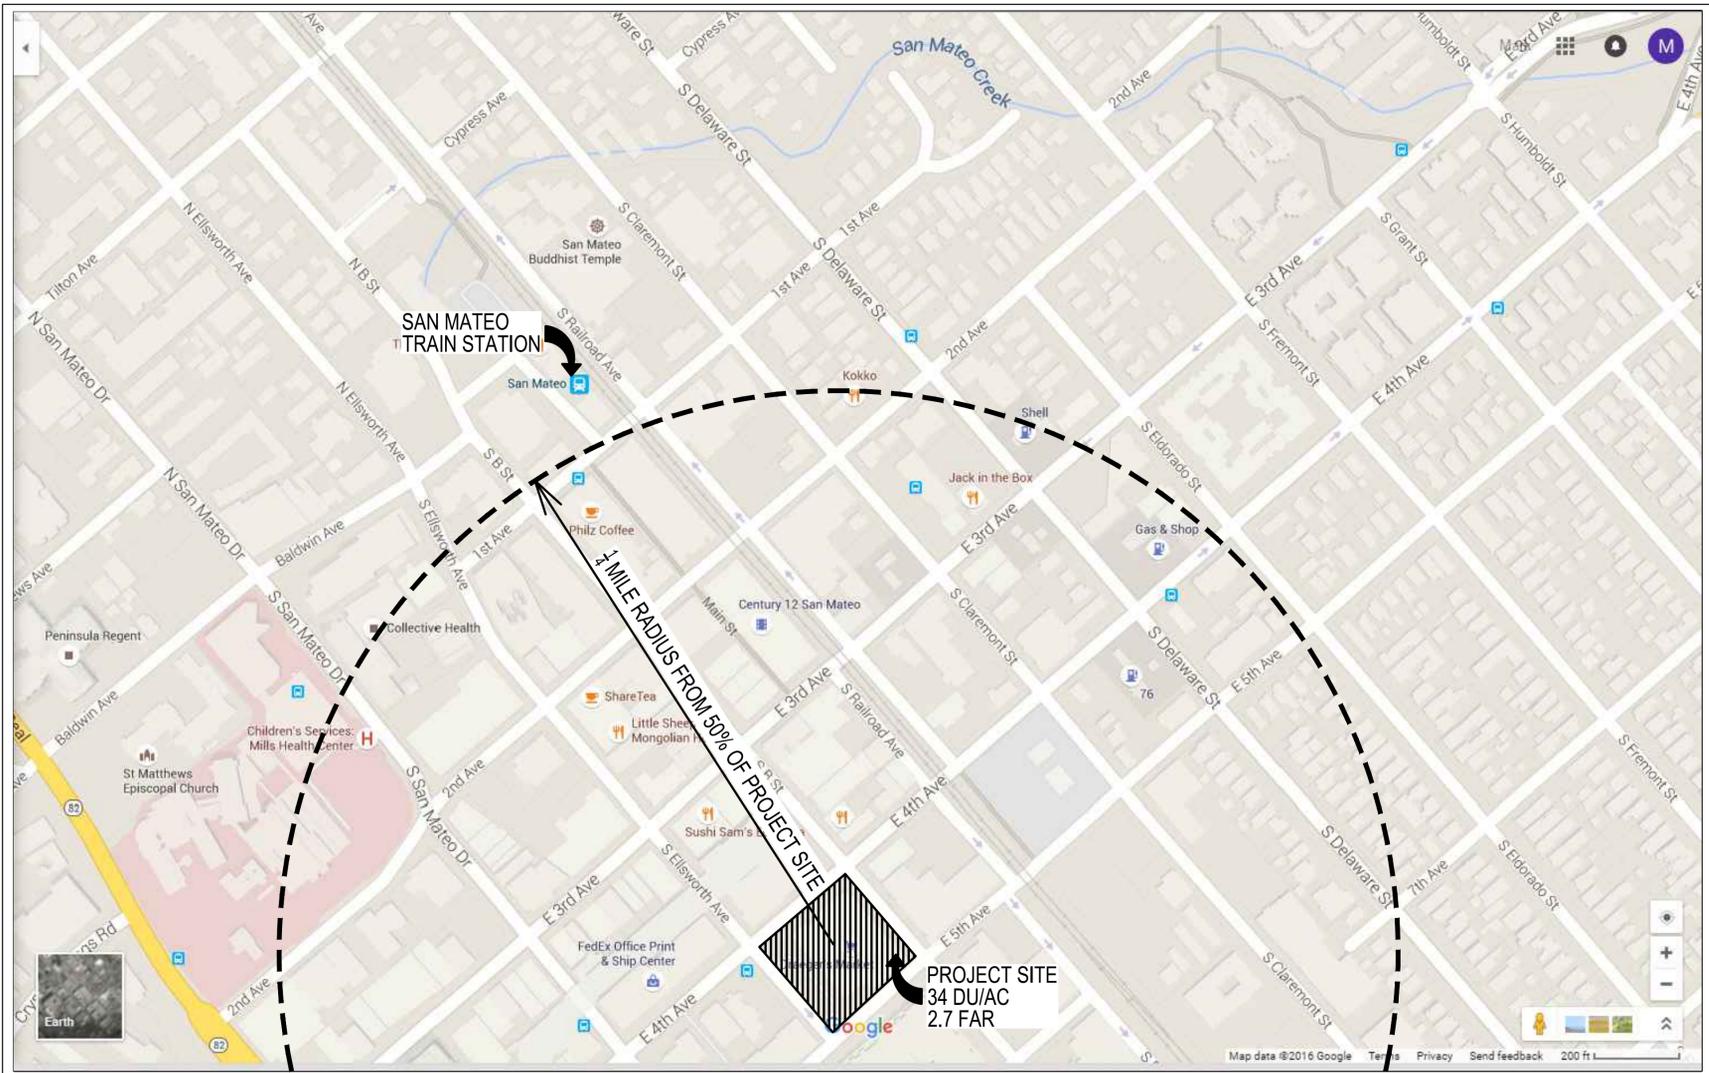

J.4 Category C: Transit-Oriented Development
 The defining criteria and LID treatment reduction credits for Category C projects are described below.

CRITERIA FOR CATEGORY C (TRANSIT ORIENTED DEVELOPMENT) SPECIAL PROJECTS
 To be considered a Category C Special Project, a Provision C.3 Regulated Project must meet all of the following criteria:

1. Be characterized as a non-auto-related land use project. That is, Category C specifically excludes any Regulated Project that is a stand-alone surface parking lot; car dealership; auto and truck rental facility with onsite surface storage; fast-food restaurant, bank or pharmacy with drive-through lanes; gas station, car wash, auto repair and service facility; or other auto-related project unrelated to the concept of Transit-Oriented Development.
2. If a commercial project, achieve at least an FAR of 2:1.
3. If a residential development project, achieve at least a gross density of 25 DU/AC.
4. If a mixed-use development project, achieve an FAR of at least 2:1, or a gross density of 25 DU/AC.

**Worksheet F
 Special Projects**

Complete this worksheet for projects that appear to meet the definition of "Special Project", per Provision C.3.e.ii of the Municipal Regional Stormwater Permit (MRP). The form assists in determining whether a project meets Special Project criteria, and the percentage of low impact development (LID) treatment reduction credit. Special Projects that implement less than 100% LID treatment must provide a narrative discussion of the feasibility or infeasibility of 100% LID treatment. See Appendix J of the C.3 Technical Guidance Handbook (download at www.flowstobay.org) for more information.

- F.1 "Special Project" Determination** (Check the boxes to determine if the project meets any of the following categories.)
- Special Project Category "A"**
 Does the project have ALL of the following characteristics?
 Located in a municipality's designated central business district, downtown core area or downtown core zoning district, neighborhood business district or comparable pedestrian-oriented commercial district, or historic preservation site and/or district¹⁵;
 Creates and/or replaces 0.5 acres or less of impervious surface;
 Includes no surface parking, except for incidental parking for emergency vehicle access, ADA access, and passenger or freight loading zones;
 Has at least 85% coverage of the entire site by permanent structures. The remaining 15% portion of the site may be used for safety access, parking structure entrances, trash and recycling service, utility access, pedestrian connections, public uses, landscaping and stormwater treatment.
- No (continue) Yes - Complete Section F.2 below
- Special Project Category "B"**
 Does the project have ALL of the following characteristics?
 Located in a municipality's designated central business district, downtown core area or downtown core zoning district, neighborhood business district or comparable pedestrian-oriented commercial district, or historic preservation site and/or district¹⁵;
 Creates and/or replaces more than 0.5 acres of impervious area and less than 2.0 acres;
 Includes no surface parking, except for incidental parking for emergency access, ADA access, and passenger or freight loading zones;
 Has at least 85% coverage of the entire site by permanent structures. The remaining 15% portion of the site may be used for safety access, parking structure entrances, trash and recycling service, utility access, pedestrian connections, public uses, landscaping and stormwater treatment;
 Minimum density of either 50 dwelling units per acre (for residential projects) or a Floor Area Ratio (FAR) of 2:1 (for commercial projects) - mixed use projects may use either criterion. **Note Change on 7/1/16¹⁶**
- No (continue) Yes - Complete Section F-2 below
- Special Project Category "C"**
 Does the project have ALL of the following characteristics?
 At least 50% of the project area is within 1/2 mile of an existing or planned transit hub¹⁷ or 100% within a planned Priority Development Area¹⁸;
 The project is characterized as a non-auto-related use¹⁹; and
 Minimum density of either 25 dwelling units per acre (for residential projects) or a Floor Area Ratio (FAR) of 2:1 (for commercial projects) - mixed use projects may use either criterion. **Note Change on 7/1/16¹⁶**
- No (continue) Yes - Complete Section F-2 below

¹⁵ And built as part of a municipality's stated objective to preserve/enhance a pedestrian-oriented type of urban design.
¹⁶ Effective 7/1/16, the MRP establishes definitions for "Gross Density" (GD) & FAR. GD is defined as, "the total number of residential units divided by the acreage of the entire site area, including land occupied by public right-of-ways, recreational, civic, commercial and other non-residential uses." FAR is defined as, "the Ratio of the total floor area on all floors of all buildings at a project site (except structures, floors, or floor areas dedicated to parking) to the total project site area."
¹⁷ "Transit hub" is defined as a rail, light rail, or commuter rail station, ferry terminal, or bus transfer station served by three or more bus routes. (A bus stop with no supporting services does not qualify.)
¹⁸ A "planned Priority Development Area" is an infill development area formally designated by the Association of Bay Area Government's / Metropolitan Transportation Commission's FOCUS regional planning program.
¹⁹ Category C specifically excludes stand-alone surface parking lots; car dealerships; auto and truck rental facilities with onsite surface storage; fast-food restaurants, banks or pharmacies with drive-through lanes; gas stations; car washes; auto repair and service facilities; or other auto-related project unrelated to the concept of transit oriented development.

C.3 and C.6 Development Review Checklist

F.2 LID Treatment Reduction Credit Calculation

(If more than one category applies, choose only one of the applicable categories and fill out the table for that category.)

Category	Impervious Area Created/Replaced (sq. ft.)	Site Coverage (%)	Project Density ¹⁹ or FAR ¹⁶	Density/Criteria	Allowable Credit (%)	Applied Credit (%)
A			N.A.	N.A.	100%	
B				Res ≥ 50 DU/ac or FAR ≥ 2:1 Res ≥ 75 DU/ac or FAR ≥ 3:1 Res ≥ 100 DU/ac or FAR ≥ 4:1	50% 75% 100%	
C	46,665	100	2.98	Location credit (select one) ²⁰ : Within 1/2 mile of transit hub Within 1/4 mile of transit hub Within a planned PDA Density credit (select one): Res ≥ 30 DU/ac or FAR ≥ 2:1 Res ≥ 60 DU/ac or FAR ≥ 4:1 Res ≥ 100 DU/ac or FAR ≥ 6:1 Parking credit (select one): ≤ 10% at-grade surface parking ²¹ No surface parking	50% 25% 25% 10% 20% 30% 10% 20%	25 10 20
TOTAL TOD CREDIT =					55	

F.3 Narrative Discussion of the Feasibility/Infeasibility of 100% LID Treatment:
 If project will implement less than 100% LID, prepare a discussion of the feasibility or infeasibility of 100% LID treatment, as described in Appendix K of the C.3 Technical Guidance.

F.4 Select Certified Non-LID Treatment Measures:
 If the project will include non-LID treatment measures, select a treatment measure certified for "Basic" General Use Level Designation (GULD) by the Washington State Department of Ecology's Technical Assessment Protocol - Ecology (TAPE). Guidance is provided in Appendix K of the C.3 Technical Guidance (download at www.flowstobay.org).²²

²⁰ To qualify for the location credit, at least 50% of the project's site must be located within the 1/2 mile or 1/4 mile radius of an existing or planned transit hub, as defined on page 1, footnote 2. A planned transit hub is a station on the MTC's Regional Transit Expansion Program list, per MTC's Resolution 3434 (revised April 2006), which is a regional priority funding plan for future transit stations in the San Francisco Bay Area. To qualify for the PDA location credit, 100% of the project site must be located within a PDA, as defined on page 1, footnote 3.
²¹ The at-grade surface parking must be treated with LID treatment measures.
²² TAPE certification is used in order to satisfy Special Project's reporting requirements in the MRP.



3350 Scott Boulevard, Building 22
 Santa Clara, California 95054
 Phone: (408) 727-6665
 www.kierwright.com

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

PROJECT NUMBER
 A19538-1

SHEET TITLE
**PRELIMINARY LOW IMPACT
 DEVELOPMENT REDUCTION
 CALCULATIONS**

SCALE
AS SHOWN

SHEET NUMBER

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal






PROJECT NUMBER
A19538-1

SHEET TITLE
VEHICLE
TURNING
ANALYSIS


SCALE
AS SHOWN

SHEET NUMBER

C6.00

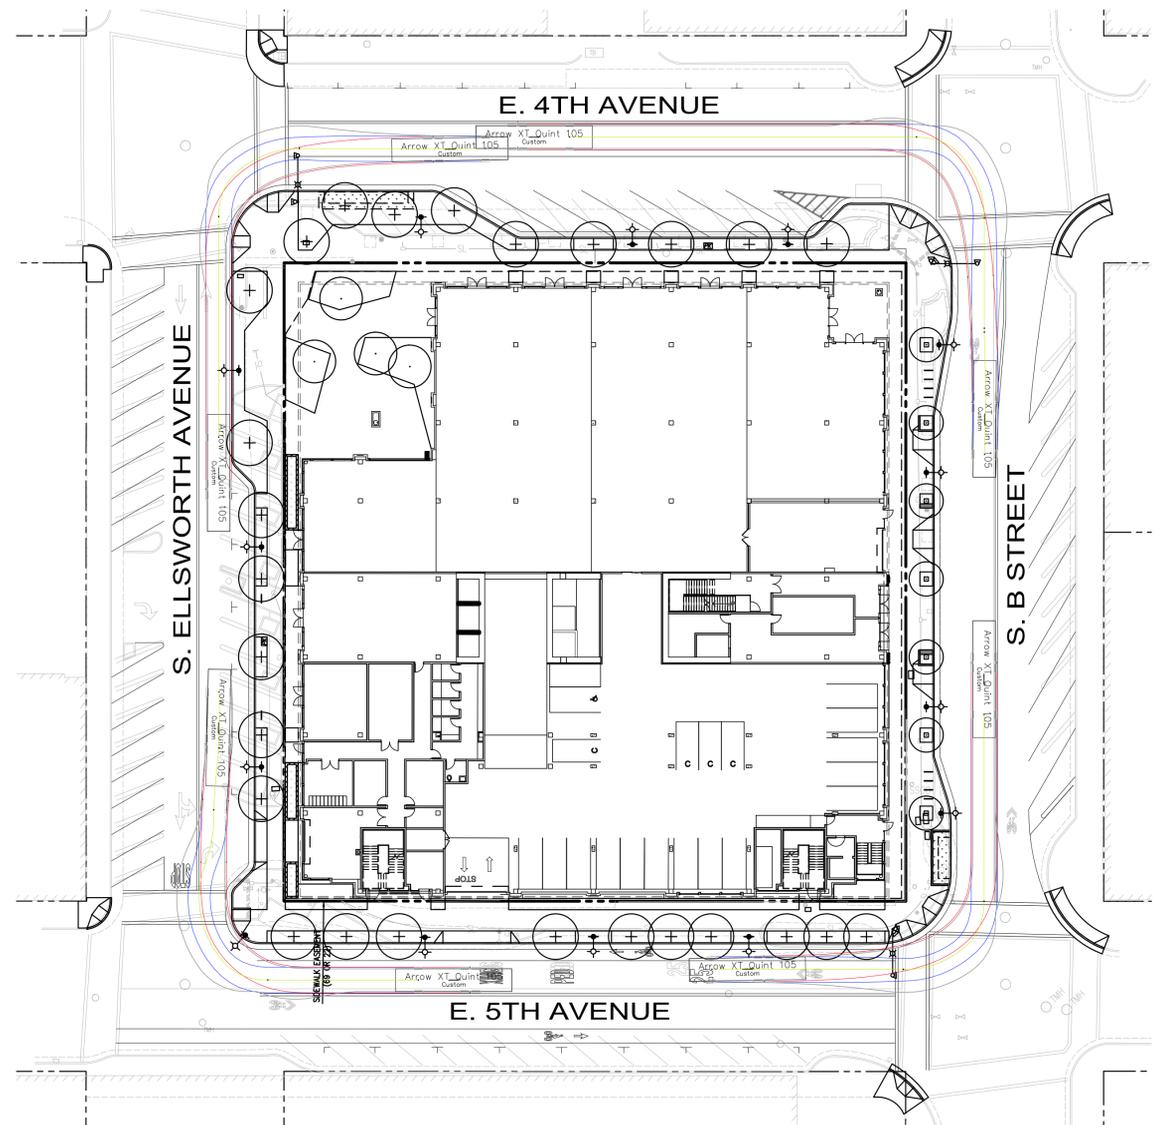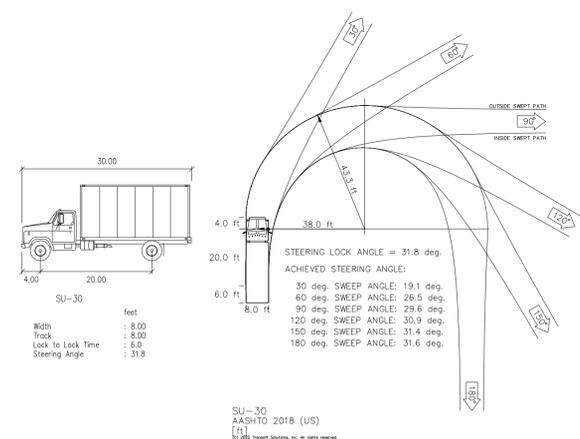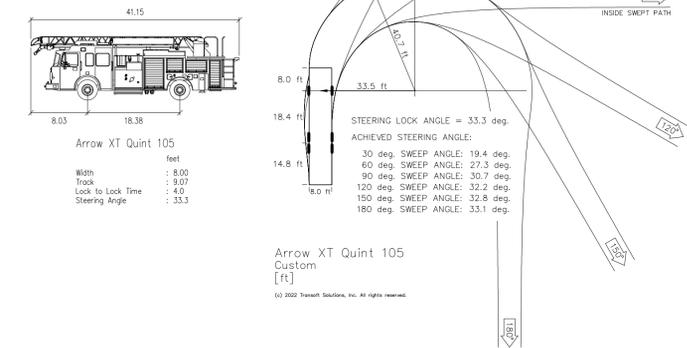


FIRE TRUCK TURNING

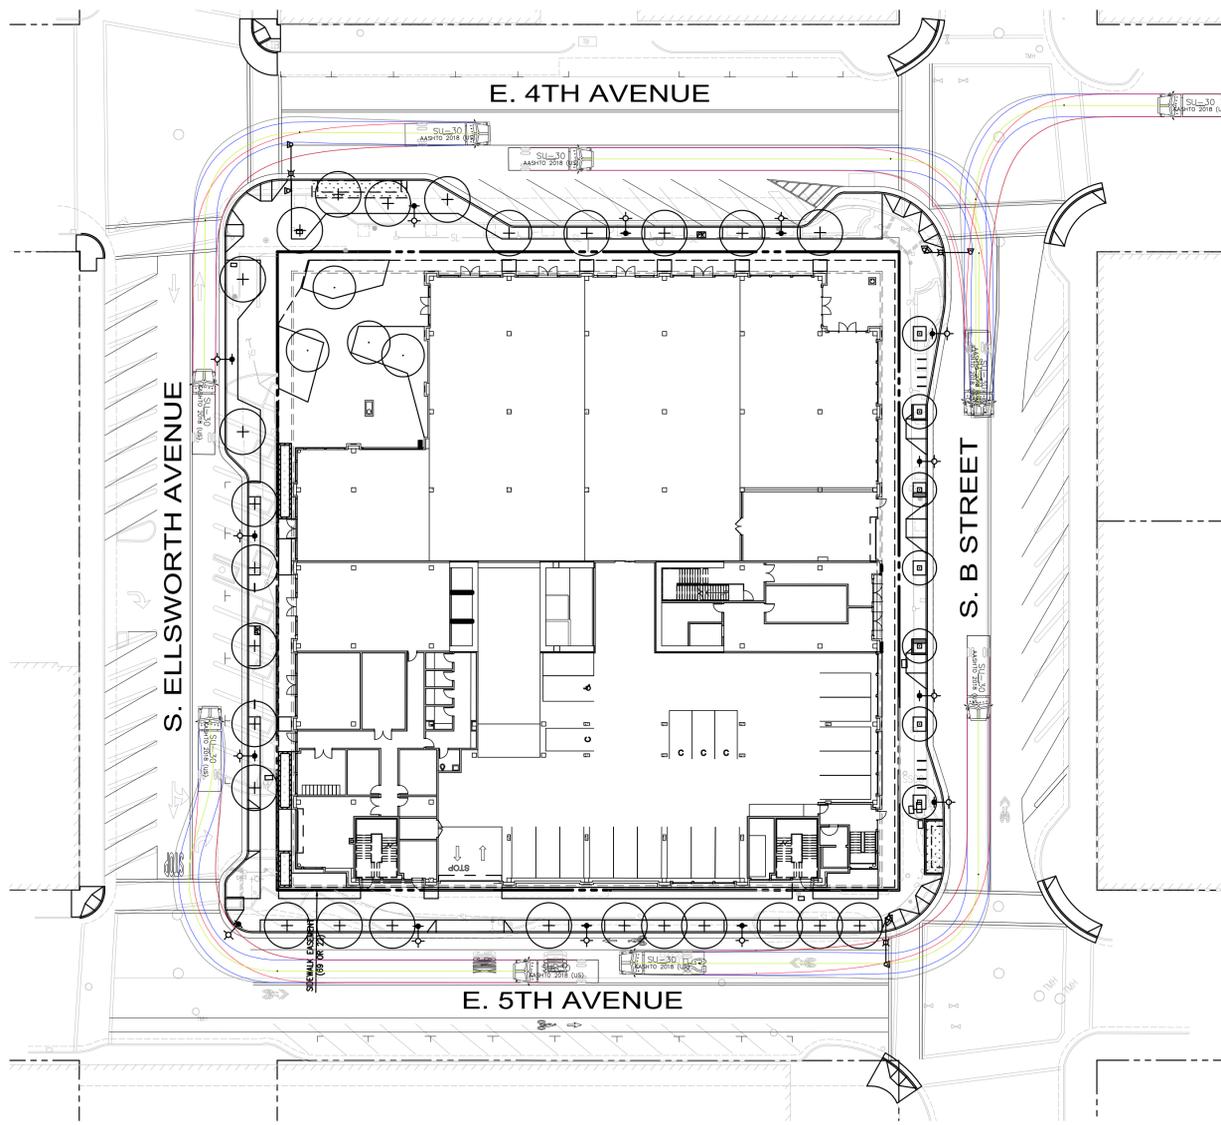

SU-30 TRUCK TURNING

Z:\2019\A19538-1\DWG\entitlements\pd_permit_A19538-1-FC-TRK.dwg 6-17-22 08:08:51 AM tknudsen

Z:\2019\A19538-1\DWG\entitlements\pd_permit\A19538-1-FC-TRK.dwg 6-17-22 08:08:54 AM tknudsen

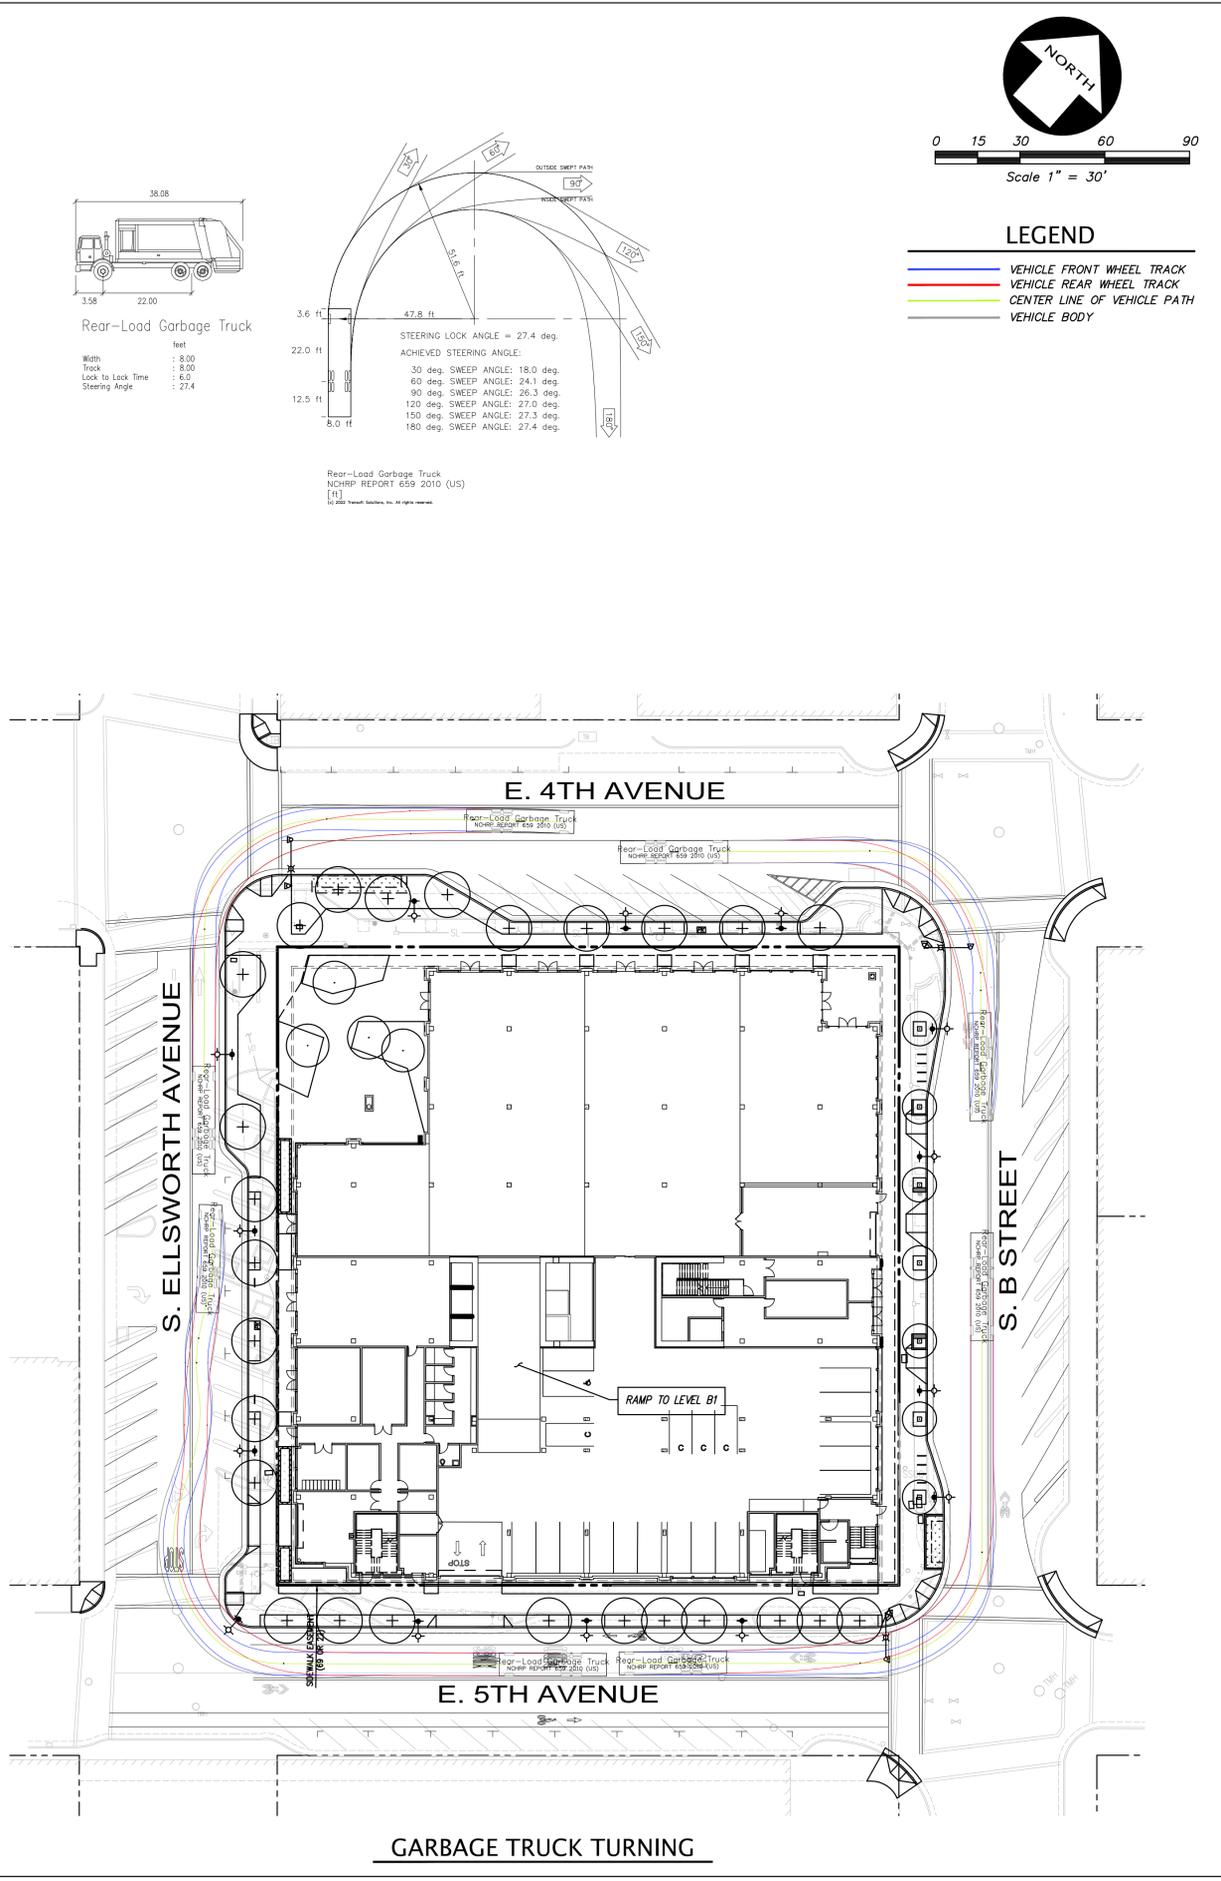

3350 Scott Boulevard, Building 22 Santa Clara, California 95054
Phone: (408) 727-6665
www.kierwright.com

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

PROJECT NUMBER
A19538-1

SHEET TITLE
VEHICLE
TURNING
ANALYSIS

SCALE
AS SHOWN

SHEET NUMBER

C6.01

GARBAGE TRUCK TURNING

ISSUES AND REVISIONS



No.	Date	Description
A	05/05/2020	Pre-Application Set
B	10/21/2020	Pre-App Resubmittal
C	03/19/2021	Pre-App Resubmittal
D	10/15/2021	Pre-App Resubmittal
E	02/04/2022	Pre-App Resubmittal
F	04/22/2022	Pre-App Resubmittal
G	06/15/2022	Pre-App Resubmittal

PROJECT NUMBER
A19538-1


SHEET TITLE
DELIVERY
TRUCK
ARRIVAL
ANALYSIS
SCALE
AS SHOWN

SHEET NUMBER



C6.02

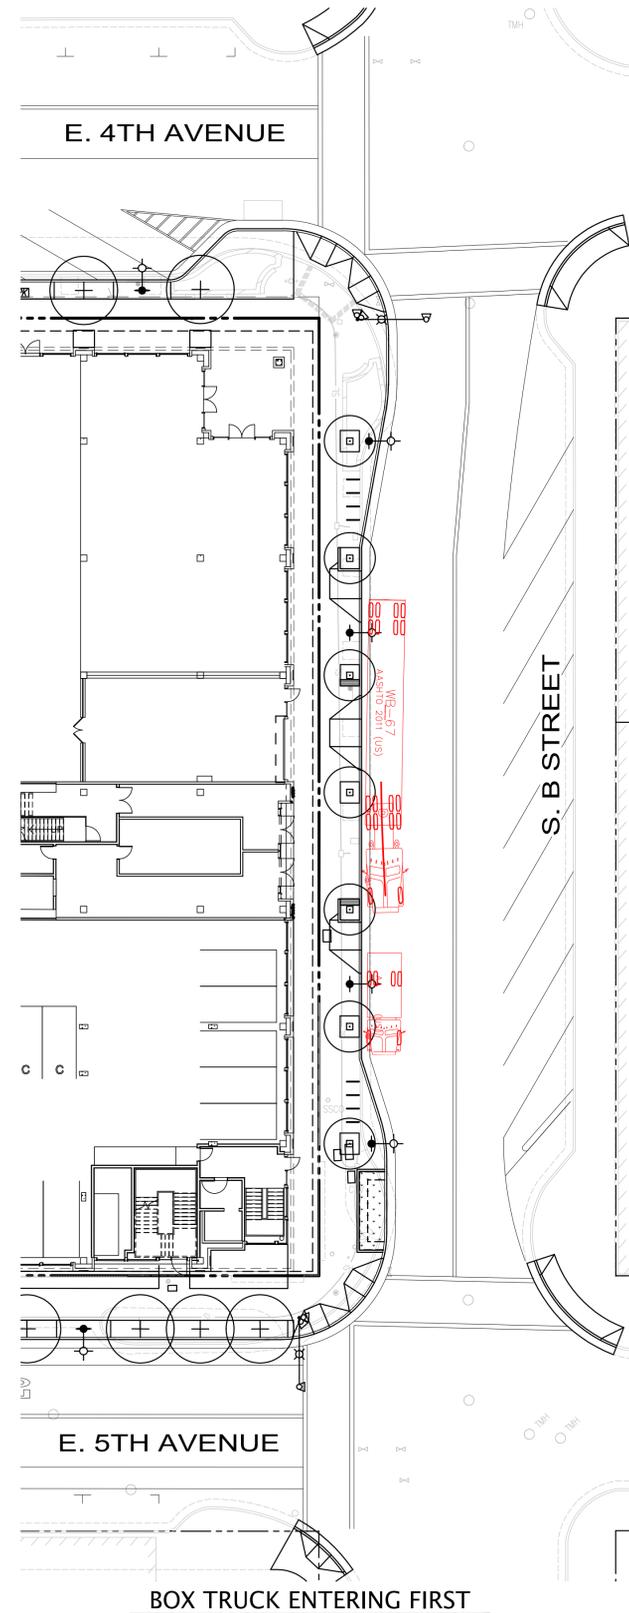

BOX TRUCK ENTERING FIRST


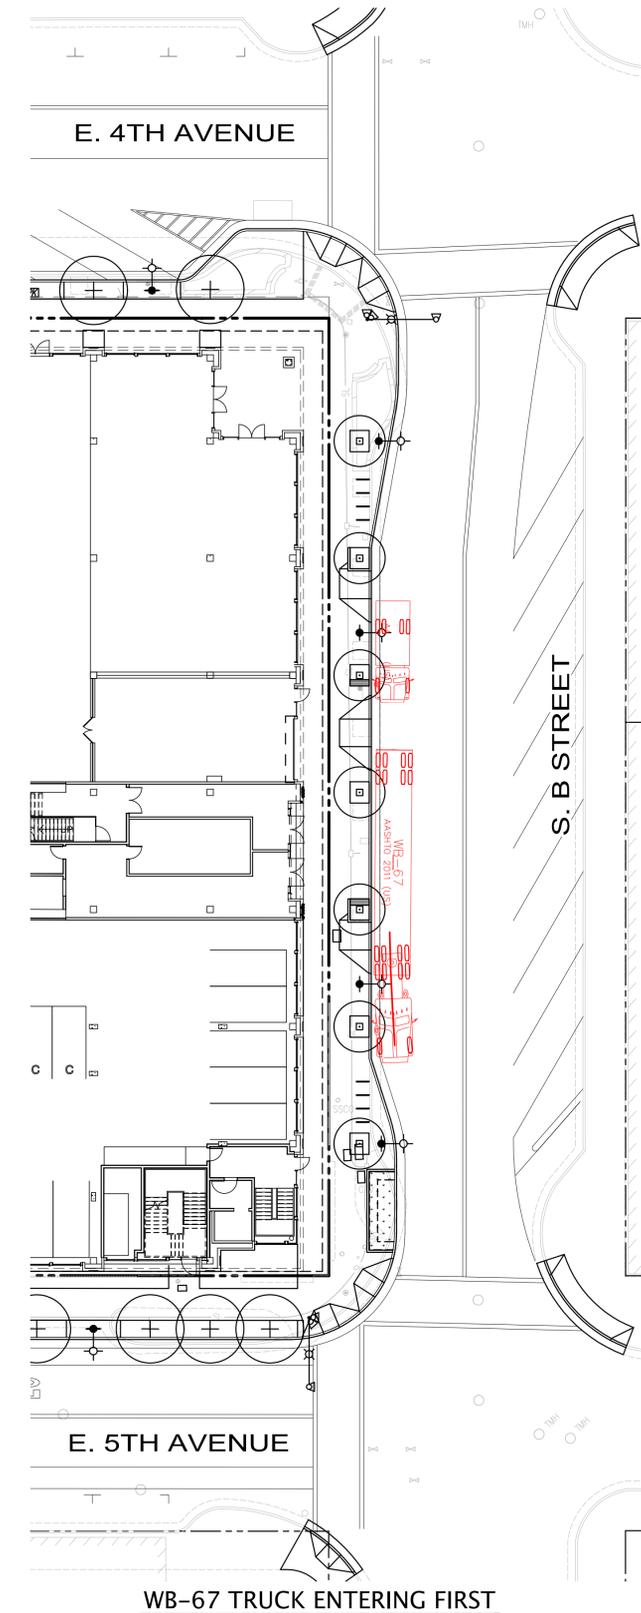


WB-67 TRUCK ENTERING FIRST



SU-30

feet	
Width	: 8.00
Track	: 8.00
Lock to Lock Time	: 6.0
Steering Angle	: 31.8

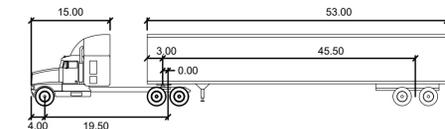

WB-67

feet	
Tractor Width	: 8.00
Trailer Width	: 8.50
Tractor Track	: 8.00
Trailer Track	: 8.50
Lock to Lock Time	: 6.0
Steering Angle	: 28.4
Articulating Angle	: 75.0



ARCHITECTS
KORTH SUNSERI HAGEY

AC
LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
TREE PROTECTION PLAN


SCALE
1/16"=1'-0"

SHEET NUMBER

L-002

LEGEND OF SYMBOLS

-  EXISTING TREE TO BE PROTECTED
-  EXISTING TREE TO BE RELOCATED
-  EXISTING TREE TO BE REMOVED

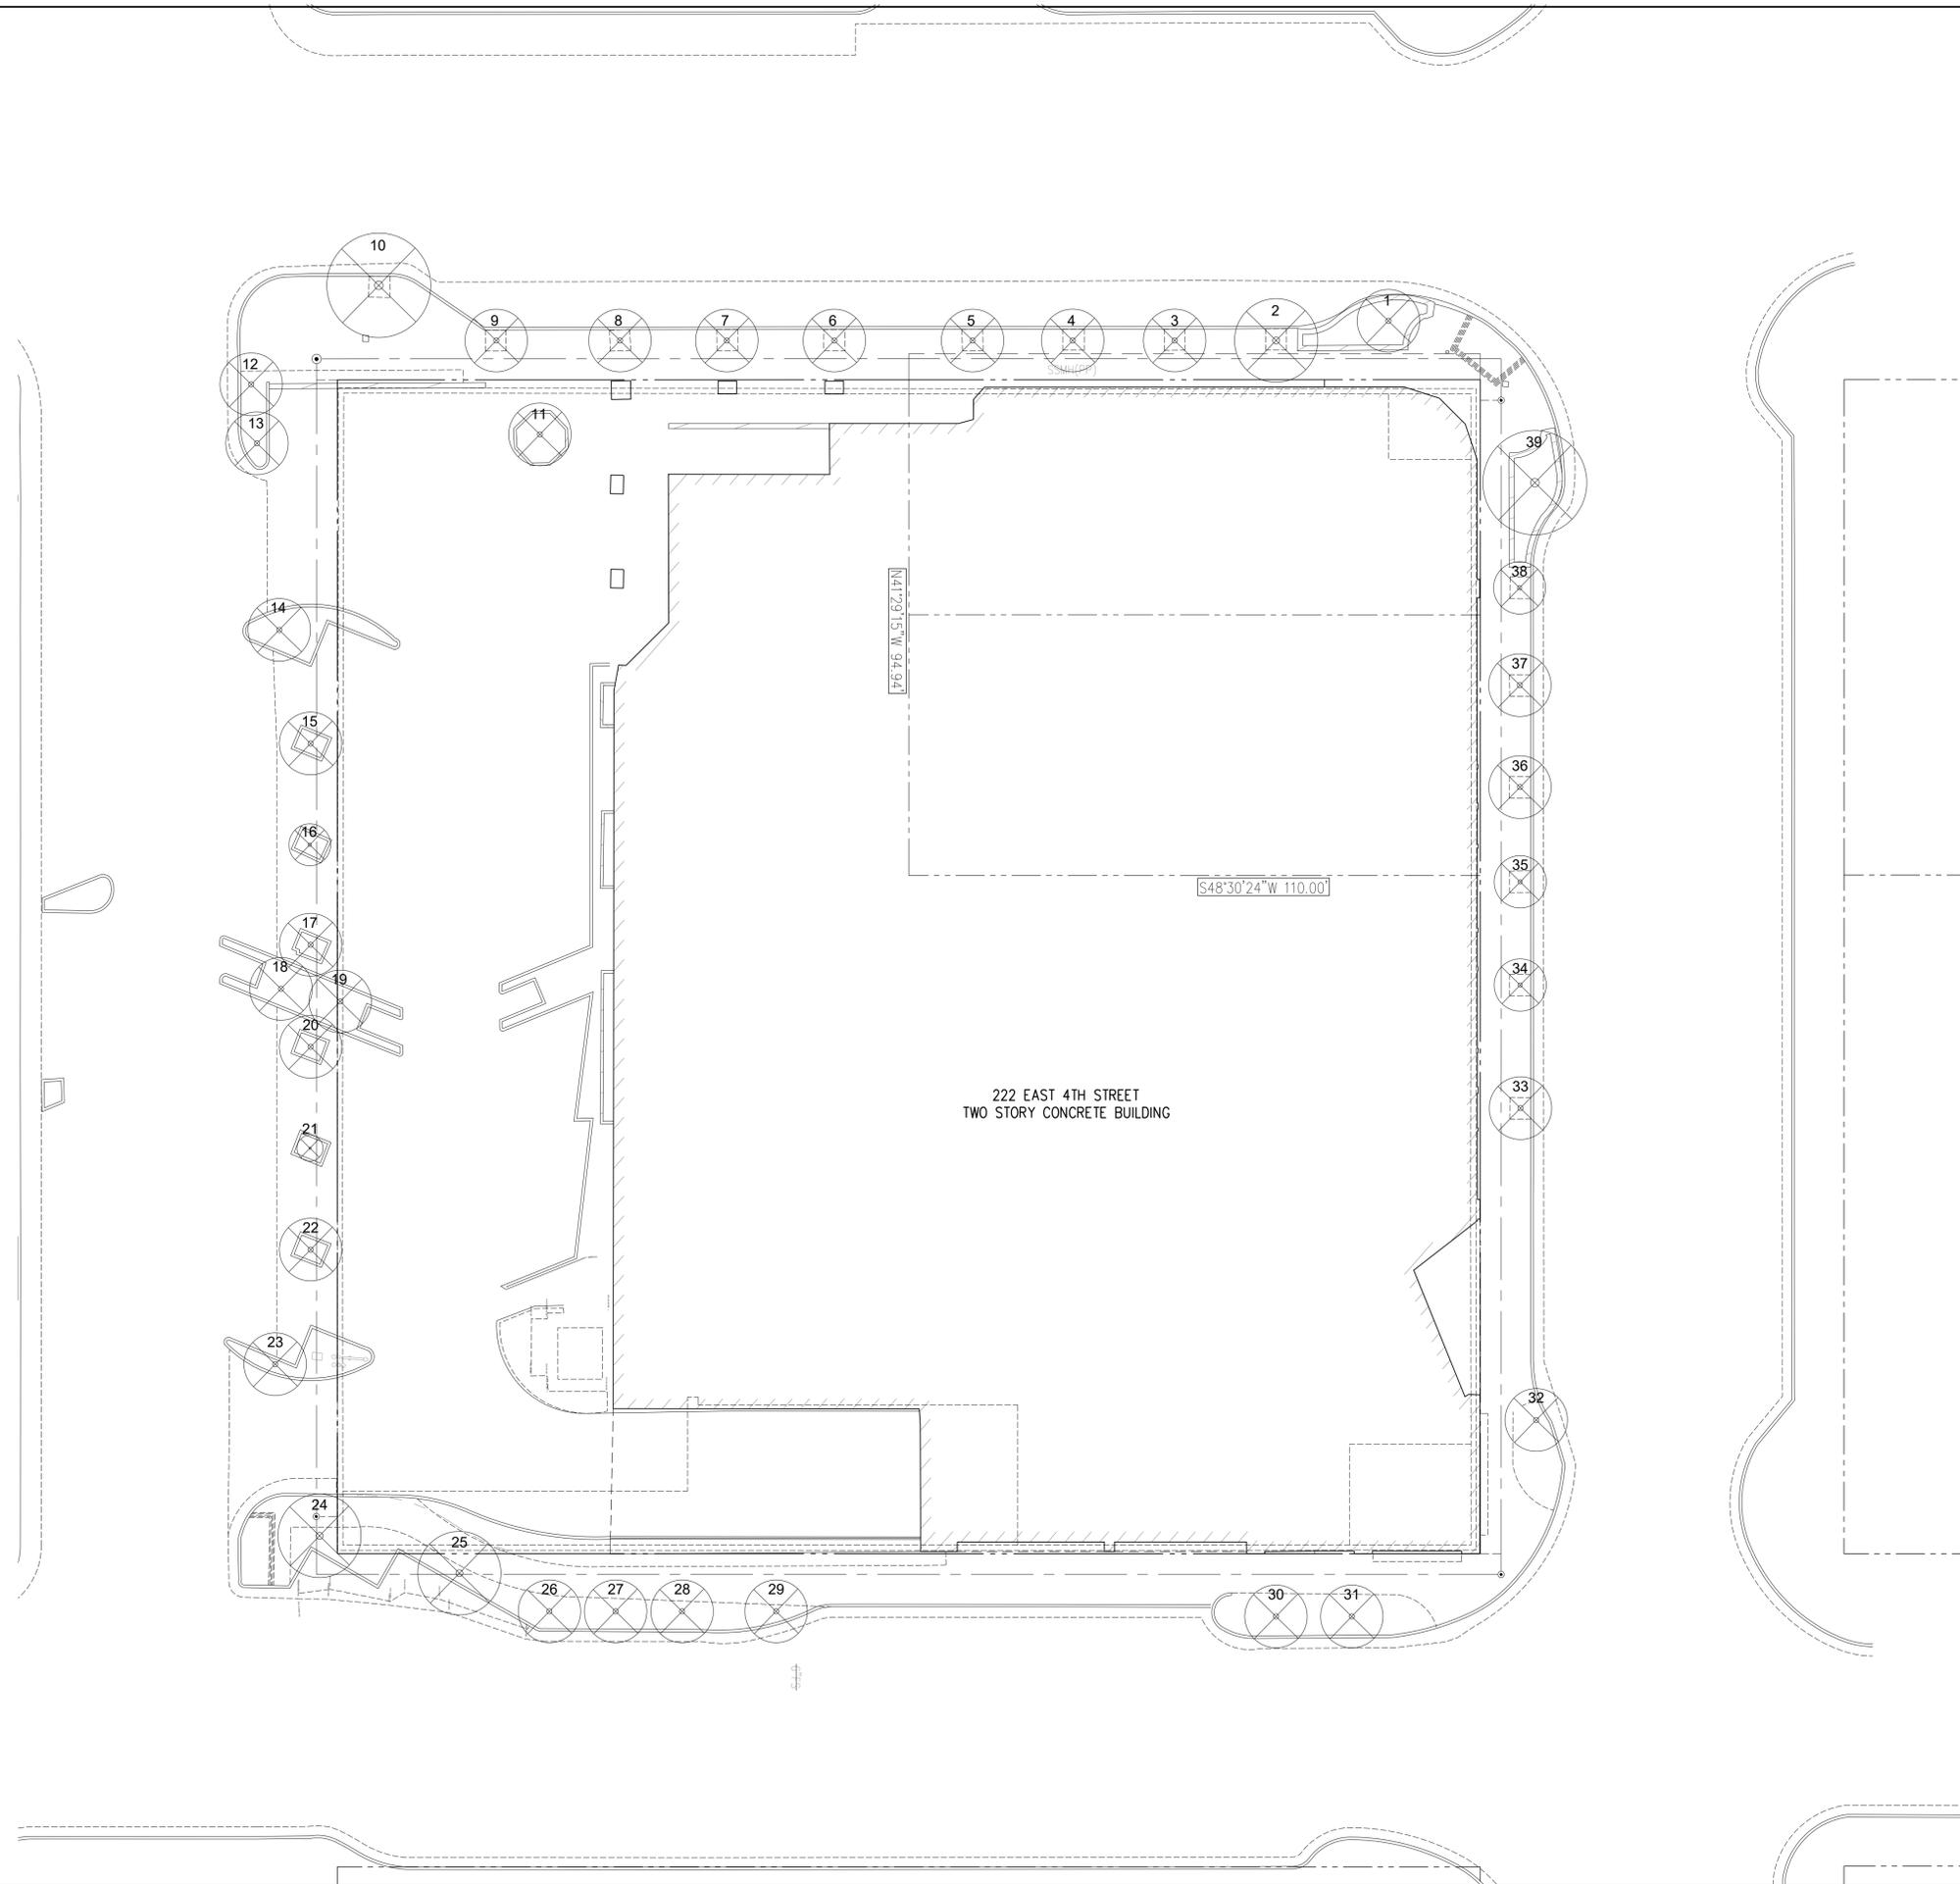

Tree Inventory, Assessment and Protection Report

222 E. 4th Street
San Mateo, CA

July 17, 2020
Revised October 20, 2021

Prepared for:

Lane Partners, LLC

Prepared By:

Richard Gessner
ASCA - Registered Consulting Arborist ® #496
ISA - Board Certified Master Arborist® WE-4341B



Monarch Consulting Arborists

Richard Gessner
P.O. Box 1010 - Felton, CA 95018
831.331.8982
www.monarcharborists.com

© Copyright Monarch Consulting Arborists LLC, 2021

Table of Contents

Summary.....1
Introduction.....1
Observations.....3
Analysis.....4
Discussion.....5
Conclusion.....7
Recommendations.....7
Bibliography.....7
Glossary of Terms.....8
Appendix A: Tree Inventory Locations.....9
Appendix B: Tree Inventory Table.....10
Appendix C: Photographs.....13
Qualifications, Assumptions, and Limiting Conditions.....17
Certification of Performance.....18

Summary

There are no "Heritage Trees" as defined by the ordinance and all the trees are "Street Trees" except one (#11). The inventory contains thirty-nine (39) trees comprised of four different species. There are five tulip poplar (*Liriodendron tulipifera*), eleven olives (*Olea eurpaea*), seventeen hackberry (*Celtis occidentalis*), and six Brisbane box (*Lophostemon confertus*). Most of the tree are in fair condition with thirteen good, one poor, two very poor, and the remaining twenty-three in fair shape and most have fair suitability for preservation except for the tulip poplars. All the trees will be highly impacted and are proposed to be removed. No tree protection is warranted. The average L/U Value was calculated to be 4.079.

Introduction

Background

Lane Partners, LLC asked me to assess the site, trees, and proposed footprint plan, and to provide a report with my findings and recommendations to help satisfy planning requirements.

Assignment

- Provide an arborist's report that includes an assessment of the trees within the project area and on the adjacent sites. The assessment is to include the species, size (trunk diameter), condition (health, structure, and form), and suitability for preservation ratings.
- Provide tree protection specifications, guidelines, and expected impact ratings for trees that may be affected by the project.
- Provide LU values according to the City of San Mateo ordinance 27.71.150.

Limits of the assignment

- The information in this report is limited to the condition of the trees and site during my inspection on July 15, 2020. No tree risk assessments were performed.
- Only the landscape plans were provided for this assignment.

Table 1: Plans Reviewed Checklist

Plan	Date	Sheet	Reviewed	Source	Notes
Existing Site Topographic Map or A.L.T.A with tree locations	June 2019		1 Yes	Kier + Wright	
Proposed Sit Plan			No		
Demolition Plan			No		
Construction Staging			No		
Grading and Drainage			No		
Utility Plan and Hook-up locations			No		
Exterior Elevations			No		
Landscape Plan	March 19, 2021	L-100, L-101, L-102	Yes	Andrea Cochrane Landscape Architect	
Irrigation Plan			No		
T-1 Tree Protection Plan			No		

Purpose and use of the report

The report is intended to identify all the trees within the plan area that could be affected by a project. The report is to be used by the property owners, owner's agents, and the City of San Mateo as a reference for existing tree and site conditions to help satisfy planning requirements.

Observations

Tree Inventory

The inventory contains all the trees six inches in diameter and greater measured at forty-eight inches above grade. The City of San Mateo ordinance 13.52.020 defines "Heritage Trees" as the following:

13.52.020 Definition

- A. Heritage tree is any of the following:
1. Any bay (*Umbellularia californica*), buckeye (*Aesculus spp.*), oak (*Quercus spp.*), cedar (*Cedrus spp.*) or redwood (*Sequoia sp.*) tree that has a diameter of ten (10) inches or more measured at forty-eight (48) inches above natural grade.
 2. Any tree or stand of trees designated by resolution of the City Council to be of special historical value or of significant community benefit.
 3. A stand of trees, the nature of which makes each dependent on the others for survival.
 4. Any other tree with a trunk diameter of sixteen (16) inches or more, measured at forty-eight (48) inches above natural grade.

There are no "Heritage Trees" as defined by the ordinance and all the trees are "Street Trees" except one in a container (#11). The trees are all located around the perimeter of the property on 4th, 5th, N. Ellsworth, and B streets.

The inventory contains thirty-nine (39) trees comprised of four different species. There are five tulip poplar (*Liriodendron tulipifera*), eleven olives (*Olea eurpaea*), seventeen hackberry (*Celtis occidentalis*), and six Brisbane box (*Lophostemon confertus*) (Appendix B).

The trees are arbitrarily numbered (no affixed number tags were used for this assignment) around the site counter clockwise starting at the corner of E. 4th Street and B Street (Appendix A).

Analysis

27.71.150 PRESERVATION OF EXISTING TREES.

Landscape Unit Value (LU)

1. The tree species, condition, and location values of the trees shall be based on an evaluation by an experienced landscape appraiser recognized by the American Society of Consulting Arborists utilizing the most recent Guide for Plant Appraisal, published by the Council of Tree and Landscape Appraisers; and approved by the Zoning Administrator.
2. Trees not within the allowable building area shall receive a location factor of 1.0 (100%). Trees located within the allowable building area shall receive a location factor of .70 (70%).
3. Trees designated as heritage trees shall receive a bonus percentage value of 1.25 (125%). Trees located within the allowable building area shall receive a location factor of .70 (70%).
4. Trees designated as heritage trees shall receive a bonus percentage value of 1.25 (125%).

All existing trees to be removed shall be given a LU value based upon the following calculation:

$$(\text{species value}\% \times \text{condition value}\% \times \text{location value}\%) / .35 \times (\text{caliper inches} \times \text{bldg./setback}\% \times \text{heritage tree}\%) = \text{LU}$$

Tree condition ratings and percentages are defined in the "Condition Rating" section of this report. The location rating were established at 63 percent (the average of site (90%), placement (50%), and contribution (50%).

The average L/U Value is 4.079 (Appendix B).



ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
TREE INVENTORY

SCALE
NA

SHEET NUMBER


Discussion

Condition Rating

A tree's condition is a determination of its overall health, structure, and form (ISA 2018). The assessment considered all three characteristics for a combined condition rating.

- 100% - Exceptional = Good health and structure with significant size, location or quality.
- 61-80% - Good = Normal vigor, well-developed structure, function and aesthetics not compromised with good longevity for the site.
- 41-60% - Fair = Reduced vigor, damage, dieback, or pest problems, at least one significant structural problem or multiple moderate defects requiring treatment. Major asymmetry or deviation from the species normal habit, function and aesthetics compromised.
- 21-40% - Poor = Unhealthy and declining appearance with poor vigor, abnormal foliar color, size or density with potential irreversible decline. One serious structural defect or multiple significant defects that cannot be corrected and failure may occur at any time. Significant asymmetry and compromised aesthetics and intended use.
- 6-20% - Very Poor = Poor vigor and dying with little foliage in irreversible decline. Severe defects with the likelihood of failure being probable or imminent. Aesthetically poor with little or no function in the landscape.
- 0-5% - Dead/Unstable = Dead or imminently ready to fail.

Most of the tree are in fair condition with thirteen good, one poor, two very poor, and the remaining twenty-three in fair shape.

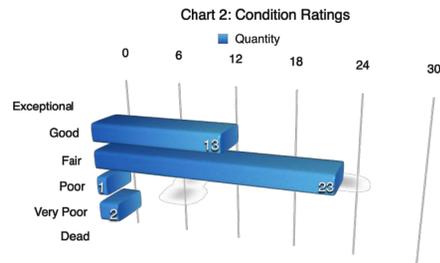

Glossary of Terms

Defect: An imperfection, weakness, or lack of something necessary. In trees defects are injuries, growth patterns, decay, or other conditions that reduce the tree's structural strength.

Diameter at breast height (DBH): Measures at 1.4 meters (4.5 feet) above ground in the United States, Australia (arboriculture), New Zealand, and when using the Guide for Plant Appraisal, 9th edition; at 1.3 meters (4.3 feet) above ground in Australia (forestry), Canada, the European Union, and in UK forestry; and at 1.5 meters (5 feet) above ground in UK arboriculture.

Drip Line: Imaginary line defined by the branch spread or a single plant or group of plants. The outer extent of the tree crown.

Mechanical damage: Physical damage caused by outside forces such as cutting, chopping or any mechanized device that may strike the tree trunk, roots or branches.

Scaffold branches: Permanent or structural branches that for the scaffold architecture or structure of a tree.

Straw wattle: also known as straw worms, bio-logs, straw noodles, or straw tubes are man made cylinders of compressed, weed free straw (wheat or rice), 8 to 12 inches in diameter and 20 to 25 feet long. They are encased in jute, nylon, or other photo degradable materials, and have an average weight of 35 pounds.

Tree Protection Zone (TPZ): Defined area within which certain activities are prohibited or restricted to prevent or minimize potential injury to designated trees, especially during construction or development.

Tree Risk Assessment: Process of evaluating what unexpected things could happen, how likely it is, and what the likely outcomes are. In tree management, the systematic process to determine the level of risk posed by a tree, tree part, or group of trees.

Trunk: Stem of a tree.

Volunteer: A tree, not planted by human hands, that begins to grow on residential or commercial property. Unlike trees that are brought in and installed on property, volunteer trees usually spring up on their own from seeds placed onto the ground by natural causes or accidental transport by people. Normally, volunteer trees are considered weeds and removed, but many desirable and attractive specimens have gone on to become permanent residents on many public and private grounds.

Suitability for Preservation

A tree's suitability for preservation is determined based on its condition (health, structure, form), age, species, tolerance to disturbance, external and functional limitations, and potential longevity for the site using a scale of good, fair, or poor. The following list defines the rating scale (Fite, K, and Smiley, E. T., 2016):

- Good = Trees with good health, structural stability and longevity after construction.
- Fair = Trees with fair health and/or structural defects that may be mitigated through treatment. These trees require more intense management and monitoring, before, during, and after construction, and may have shorter life expectancy after development.
- Poor = Trees are expected to decline during or after construction regardless of management. The species or individual may possess characteristics that are incompatible or undesirable in landscape settings or unsuited for the intended use of the site.

Most of the trees have fair suitability for preservation except for the tulip poplars. All the tulip poplars are poorly suited for retention due to pest problems and their condition. At least three olives are in raided planters with two at the corner of 4th and B and one just inside the property near the corner of 4th and N. Ellsworth. These trees have good suitability for retention or could successfully be relocated.


Expected Impact Level

Impact level defines how a tree may be affected by construction activity and proximity to the tree, and is described as low, moderate, or high. The following scale defines the impact rating:

- Low = The construction activity will have little influence on the tree.
- Moderate = The construction may cause future health or structural problems, and steps must be taken to protect the tree to reduce future problems.
- High = Tree structure and health will be compromised and removal is recommended, or other actions must be taken for the tree to remain. The tree is located in the building envelope.

All the trees will be highly impacted and are proposed for removal.

Appendix A: Tree Inventory Locations

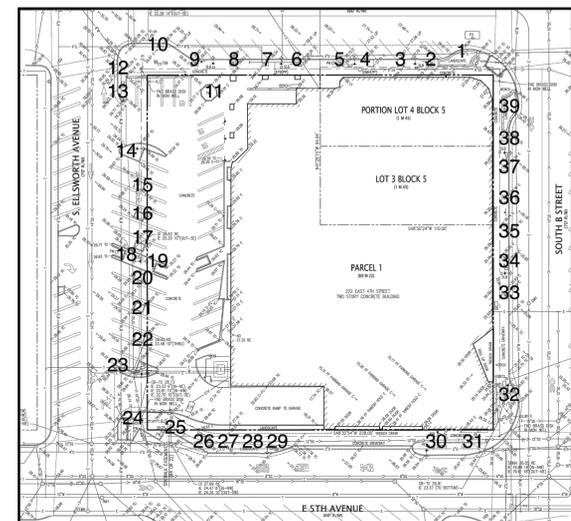

Conclusion

There are no "Heritage Trees" as defined by the ordinance and all the trees are "Street Trees" except one olive. The trees are all located around the perimeter of the property on 4th, 5th, N. Ellsworth, and B streets. The inventory contains thirty-nine (39) trees comprised of four different species. There are five tulip poplar (*Liriodendron tulipifera*), eleven olives (*Olea europaea*), seventeen hackberry (*Celtis occidentalis*), and six Brisbane box (*Lophostemon confertus*). Most of the tree are in fair condition with thirteen good, one poor, two very poor, and the remaining twenty-three in fair shape and most have fair suitability for preservation except for the tulip poplars. All the trees are expected to be highly impacted and removed. The average L/U Value was calculated to be 4.079.

Recommendations

1. Obtain all necessary permits prior to removing or significantly altering any trees on the property
2. All tree maintenance, care, and removals shall be performed by a qualified arborist with a C-61/D-49 California Contractors License. Tree maintenance and care shall be specified in writing according to American National Standard for Tree Care Operations: *Tree, Shrub and Other Woody Plant Management: Standard Practices* parts 1 through 10 and adhere to ANSI Z133.1 safety standards and local regulations. All maintenance is to be performed according to ISA Best Management Practices.

Bibliography

- American National Standard for Tree Care Operations: *Tree, Shrub and Other Woody Plant Management : Standard Practices* (Management of Trees and Shrubs During Site Planning, Site Development, and Construction)(Part 5). Londonderry, NH: Secretariat, Tree Care Industry Association, 2019. Print.
- Fite, Kelby, and Edgar Thomas, Smiley. *Managing trees during construction*, second edition. Champaign, IL: International Society of Arboriculture, 2016.
- ISA. *Guide For Plant Appraisal*. Savoy, IL: International Society Of Arboriculture, 2000. Print.
- ISA. *Species Classification and Group Assignment, 2004 Western Chapter Regional Supplement*. Western Chapter ISA


Appendix B: Tree Inventory Table

Table 2: Inventory Summary

Tree Species	#	Trunk Diameter (in.)	Condition	Expected Impact	Disposition	L/U Value
olive (<i>Olea europaea</i>)	1	4, 2, 2	Good	High	Container	2.4696
hackberry (<i>Celtis occidentalis</i>)	2	7	Fair	High	Street Tree	4.3218
hackberry (<i>Celtis occidentalis</i>)	3	9	Fair	High	Street Tree	5.5566
hackberry (<i>Celtis occidentalis</i>)	4	7	Fair	High	Street Tree	4.3218
hackberry (<i>Celtis occidentalis</i>)	5	6	Fair	High	Street Tree	3.7044
hackberry (<i>Celtis occidentalis</i>)	6	7	Fair	High	Street Tree	4.3218
hackberry (<i>Celtis occidentalis</i>)	7	5	Fair	High	Street Tree	3.087
hackberry (<i>Celtis occidentalis</i>)	8	8	Fair	High	Street Tree	4.9392
hackberry (<i>Celtis occidentalis</i>)	9	9	Fair	High	Street Tree	5.5566
hackberry (<i>Celtis occidentalis</i>)	10	11	Good	High	Street Tree	6.7914
olive (<i>Olea europaea</i>)	11	5, 4, 2, 2, 2, 2	Good	High	Container	3.087
olive (<i>Olea europaea</i>)	12	8, 7, 5, 4	Good	High	Street Tree	4.9392
olive (<i>Olea europaea</i>)	13	5, 5, 4, 4	Good	High	Street Tree	3.087
olive (<i>Olea europaea</i>)	14	5, 4, 3	Fair	High	Street Tree	3.087
tulip poplar (<i>Liriodendron tulipifera</i>)	15	7	Good	High	Street Tree	1.8522
hackberry (<i>Celtis occidentalis</i>)	16	1	Very Poor	High	Street Tree	0.6174



\$ 5 & + , 7 (& 7 6
. 2 5 7 + 6 8 1 6 (5 , + \$ * (<



ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
TREE INVENTORY

SCALE
NA

SHEET NUMBER

L-004

Tree Species	#	Trunk Diameter (in.)	Condition	Expected Impact	Disposition	L/U Value
tulip poplar (<i>Liriodendron tulipifera</i>)	17	7	Very Poor	High	Street Tree	1.8522
olive (<i>Olea europaea</i>)	18	3, 2, 2, 2, 2, 2	Fair	High	Street Tree	1.8522
olive (<i>Olea europaea</i>)	19	5, 2, 2, 2, 1	Fair	High	Street Tree	3.087
tulip poplar (<i>Liriodendron tulipifera</i>)	20	5, 4	Fair	High	Street Tree	1.323
tulip poplar (<i>Liriodendron tulipifera</i>)	21	1	Poor	High	Street Tree	0.1134
tulip poplar (<i>Liriodendron tulipifera</i>)	22	7	Good	High	Street Tree	1.8522
olive (<i>Olea europaea</i>)	23	7, 6, 5, 4	Good	High	Street Tree	4.3218
olive (<i>Olea europaea</i>)	24	8, 7, 5, 3, 3	Good	High	Street Tree	4.9392
Brisbane box (<i>Lophostemon confertus</i>)	25	12	Fair	High	Street Tree	6.804
Brisbane box (<i>Lophostemon confertus</i>)	26	12	Good	High	Street Tree	9.5256
olive (<i>Olea europaea</i>)	27	5, 3, 3, 3, 3, 3	Good	High	Street Tree	3.087
Brisbane box (<i>Lophostemon confertus</i>)	28	13	Good	High	Street Tree	10.3194
Brisbane box (<i>Lophostemon confertus</i>)	29	14	Fair	High	Street Tree	7.938
Brisbane box (<i>Lophostemon confertus</i>)	30	14	Fair	High	Street Tree	7.938

C2: N. Ellsworth Olives and Tulip Trees



Tree Species	#	Trunk Diameter (in.)	Condition	Expected Impact	Disposition	L/U Value
Brisbane box (<i>Lophostemon confertus</i>)	31	13	Fair	High	Street Tree	7.371
hackberry (<i>Celtis occidentalis</i>)	32	8	Fair	High	Street Tree	3.528
hackberry (<i>Celtis occidentalis</i>)	33	7	Fair	High	Street Tree	3.087
hackberry (<i>Celtis occidentalis</i>)	34	6	Fair	High	Street Tree	2.646
hackberry (<i>Celtis occidentalis</i>)	35	6	Fair	High	Street Tree	2.646
hackberry (<i>Celtis occidentalis</i>)	36	6	Fair	High	Street Tree	2.646
hackberry (<i>Celtis occidentalis</i>)	37	8	Fair	High	Street Tree	3.528
hackberry (<i>Celtis occidentalis</i>)	38	6	Fair	High	Street Tree	2.646
olive (<i>Olea europaea</i>)	39	7, 7, 6, 4, 2, 2	Good	High	Container	4.3218

C3: 5th Street Brisbane Box



**Appendix C: Photographs
C1: 4th Street Hackberries**



C4: B Street Hackberries



ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
TREE INVENTORY

SCALE
NA

SHEET NUMBER

L-005

Qualifications, Assumptions, and Limiting Conditions

Any legal description provided to the consultant is assumed to be correct. Any titles or ownership of properties are assumed to be good and marketable. All property is appraised or evaluated as though free and clear, under responsible ownership and competent management.

All property is presumed to be in conformance with applicable codes, ordinances, statutes, or other regulations.

Care has been taken to obtain information from reliable sources. However, the consultant cannot be responsible for the accuracy of information provided by others.

The consultant shall not be required to give testimony or attend meetings, hearings, conferences, mediations, arbitration, or trials by reason of this report unless subsequent contractual arrangements are made, including payment of an additional fee for such services.

This report and any appraisal value expressed herein represent the opinion of the consultant, and the consultant's fee is not contingent upon the reporting of a specified appraisal value, a stipulated result, or the occurrence of a subsequent event.

Sketches, drawings, and photographs in this report are intended for use as visual aids, are not necessarily to scale, and should not be construed as engineering or architectural reports or surveys. The reproduction of information generated by architects, engineers, or other consultants on any sketches, drawings, or photographs is only for coordination and ease of reference. Inclusion of said information with any drawings or other documents does not constitute a representation as to the sufficiency or accuracy of said information.

Unless otherwise expressed: a) this report covers only examined items and their condition at the time of inspection; and b) the inspection is limited to visual examination of accessible items without dissection, excavation, probing, or coring. There is no warranty or guarantee, expressed or implied, that structural problems or deficiencies of plants or property may not arise in the future.

Required Tree Planting

Zoning Code, Section 27.71 – Landscape, requires all projects to have a minimum ratio of **1 tree per 400 square feet** of landscaped area. Existing trees that are a minimum of 6 inch diameter may count toward this total.

Landscape Area: **6706.56** sq. ft. ÷ 400 = **16.77** (a)

Number of existing trees from Tree Evaluation Schedule with a 6 inch or greater diameter **to be preserved:** **0** (b)

Landscape Unit (LU) value of trees **to be removed** from the Tree Evaluation Schedule: **3.087** (c)

Minimum LU value to be replaced and/or met through payment of in-lieu fees: **[a - b + c = d]** **19.8957** (d)

New Trees:

A "landscape unit" (LU) value equivalent to (d) above, must either be planted on site, or an "in-lieu" fee paid to the city's street tree planting fund. If the LU value shown at (e) is not equal or greater than (d), then an in-lieu fee must be paid to the City's street tree planting fund at the rate defined annually in the City's Comprehensive Fee Schedule for each deficient LU.

New Trees Being Planted*			
Quantity	Size	LU Value	Total LU Value
	15 gallon	1	
	24 inch box	2	
	36 inch box	3	
4	48 inch box	4	16
Total LU Value of new trees being proposed:			16 (e)

*New replacement trees shall be in addition to and not substitute requirements for new street trees, parking lot trees or other required trees.

Fees Owed to the City Street Tree Planting Fund: **1252.7**

If (d) is greater than (e), there will be an LU value deficit calculated as follows:

[d - e = 3.86 x (the annually defined \$ per LU value as per Current Comprehensive Fee Schedule) = \$ **1252.7**

Certification of Performance

I Richard Gessner, Certify:

That I have personally inspected the tree(s) and/or the property referred to in this report, and have stated my findings accurately. The extent of the evaluation and/or appraisal is stated in the attached report and Terms of Assignment;

That I have no current or prospective interest in the vegetation or the property that is the subject of this report, and I have no personal interest or bias with respect to the parties involved;

That the analysis, opinions and conclusions stated herein are my own;

That my analysis, opinions, and conclusions were developed and this report has been prepared according to commonly accepted Arboricultural practices;

That no one provided significant professional assistance to the consultant, except as indicated within the report.

That my compensation is not contingent upon the reporting of a predetermined conclusion that favors the cause of the client or any other party, nor upon the results of the assessment, the attainment of stipulated results, or the occurrence of any other subsequent events;

I further certify that I am a Registered Consulting Arborist® with the American Society of Consulting Arborists, and that I acknowledge, accept and adhere to the ASCA Standards of Professional Practice. I am an International Society of Arboriculture Board Certified Master Arborist® and Tree Risk Assessor Qualified. I have been involved with the practice of Arboriculture and the care and study of trees since 1998.

Richard J. Gessner

ASCA Registered Consulting Arborist® #496
ISA Board Certified Master Arborist® WE-4341B



Copyright

© Copyright 2021, Monarch Consulting Arborists LLC. Other than specific exception granted for copies made by the client for the express uses stated in this report, no parts of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, recording, or otherwise without the express, written permission of the author.

Tree Number	Species	Fate: Preserve / Remove	Species Value %	Condition Value %	Location Value %	Divided by 0.35	Caliper Size (in.)	.7 if in allowable bldg. area 1 if in setback	1.25 if Heritage Tree 1 if not	LU Value
1	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	4	0.7	1	2.4696
2	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	7	0.7	1	4.3218
3	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	9	0.7	1	5.5666
4	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	7	0.7	1	4.3218
5	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	6	0.7	1	3.7044
6	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	7	0.7	1	4.3218
7	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	5	0.7	1	3.087
8	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	8	0.7	1	4.9392
9	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	9	0.7	1	5.5666
10	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	11	0.7	1	6.7914
11	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	5	0.7	1	3.087
12	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	8	0.7	1	4.9392
13	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	5	0.7	1	3.087
14	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	5	0.7	1	3.087
15	tulip poplar (Liriodendron tulipifera)	Remove	0.3	0.7	0.63	0.38	7	0.7	1	1.8522
16	hackberry (Celtis occidentalis)	Remove	0.7	0.7	0.63	0.88	1	0.7	1	0.6174
17	tulip poplar (Liriodendron tulipifera)	Remove	0.3	0.7	0.63	0.38	7	0.7	1	1.8522
18	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	3	0.7	1	1.8522
19	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	5	0.7	1	3.087
20	tulip poplar (Liriodendron tulipifera)	Remove	0.3	0.7	0.63	0.38	5	0.7	1	1.323
21	tulip poplar (Liriodendron tulipifera)	Remove	0.3	0.3	0.63	0.16	1	0.7	1	0.1134
22	tulip poplar (Liriodendron tulipifera)	Remove	0.3	0.7	0.63	0.38	7	0.7	1	1.8522
23	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	7	0.7	1	4.3218
24	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	8	0.7	1	4.9392
25	Brisbane box (Lophostemon confertus)	Remove	0.9	0.5	0.63	0.81	12	0.7	1	6.804
26	Brisbane box (Lophostemon confertus)	Remove	0.9	0.7	0.63	1.13	12	0.7	1	9.5256
27	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	5	0.7	1	3.087
28	Brisbane box (Lophostemon confertus)	Remove	0.9	0.7	0.63	1.13	13	0.7	1	10.3194
29	Brisbane box (Lophostemon confertus)	Remove	0.9	0.5	0.63	0.81	14	0.7	1	7.938
30	Brisbane box (Lophostemon confertus)	Remove	0.9	0.5	0.63	0.81	14	0.7	1	7.938
31	Brisbane box (Lophostemon confertus)	Remove	0.9	0.5	0.63	0.81	13	0.7	1	7.371
32	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	8	0.7	1	3.528
33	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	7	0.7	1	3.087
34	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	6	0.7	1	2.646
35	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	6	0.7	1	2.646
36	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	6	0.7	1	2.646
37	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	8	0.7	1	3.528
38	hackberry (Celtis occidentalis)	Remove	0.7	0.5	0.63	0.63	6	0.7	1	2.646
39	olive (Olea europaea)	Remove	0.7	0.7	0.63	0.88	7	0.7	1	4.3218
TOTAL										159.1128



ARCHITECTS
KORTH SUNSERI HAGEY

AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
TREE INVENTORY

SCALE
NA

SHEET NUMBER

L-006



ARCHITECTS
KORTH SUNSERI HAGEY

AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LEVEL 1 LANDSCAPE PLAN

SCALE
1/16"=1'-0"


SHEET NUMBER

L-100

TREES	CODE	BOTANICAL NAME	COMMON NAME	CONT	QTY	REMARKS
○	Os	OLEA EUROPAEA 'SWAN HILL' TM	SWAN HILL OLIVE	---	4	
○	Qh	QUERCUS HYPOLEUCOIDES	SILVERLEAF OAK	---	10	
○	Qs	QUERCUS VIRGINIANA 'SKY CLIMBER'	SKY CLIMBER SOUTHERN LIVE OAK	---	23	

REFERENCE NOTES SCHEDULE			
0 GENERAL			
SYMBOL	DESCRIPTION	SOURCE	
[0-01]	CURB CUT, S.C.D.		
2 PAVING + EDGES			
SYMBOL	DESCRIPTION	NOTES	SOURCE
[2-01]	CONC. PAVING	C.I.P. INTEGRAL COLOR CONC. PAVING	
[2-02]	CONC. UNIT PAVING TYPE I	3"x12" PRECAST CONC. PAVERS - COLOR: PORCELAIN	STEPSTONE, INC
[2-03]	CONC. UNIT PAVING TYPE II	3"x12" PRECAST CONC. PAVERS - COLOR: FRENCH GREY	STEPSTONE, INC
3 SITE WALLS AND STAIRS			
SYMBOL	DESCRIPTION	NOTES	SOURCE
[3-01]	RAISED METAL PLANTER	CUSTOM POWDERCOATED PLANTERS - COLOR: CHARCOAL	STREETLIFE, LLC
5 SITE FURNISHINGS			
SYMBOL	DESCRIPTION	NOTES	SOURCE
[5-01]	WOOD BENCH TYPE I	7'-8" WOOD BENCH WITH ARMREST, GALV. BASES	STREETLIFE, LLC
[5-02]	WOOD BENCH TYPE II	9'-10" WOOD BENCH WITH ARMRESTS, GALV. STEEL BASES	STREETLIFE, LLC
[5-03]	WOOD BENCH TYPE III	23"x23" WOOD CUBE BENCH, GALV. STEEL BASE	STREETLIFE, LLC
[5-04]	WOOD BENCH TYPE IV	CUSTOM WOOD BENCH WITH ARMRESTS AT RAISED METAL PLANTERS	STREETLIFE, LLC
[5-05]	WOOD BENCH TYPE V	WOOD BENCH AT TREE GRATE, STEEL BASES TO MATCH GRATES	STREETLIFE, LLC
[5-06]	WOOD DINING TABLE	WOOD TABLE AND BECH WITH ARMREST, GALV. STEEL BASES	STREETLIFE, LLC
[5-07]	BIKE RACK	WELLE CIRCULAR RACK - STAINLESS FINISH	PALMER GROUP, LLC
[5-08]	TREE GRATE	POWDERCOATED STEEL TREE GRATE	STREETLIFE, LLC
[5-11]	MOVABLE SITE FURNISHING	TBD FF&E BY OTHERS, SHOWN FOR REFERENCE	
7 PLANTING			
SYMBOL	DESCRIPTION		
[7-01]	NATIVE OR ADAPTED PLANTING		
[7-02]	BIOTREATMENT PLANTING		
8 SITE LIGHTING			
SYMBOL	DESCRIPTION	DESCRIPTION	
[8-01]	SITE LIGHTING	SEE LIGHTING DRAWINGS	

NOTES:
1. SEE L-205 FOR MATERIALS AND FURNISHINGS IMAGES
2. SEE L-300 FOR FURNISHING DETAILS

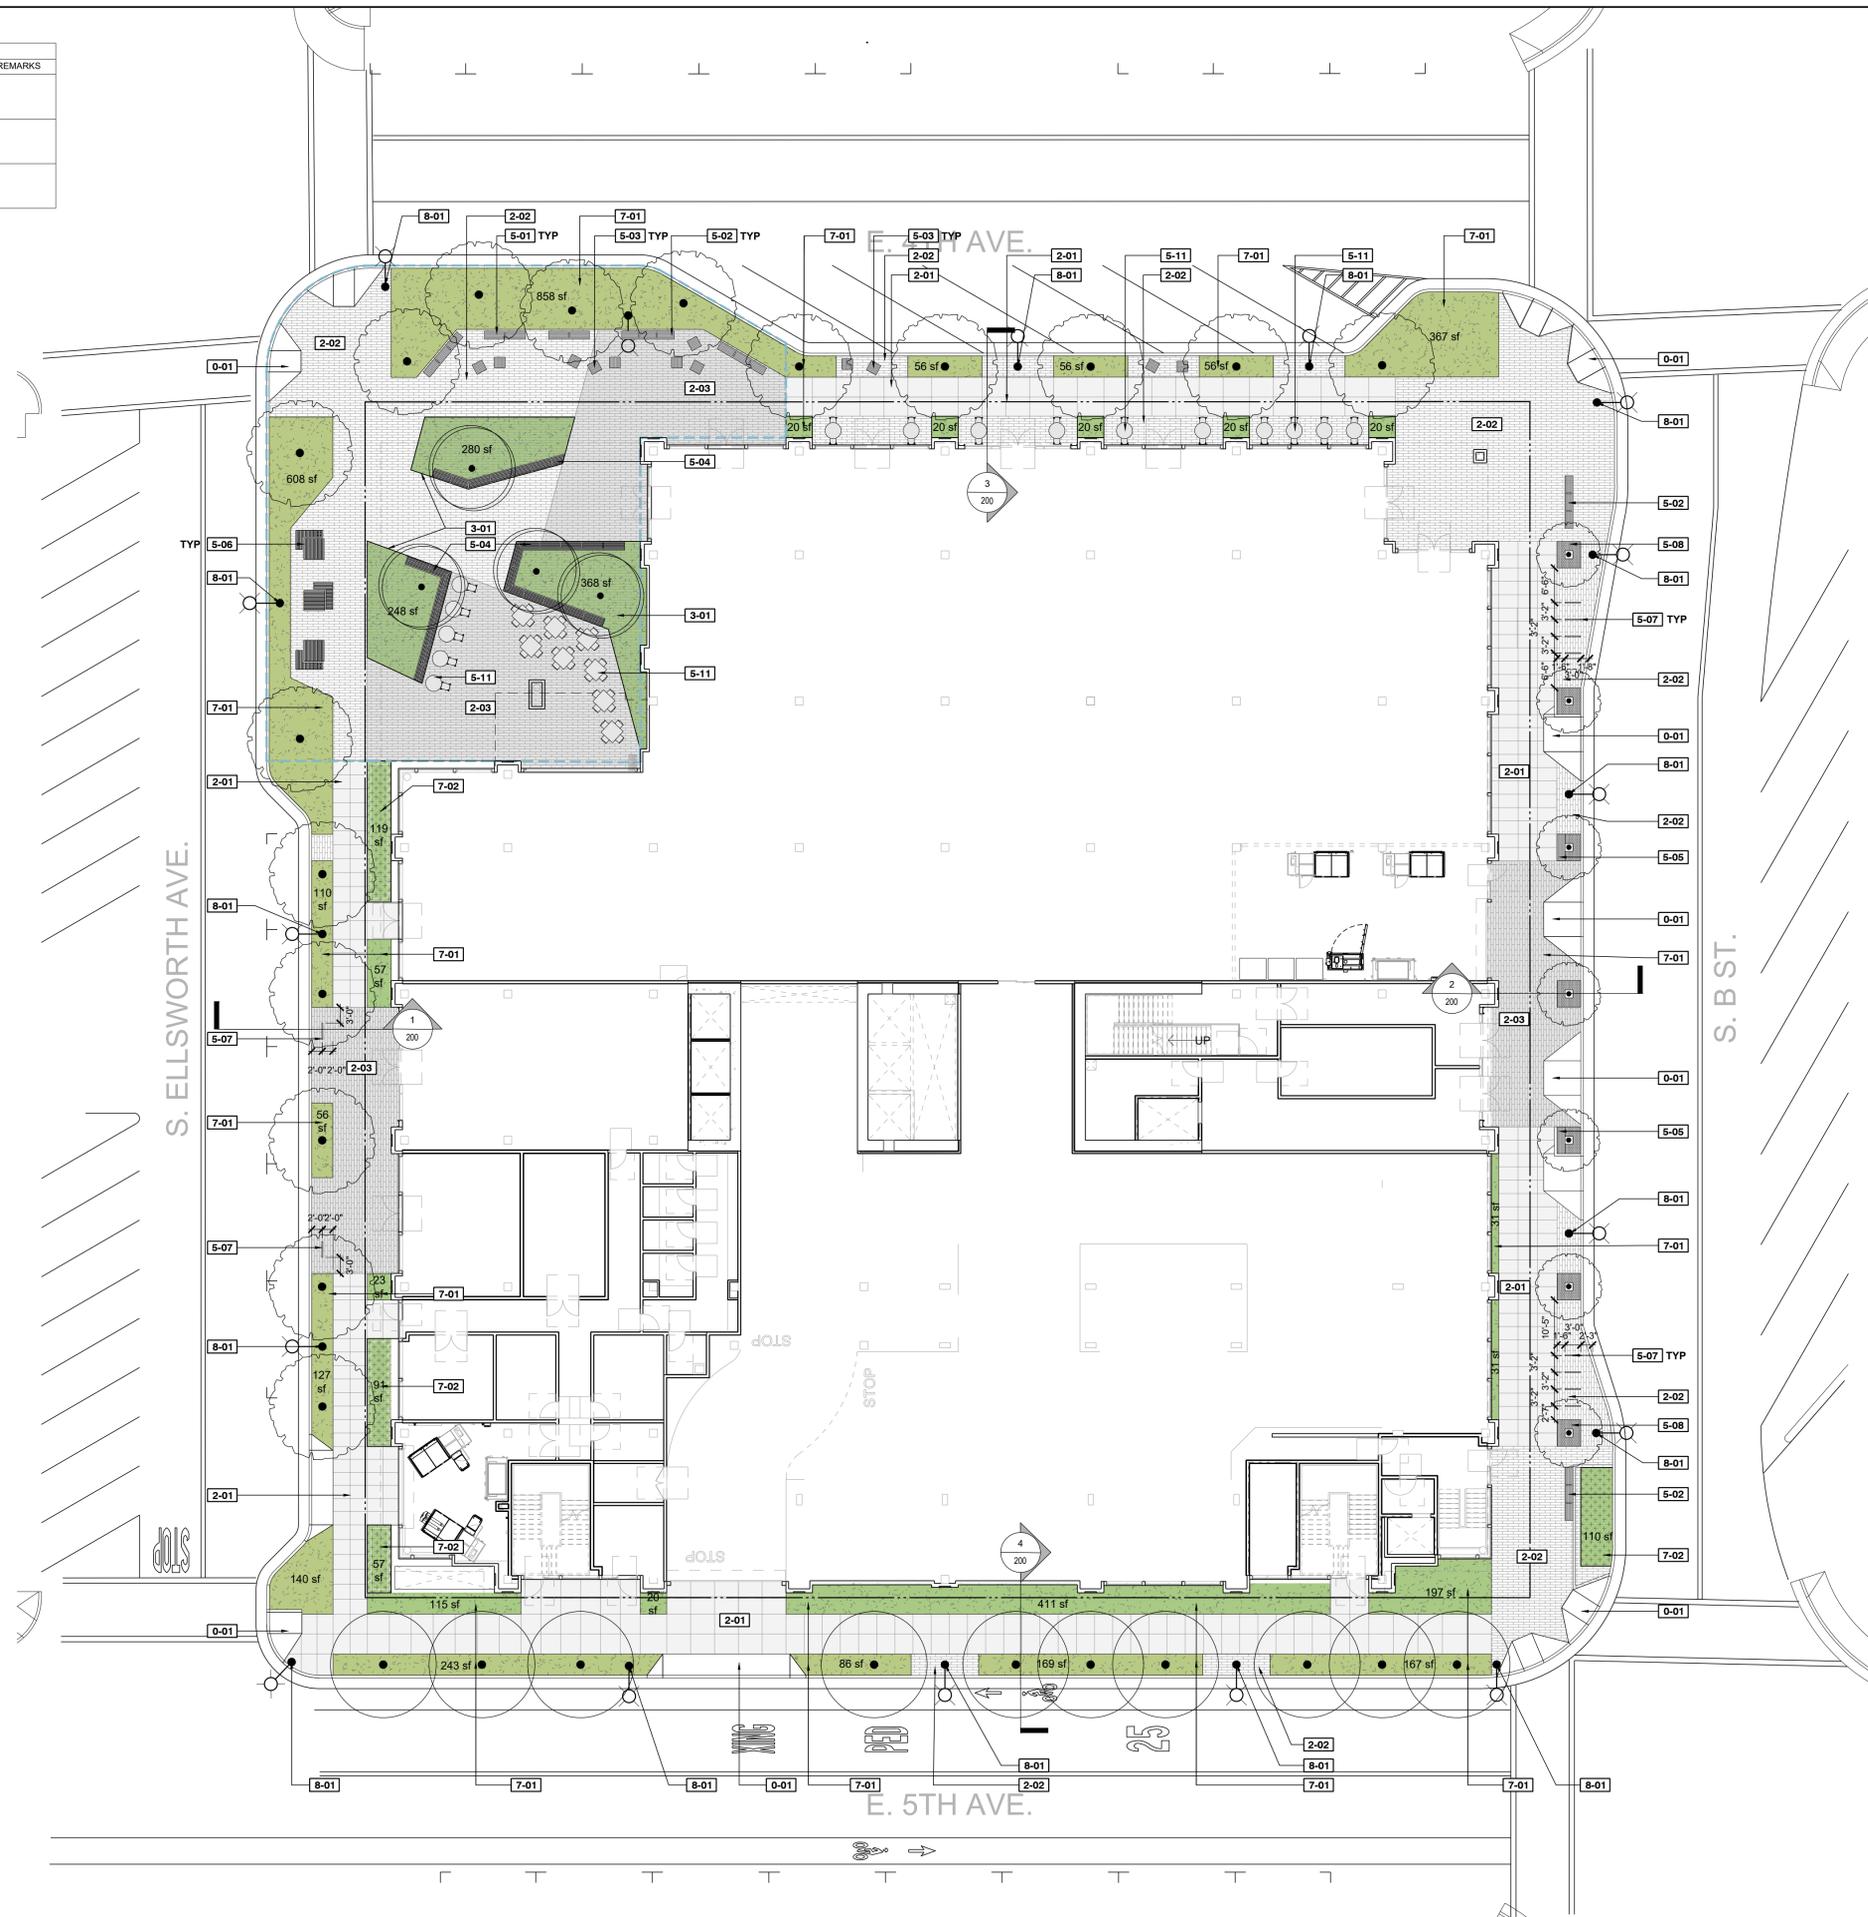



ARCHITECTS
KORTH SUNSERI HAGEY

AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
LEVEL 3 LANDSCAPE PLAN

SCALE
1/16"=1'-0"


SHEET NUMBER

L-101

REFERENCE NOTES SCHEDULE			
2 PAVING + EDGES			
SYMBOL	DESCRIPTION	NOTES	SOURCE
2-04	PEDESTAL PAVING TYPE I	18"x36" PRECAST CONC. PAVERS - COLOR: FRENCH GREY	STEPSTONE, INC.
2-05	PEDESTAL PAVING TYPE II	18"x36" PRECAST CONC. PAVERS - COLOR: PORCELAIN	STEPSTONE, INC.
2-07	PEDESTAL PAVING TYPE IV	24"x48" THERMALLY MODIFIED ASH DECKING TILES	THERMORY
2-08	ACCESS GRATING	STAINLESS STEEL PRESSED GRATING	
5 SITE FURNISHINGS			
SYMBOL	DESCRIPTION	NOTES	SOURCE
5-01	WOOD BENCH TYPE I	7'-8" WOOD BENCH WITH ARMREST, GALV. BASES	STREETLIFE, LLC
5-11	MOVABLE SITE FURNISHING	TBD FF&E BY OTHERS, SHOWN FOR REFERENCE	
7 PLANTING			
SYMBOL	DESCRIPTION	NOTES	SOURCE
7-01	NATIVE OR ADAPTED PLANTING		

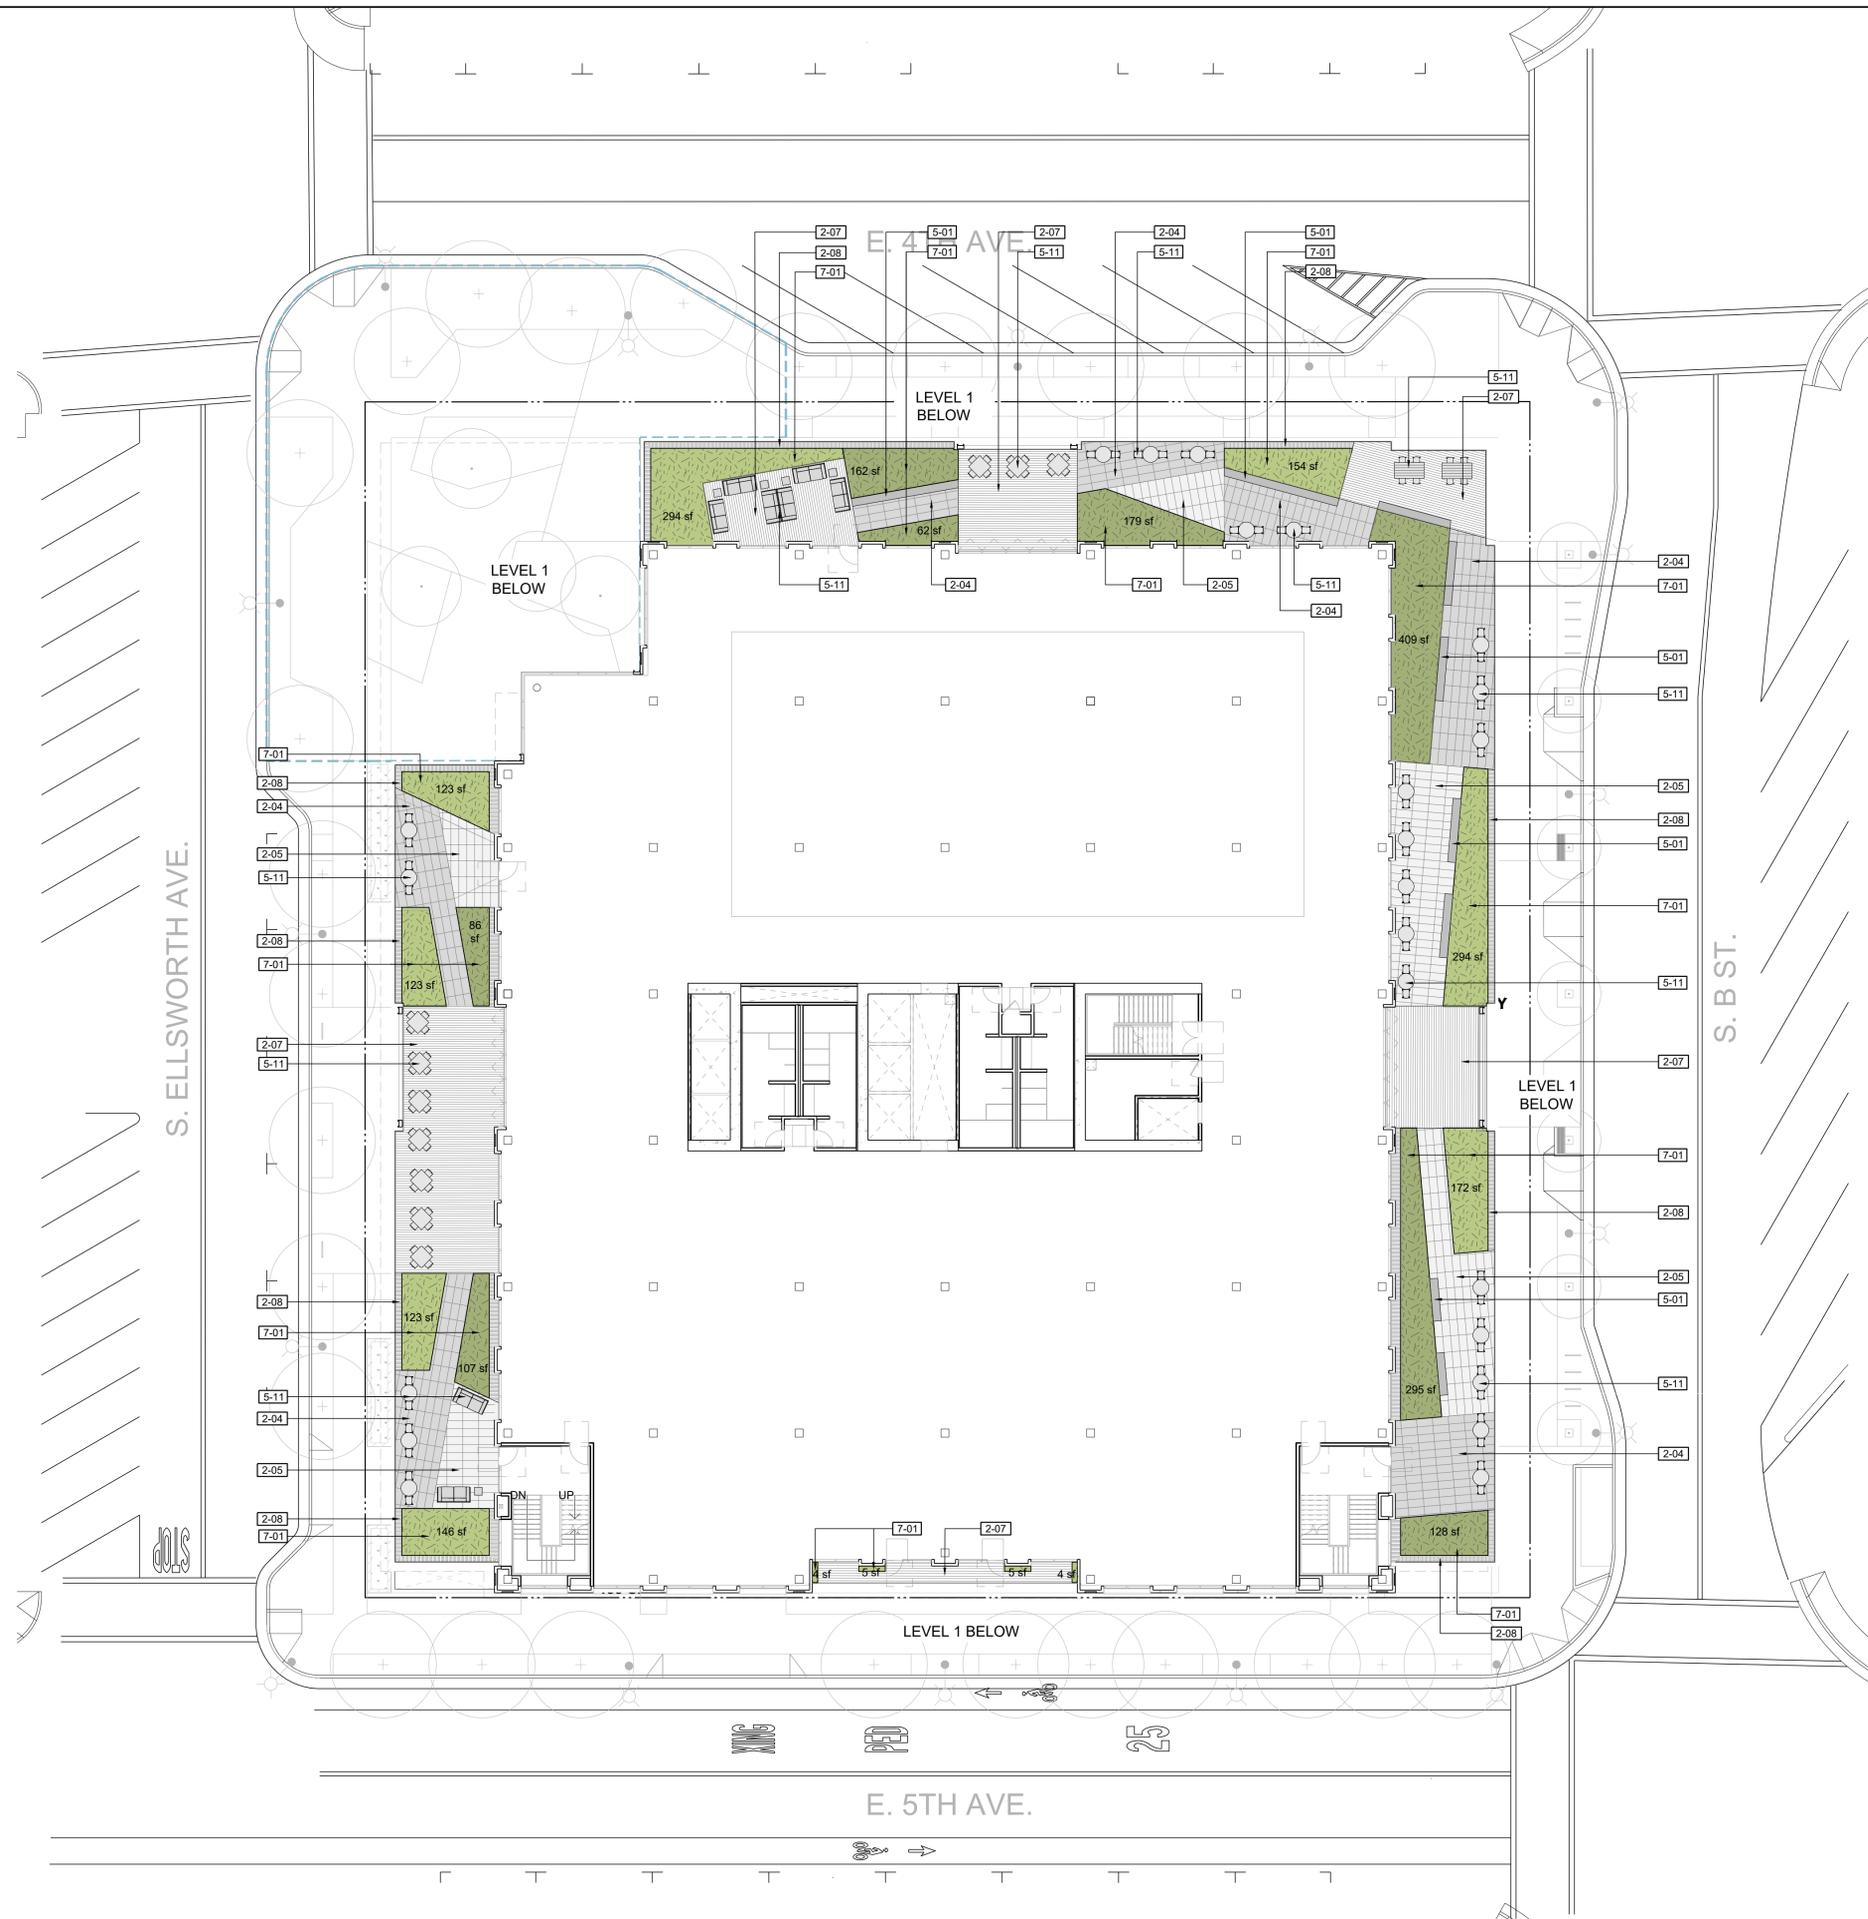

REFERENCE NOTES SCHEDULE			
SYMBOL	DESCRIPTION	NOTES	SOURCE
2	PAVING + EDGES		
2-07	PEDESTAL PAVING TYPE IV	24"x48" THERMALLY MODIFIED ASH DECKING TILES	THERMORY

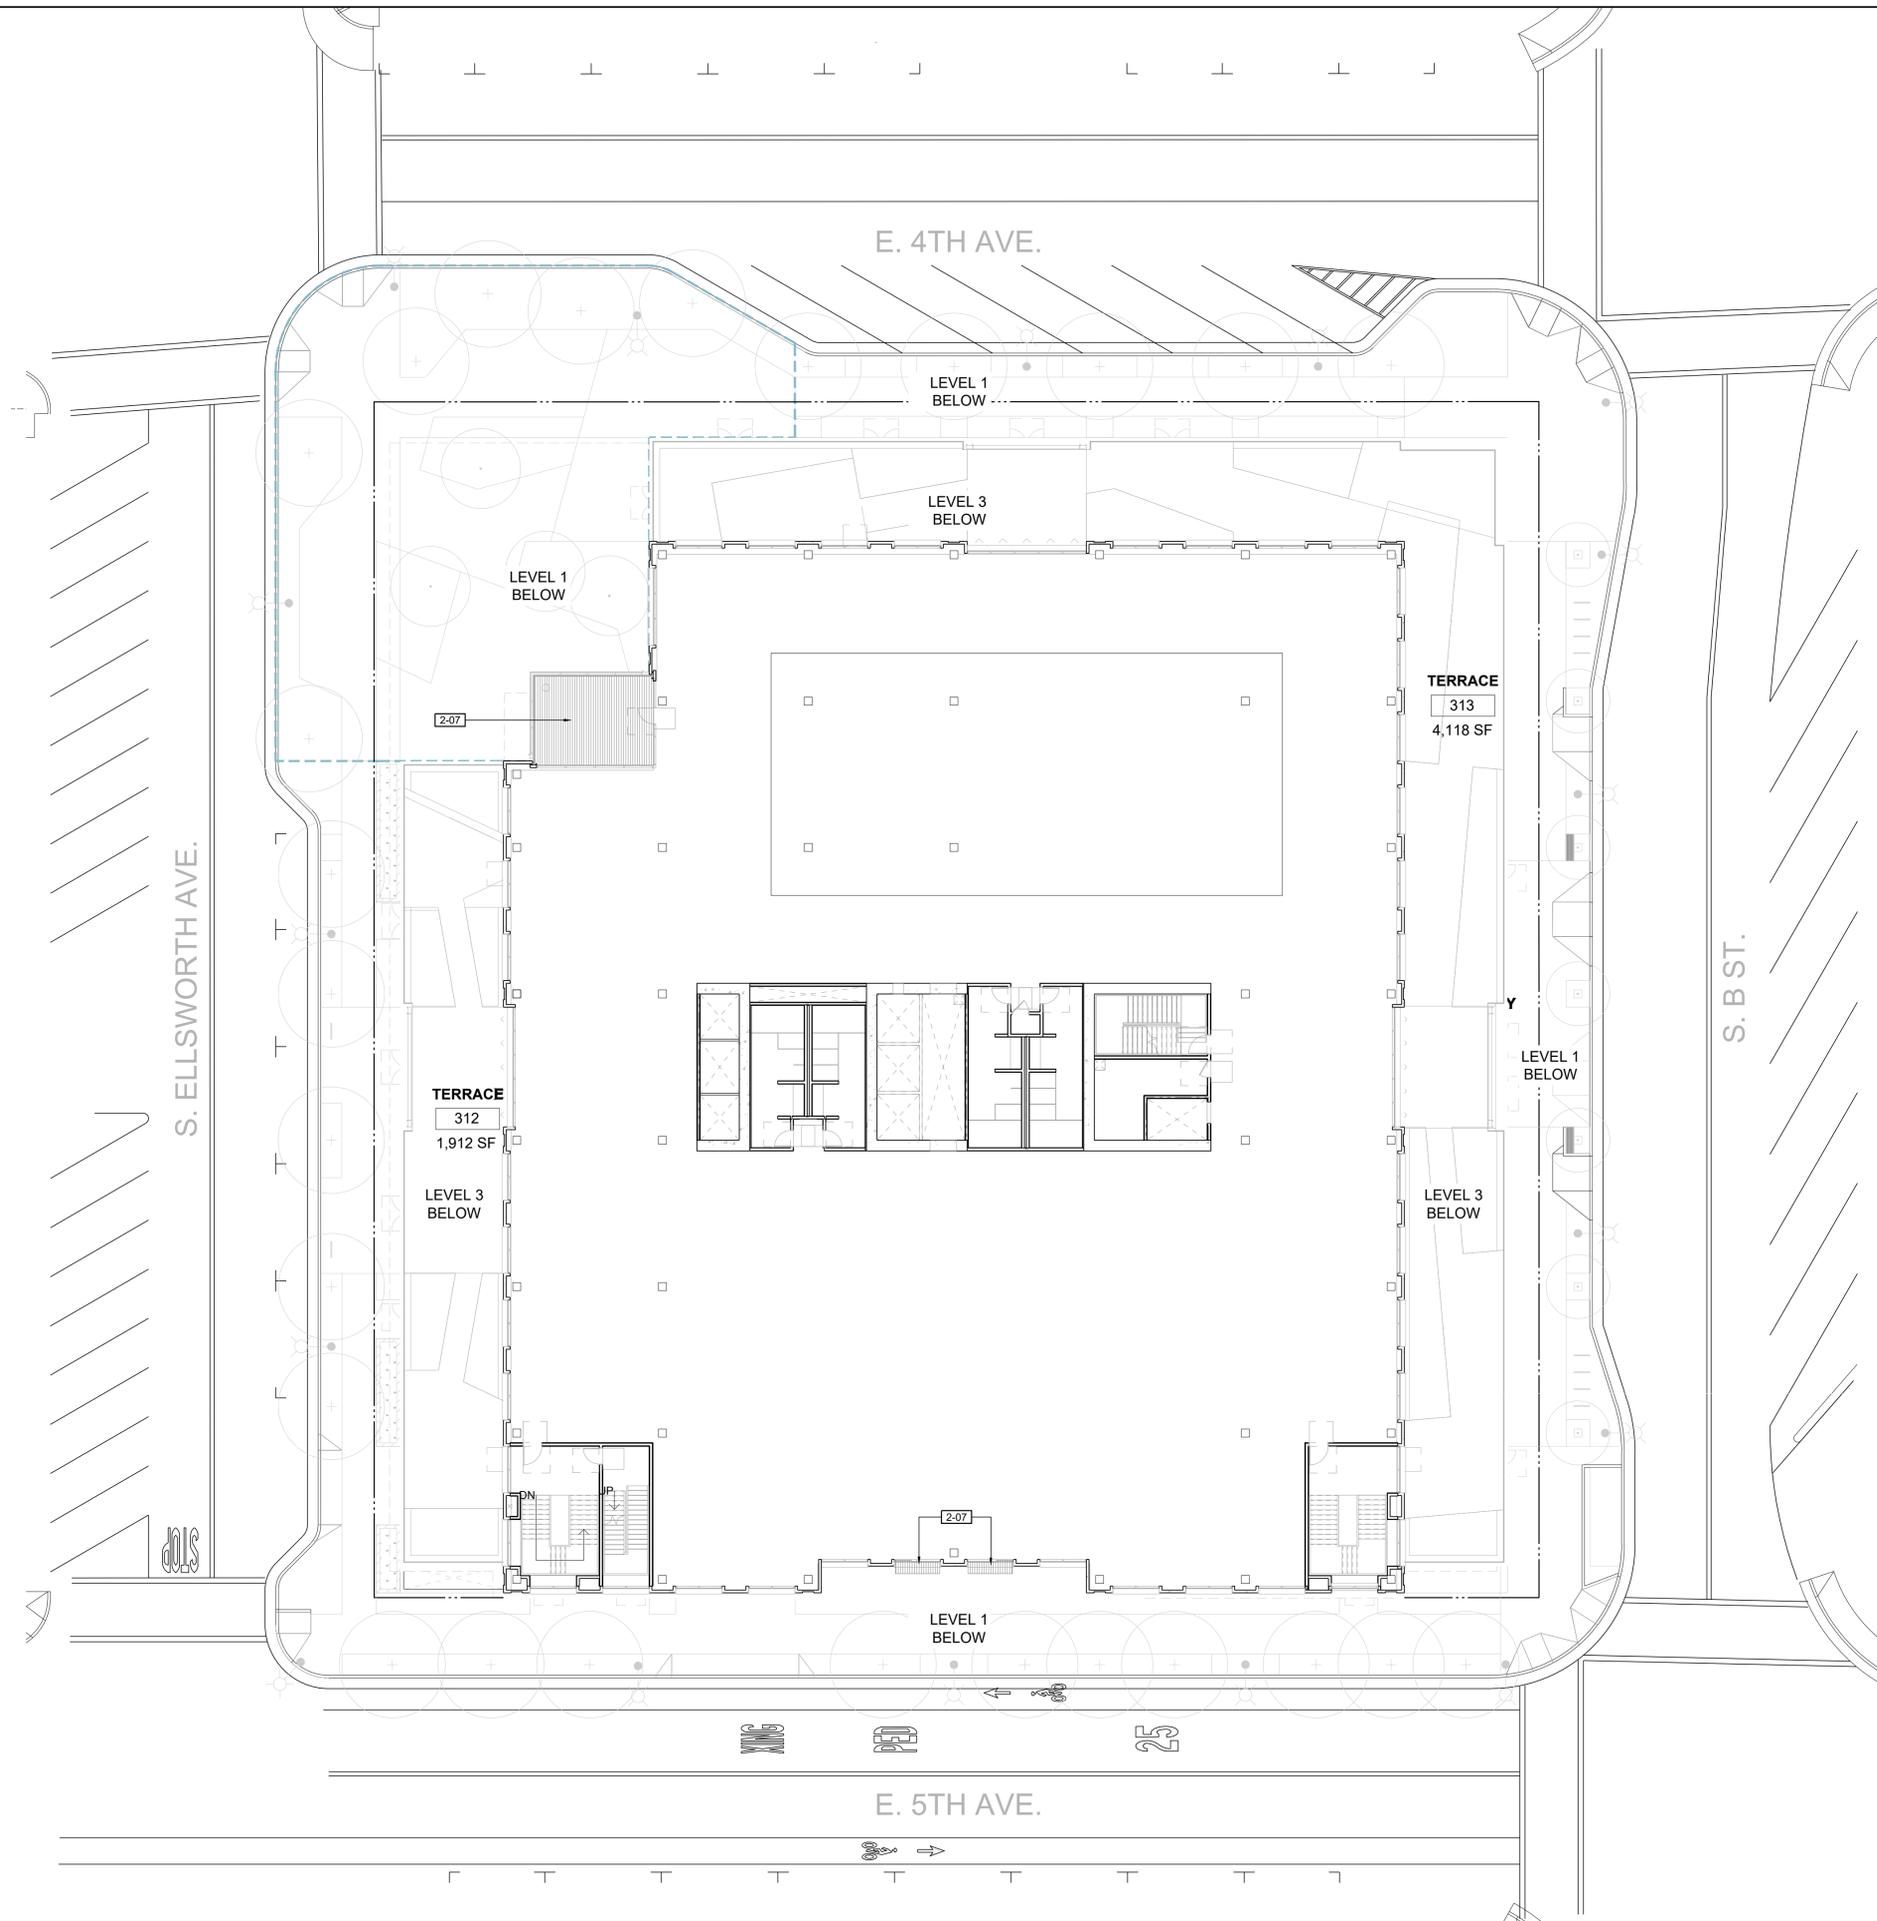

222 EAST 4TH
LANE PARTNERS



AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LEVEL 4 LANDSCAPE PLAN

SCALE
1/16"=1'-0"

SHEET NUMBER

L-102



ARCHITECTS
KORTH SUNSERI HAGEY

AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
ROOF LANDSCAPE PLAN

SCALE
1/16"=1'-0"

SHEET NUMBER

L-103

REFERENCE NOTES SCHEDULE			
2 PAVING + EDGES			
SYMB OL	DESCRIPTION	NOTES	SOURCE
2-04	PEDESTAL PAVING TYPE I	18"x36" PRECAST CONC. PAVERS - COLOR: FRENCH GREY	STEPSTONE, INC.
2-05	PEDESTAL PAVING TYPE II	18"x36" PRECAST CONC. PAVERS - COLOR: PORCELAIN	STEPSTONE, INC.
2-06	PEDESTAL PAVING TYPE III	30"x30" PRECAST CONC. PAVERS - COLOR: PORCELAIN	STEPSTONE, INC.
2-07	PEDESTAL PAVING TYPE IV	24"x48" THERMALLY MODIFIED ASH DECKING TILES	THERMORY
2-08	ACCESS GRATING	STAINLESS STEEL PRESSED GRATING	
3 SITE WALLS AND STAIRS			
SYMB OL	DESCRIPTION	NOTES	SOURCE
3-01	RAISED METAL PLANTER	CUSTOM POWDERCOATED PLANTERS - COLOR: CHARCOAL	STREETLIFE, LLC
5 SITE FURNISHINGS			
SYMB OL	DESCRIPTION	NOTES	SOURCE
5-01	WOOD BENCH TYPE I	7'-8" WOOD BENCH WITH ARMREST, GALV. BASES	STREETLIFE, LLC
5-09	BBQ	CUSTOM BBQ AREA	
5-10	SCREEN	SEE ARCH DRAWINGS	
5-11	MOVABLE SITE FURNISHING	TBD FF&E BY OTHERS, SHOWN FOR REFERENCE	





ARCHITECTS
KORTH SUNSERI HAGEY

AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
STREETSCAPE SECTIONS


SCALE
AS NOTED

SHEET NUMBER


L-200

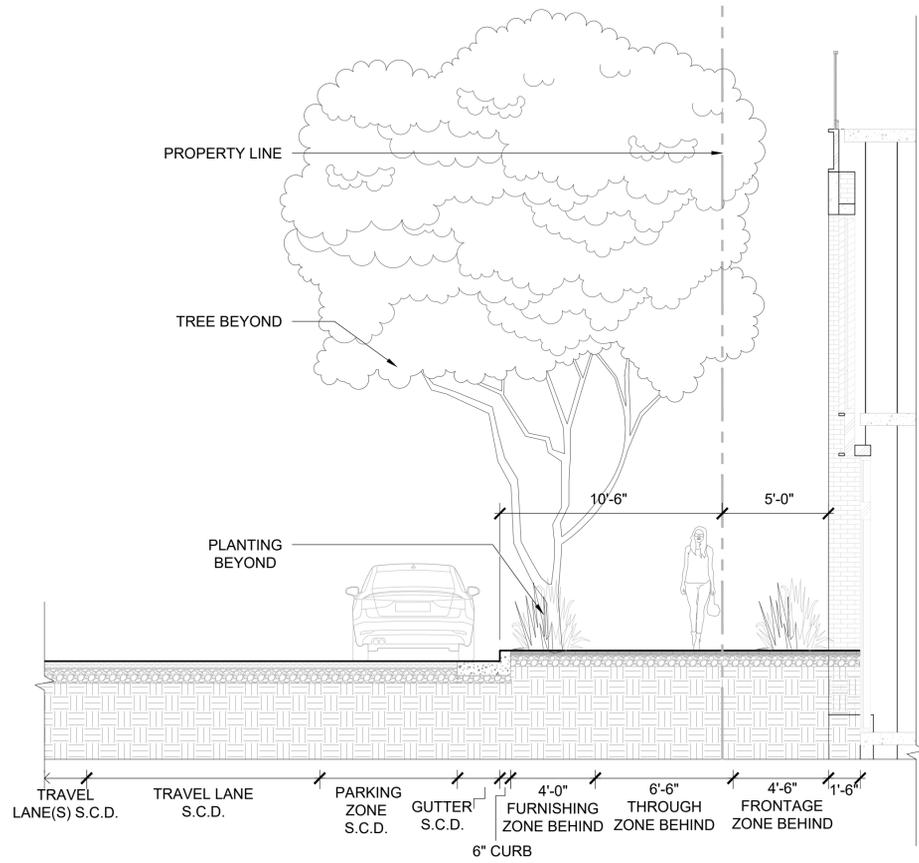


1 ELLSWORTH AVENUE
SCALE: 1/4" = 1'-0"
TYPICAL SECTION

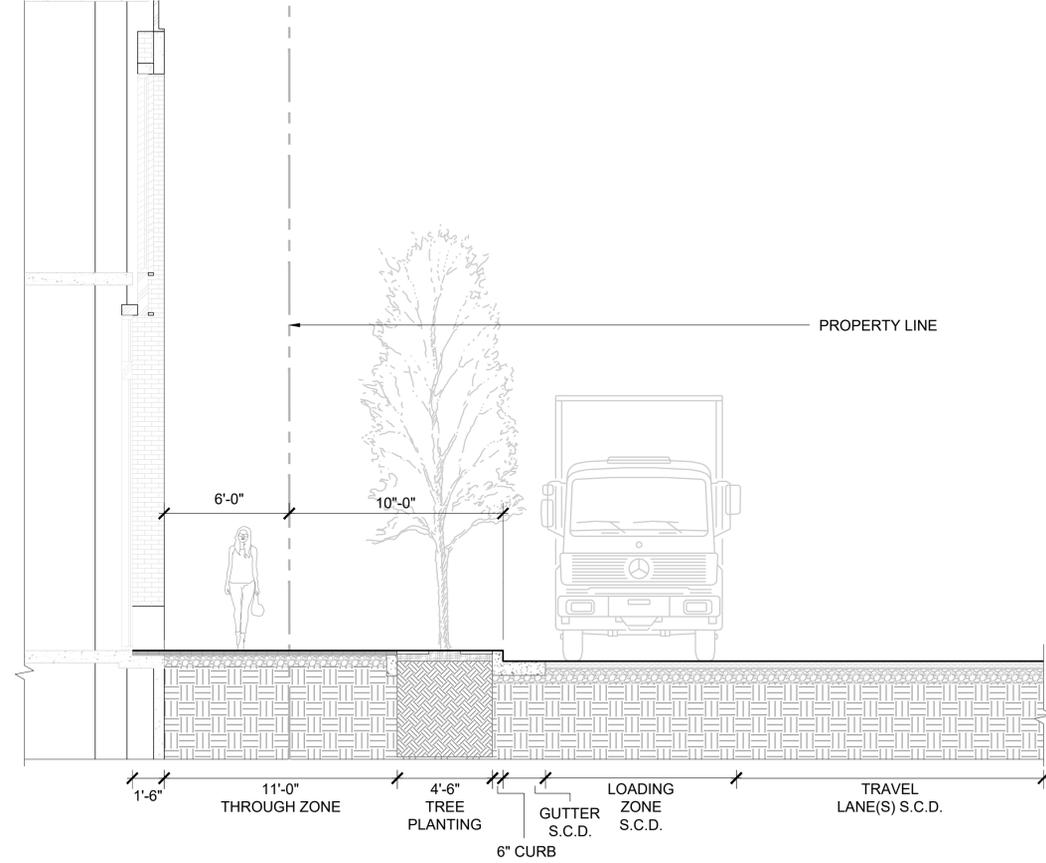

2 B-STREET
SCALE: 1/4" = 1'-0"
TYPICAL SECTION

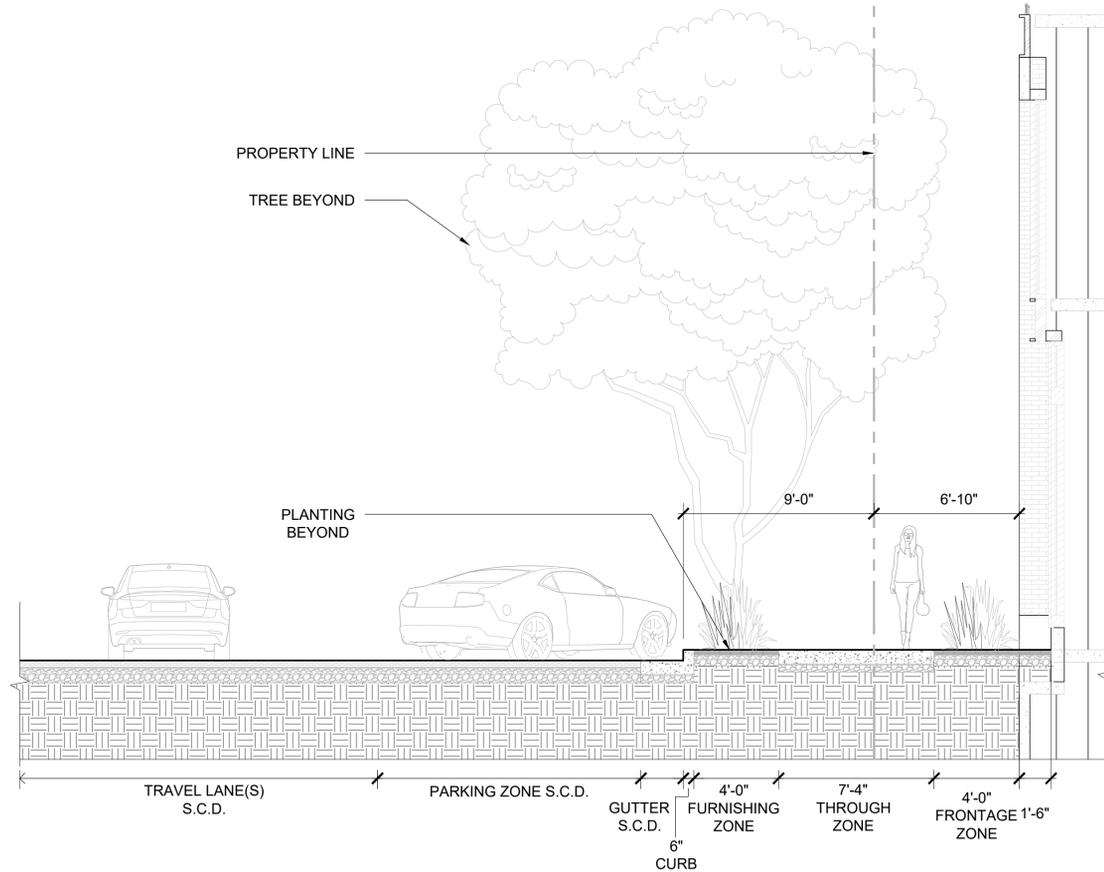

3 E 4TH AVENUE
SCALE: 1/4" = 1'-0"
TYPICAL SECTION

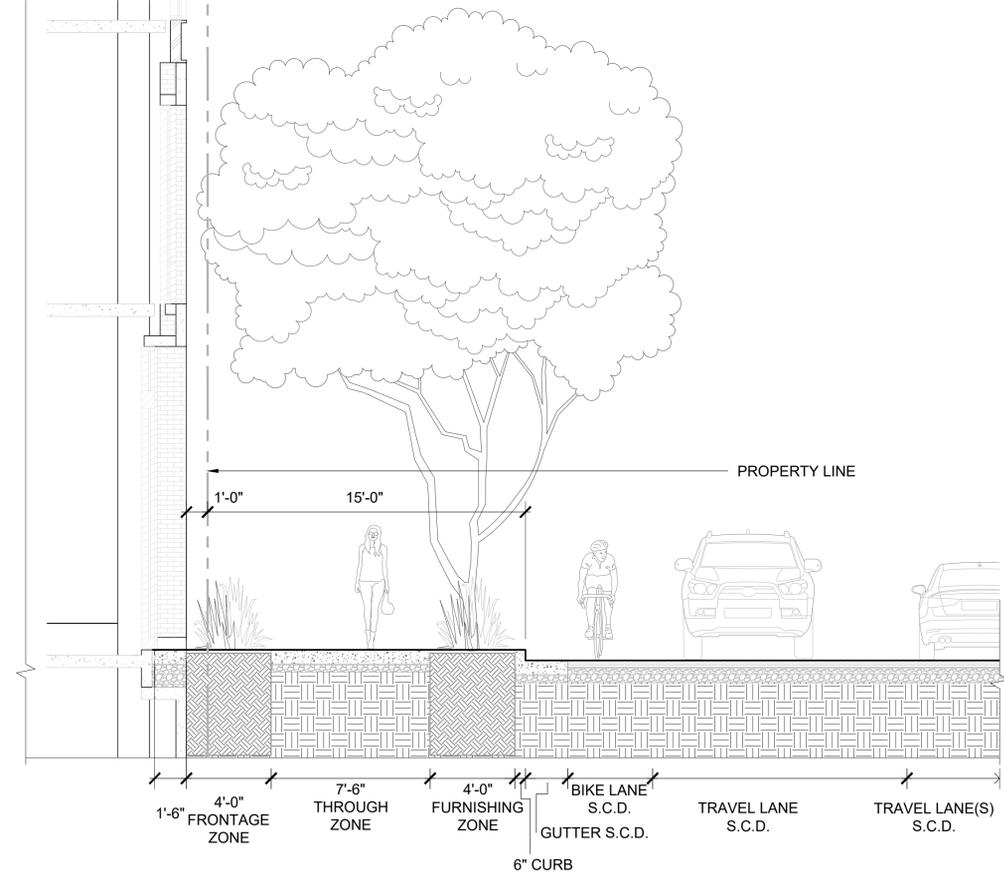

4 E 5TH AVENUE
SCALE: 1/4" = 1'-0"
TYPICAL SECTION



4TH & ELLSWORTH AERIAL

CONCEPTUAL LANDSCAPE SHOWN AT ROOFTOP TERRACES



PARKLET FROM 4TH & ELLSWORTH



ARCHITECTS
KORTH SUNSERI HAGEY

AC
LA
ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LANDSCAPE RENDERINGS

SCALE
N.A.

SHEET NUMBER



ARCHITECTS
KORTH SUNSERI HAGEY

AC
LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LANDSCAPE RENDERINGS

SCALE
N.A.

SHEET NUMBER



AERIAL OF PARKLET AT 4TH & ELLSWORTH

CONCEPTUAL LANDSCAPE SHOWN AT ROOFTOP TERRACES



PARKLET AT 4TH AND ELLSWORTH FROM ELLSWORTH



ARCHITECTS
KORTH SUNSERI HAGEY

AC
LA
ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LANDSCAPE RENDERINGS

SCALE
N.A.

SHEET NUMBER

L-203



ELLSWORTH STREETScape AND BUILDING ENTRY



STREETScape AND ENTRY AT 4TH & B STREET



4TH AVE & B STREET AERIAL



B STREET STREETScape & 5TH AVE



ARCHITECTS
KORTH SUNSERI HAGEY

AC
LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00

SHEET TITLE
LANDSCAPE RENDERINGS

SCALE
N.A.

SHEET NUMBER

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal


PROJECT NUMBER
16010.00

SHEET TITLE
LANDSCAPE MATERIALS AND
FURNISHING IMAGERY

SCALE
N.A.

SHEET NUMBER

L-205

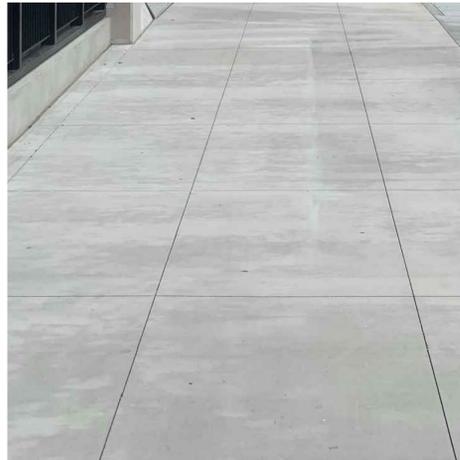

CONCRETE PAVING



UNIT PAVING TYPE I & II



PEDESTAL PAVING TYPE I & II



PEDESTAL PAVING TYPE III



PRECAST PAVER COLORS



BENCH TYPE I & II



BENCH TYPE III



RAISED METAL PLANTER & BENCH TYPE IV



WOOD DINING TABLE



BENCH TYPE V



BIKE RACK AT UNIT PAVING




PEDESTAL PAVING TYPE IV





ARCHITECTS
KORTH SUNSERI HAGEY


AC LA ANDREA COCHRAN
LANDSCAPE ARCHITECTURE
2325 Third Street #210
San Francisco CA 94107
415.503.0060

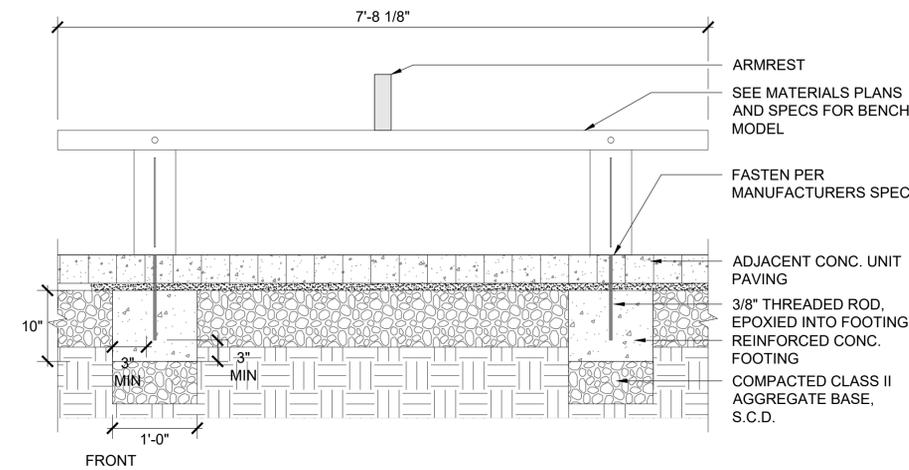




1 WOOD BENCH TYPE I
SCALE: 1"=1'-0"
TYPICAL SECTION

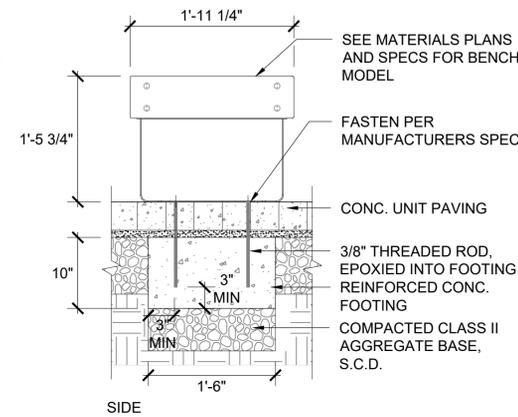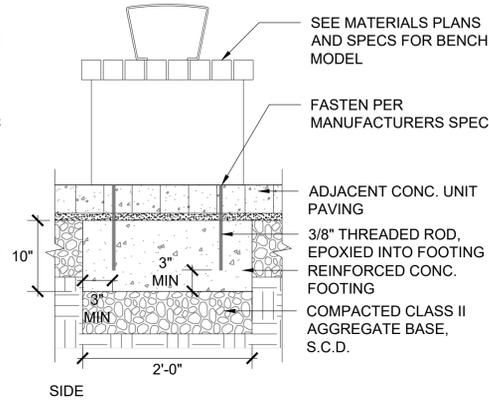


2 WOOD BENCH TYPE III
SCALE: 1"=1'-0"
TYPICAL SECTION

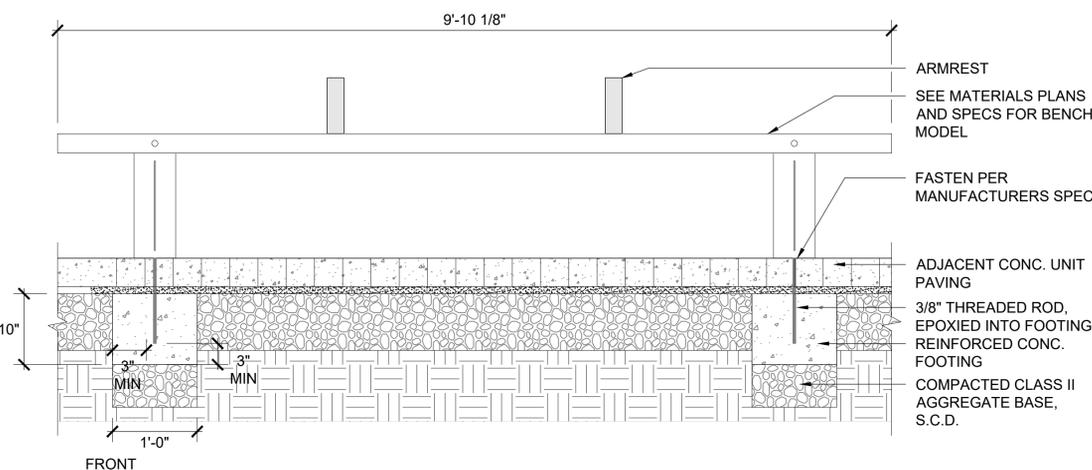

3 WOOD BENCH TYPE II
SCALE: 1"=1'-0"
TYPICAL SECTION

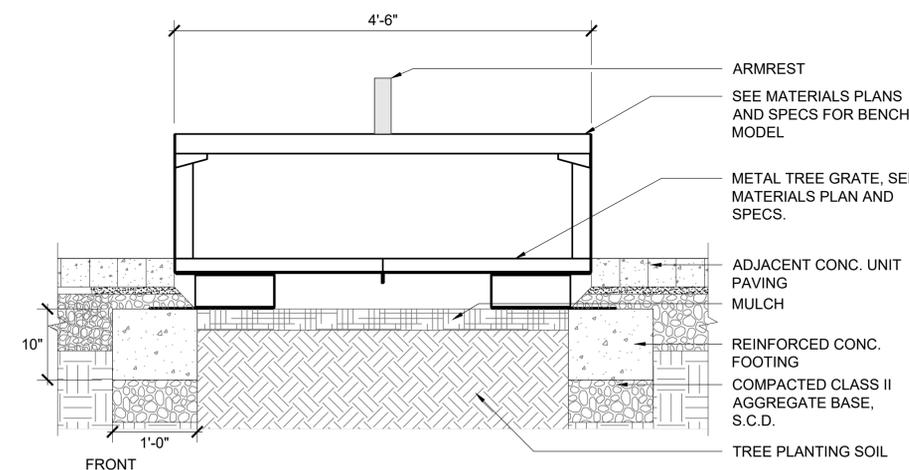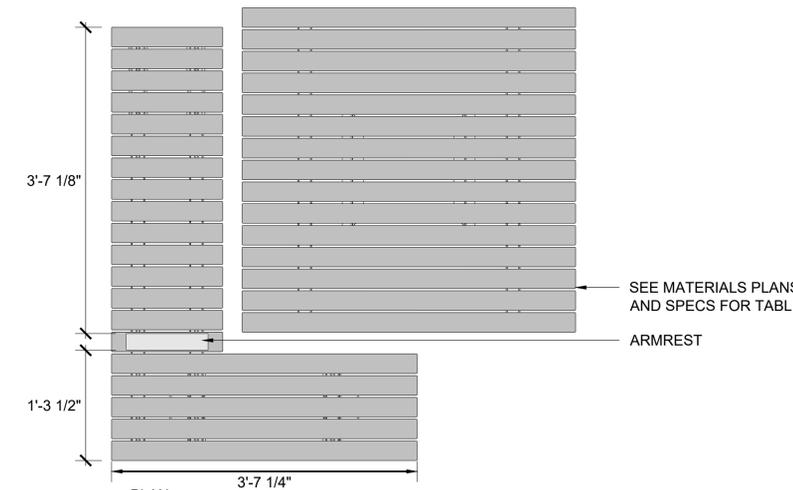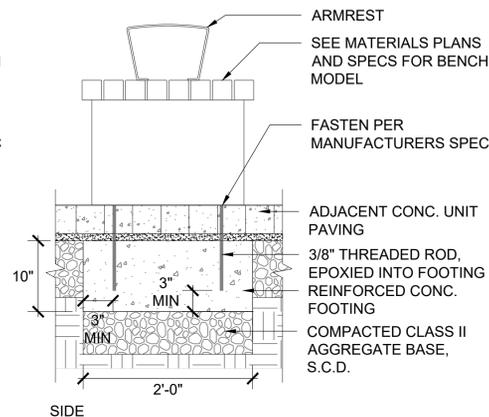

4 WOOD BENCH TYPE V
SCALE: 1"=1'-0"
TYPICAL SECTION

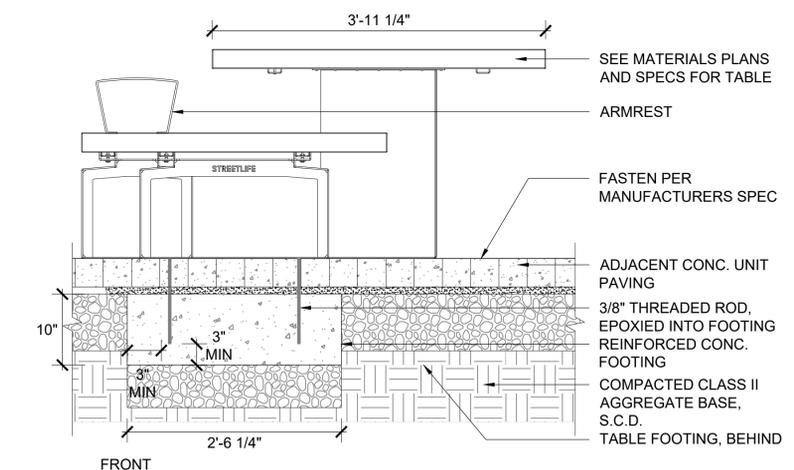

5 PICNIC TABLE AND BENCH
SCALE: 1"=1'-0"
TYPICAL SECTION

ISSUES AND REVISIONS

No.	Date	Description
A	05/05/20	Pre-Application Set
B	10/21/20	Pre-Application Resubmittal
C	03/19/21	Pre-Application Resubmittal
D	10/15/21	Pre-Application Resubmittal
E	02/04/22	Pre-Application Resubmittal
F	04/22/22	Pre-Application Resubmittal
G	06/15/22	Pre-Application Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
SITE FURNISHING DETAILS

SCALE
AS NOTED

SHEET NUMBER

L-300

GENERAL NOTES:
 1. ANY DESIGNS OR DESIGN SOLUTIONS PRESENTED IN THIS DRAWING OR SPECIFICATION, WHICH ARE DIRECT OR IMPLIED, INCLUDING NARRATIVES, DRAWINGS, OR DIAGRAMS, ARE HEREBY CLARIFIED AS EXAMPLES AND SHALL NOT BE CONSIDERED COMPLETE DESIGNS OR DESIGNS SUITABLE FOR CONSTRUCTION.
 2. OMISSIONS FROM DRAWINGS OR SPECIFICATIONS, OR THE INACCURATE DESCRIPTION OF DETAILS OF WORK, WHICH ARE MANIFESTLY NECESSARY TO CARRY OUT THE INTENT OF THE DRAWINGS AND SPECIFICATIONS, OR WHICH ARE CUSTOMARILY PERFORMED, SHALL NOT RELIEVE THE CONTRACTOR FROM PERFORMING SUCH OMITTED OR INACCURATELY DESCRIBED DETAILS OF THE WORK. WORK SHALL BE PERFORMED AS IF FULLY AND CORRECTLY SET FORTH AND DESCRIBED IN THE DRAWINGS AND SPECIFICATIONS.
 3. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO START OF CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ALL EXISTING FIELD CONDITIONS AND ANY DISCREPANCIES OR INCONSISTENCIES.

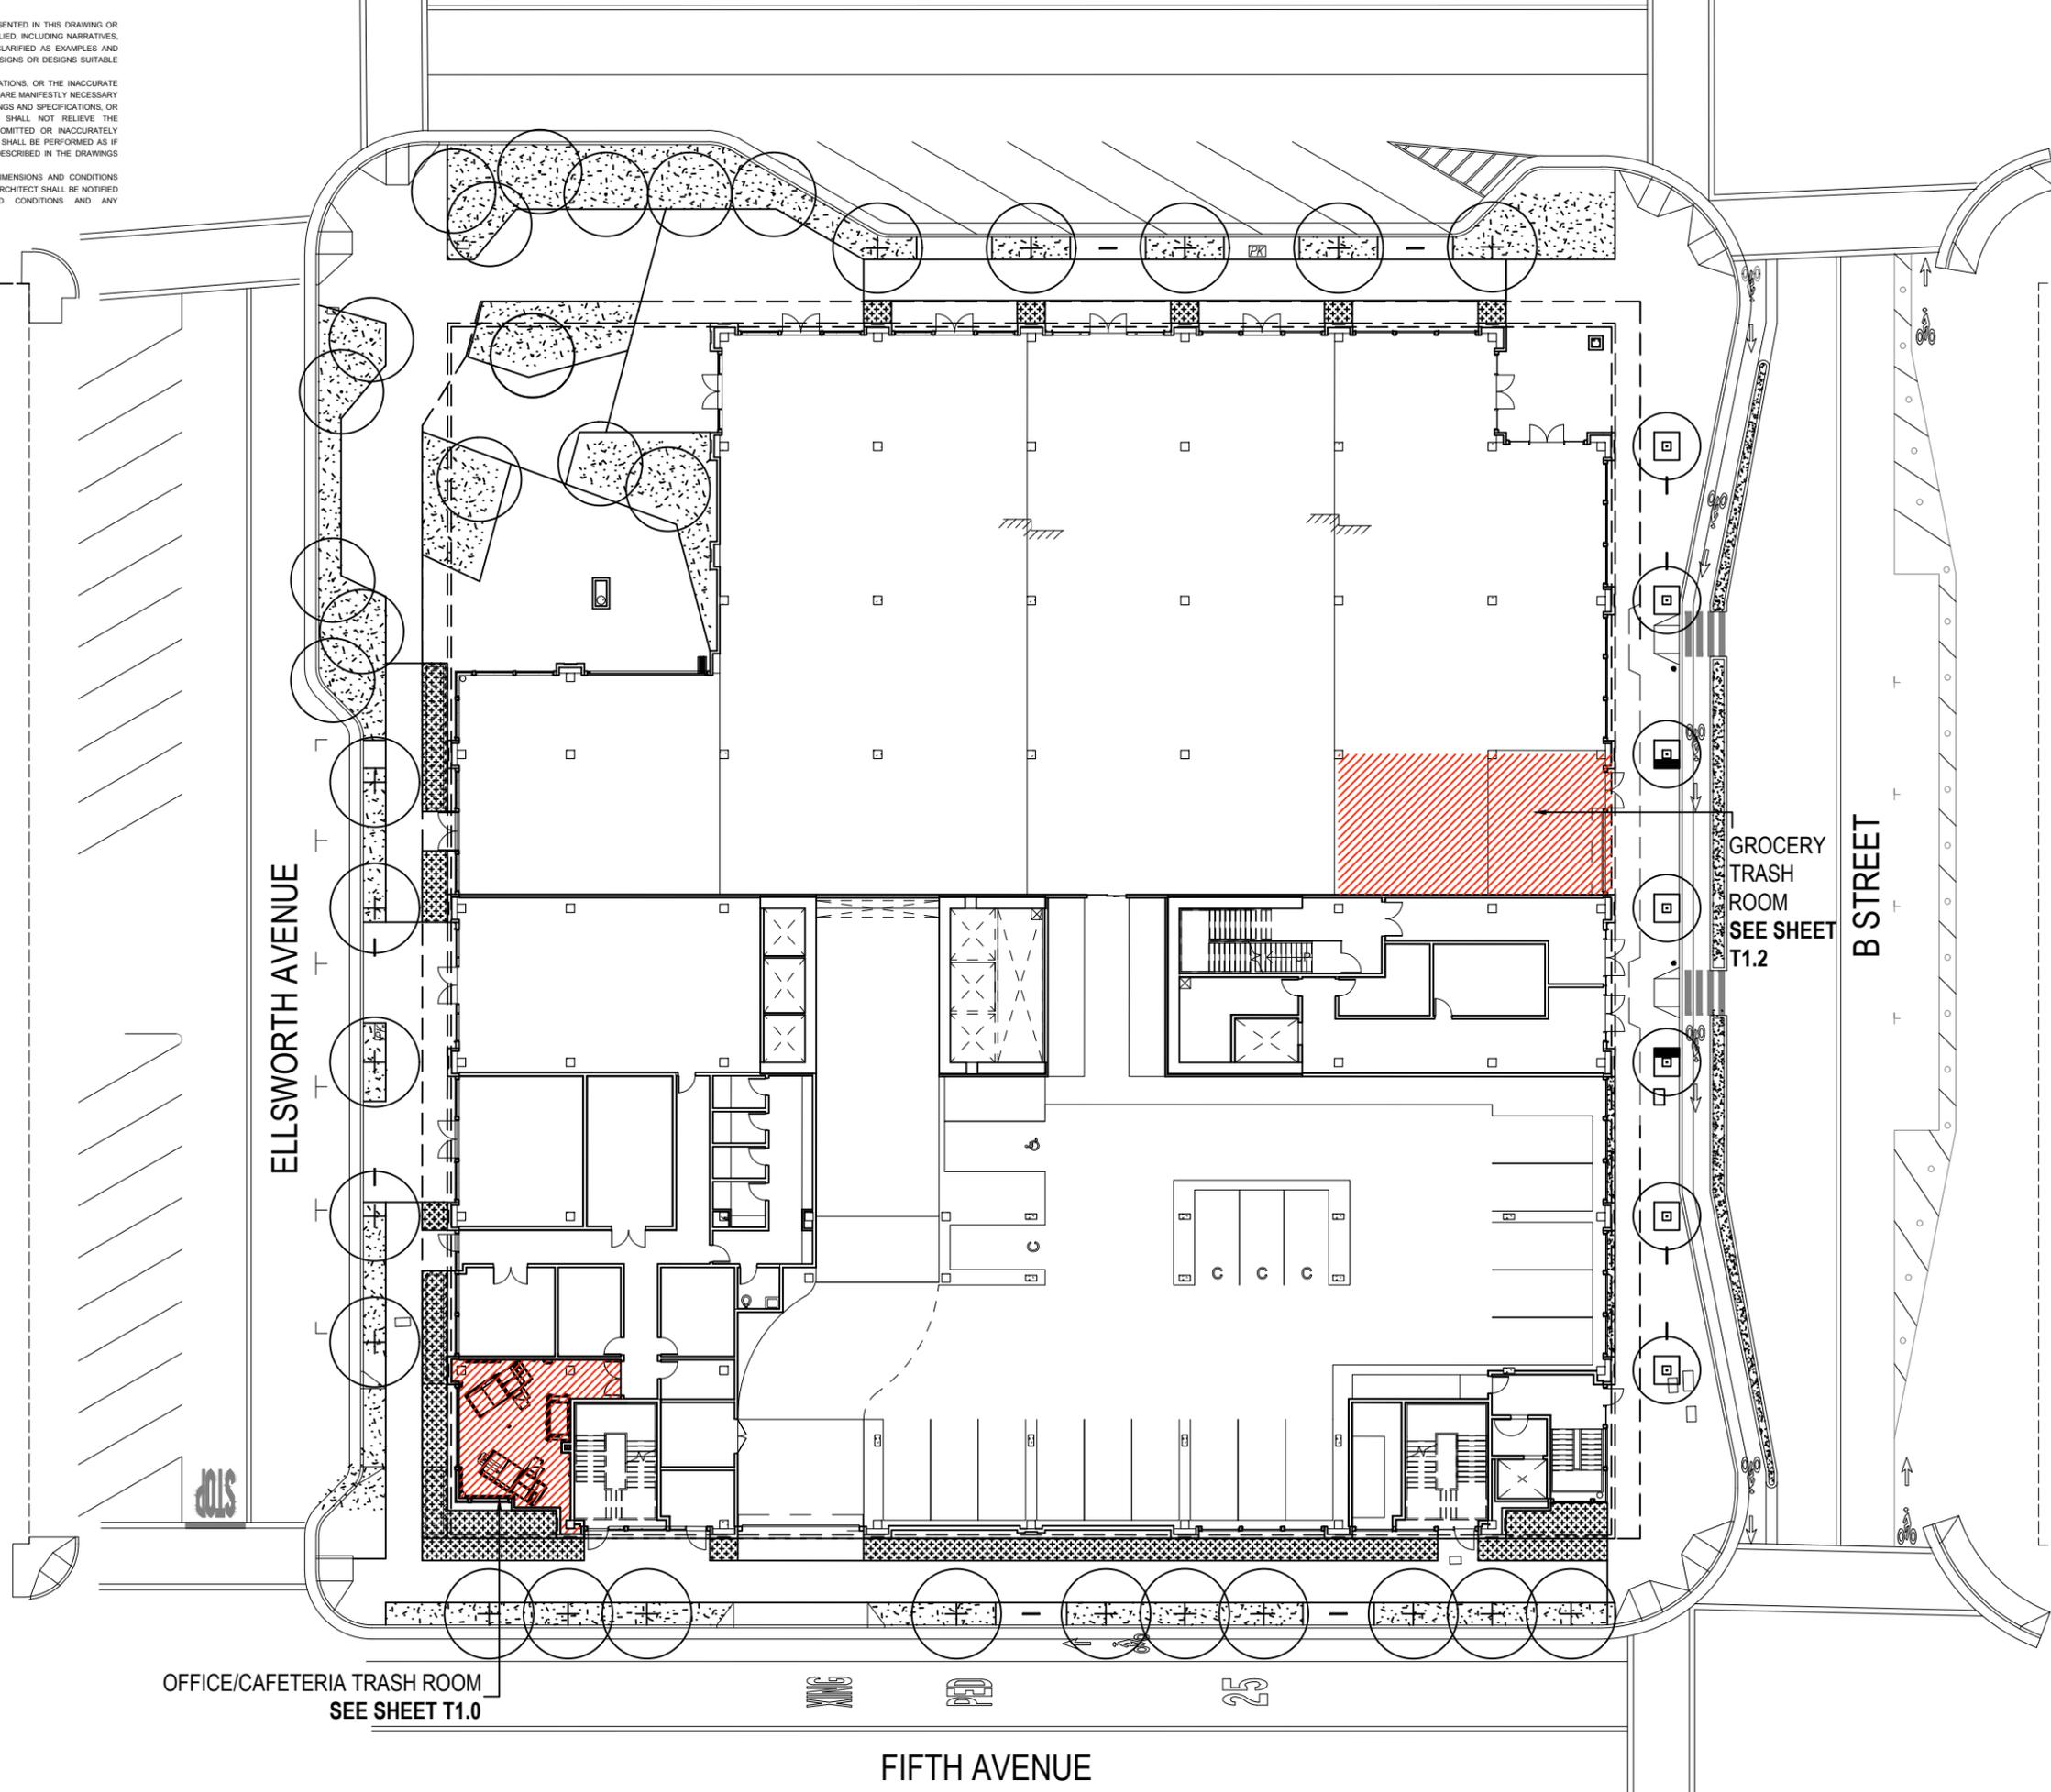

AMERICAN TRASH MANAGEMENT
 1900 POWELL STREET, SUITE 220
 EMERYVILLE, CALIFORNIA 94608
 P: 415.292.5400
 F: 415.292.5410
 SBROWN@TRASHMANAGE.COM

CONSULTANT

KSH
 ARCHITECT

LANE PARTNERS
 OWNER / DEVELOPER

NO.	DATE	ISSUE / REVISION	ISSUED BY

NO.	DATE	ISSUE / REVISION	ISSUED BY

KSH-222 E 4th-San Mateo
 PROJECT

SITE PLAN
 LEVEL 1
 DRAWING TITLE

PROJECT NO.	DRAWING NO.
DRAWN PH	T0.1
APPROVED SB	
DATE 06/03/2022	
SCALE 1/30" = 1'-0"	



AMERICAN TRASH MANAGEMENT

AMERICAN TRASH MANAGEMENT
1900 POWELL STREET, SUITE 220
EMERYVILLE, CALIFORNIA 94608
P: 415.292.5400
F: 415.292.5410
SBROWN@TRASHMANAGE.COM

CONSULTANT

KSH

ARCHITECT

LANE PARTNERS

OWNER / DEVELOPER

NO.	DATE	ISSUE / REVISION	ISSUED BY

KSH-222 E 4th-San Mateo

PROJECT

KEY PLAN
TYPICAL UPPER LEVEL

DRAWING TITLE

PROJECT NO.

DRAWN PH

APPROVED SB

DATE 06/03/2022

SCALE 1/20" = 1'-0"

DRAWING NO.

T0.2

GENERAL NOTES:

1. ANY DESIGNS OR DESIGN SOLUTIONS PRESENTED IN THIS DRAWING OR SPECIFICATION, WHICH ARE DIRECT OR IMPLIED, INCLUDING NARRATIVES, DRAWINGS, OR DIAGRAMS, ARE HEREBY CLARIFIED AS EXAMPLES AND SHALL NOT BE CONSIDERED COMPLETE DESIGNS OR DESIGNS SUITABLE FOR CONSTRUCTION.
2. OMISSIONS FROM DRAWINGS OR SPECIFICATIONS, OR THE INACCURATE DESCRIPTION OF DETAILS OF WORK, WHICH ARE MANIFESTLY NECESSARY TO CARRY OUT THE INTENT OF THE DRAWINGS AND SPECIFICATIONS, OR WHICH ARE CUSTOMARILY PERFORMED, SHALL NOT RELIEVE THE CONTRACTOR FROM PERFORMING SUCH OMITTED OR INACCURATELY DESCRIBED DETAILS OF THE WORK. WORK SHALL BE PERFORMED AS IF FULLY AND CORRECTLY SET FORTH AND DESCRIBED IN THE DRAWINGS AND SPECIFICATIONS.
3. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO START OF CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ALL EXISTING FIELD CONDITIONS AND ANY DISCREPANCIES OR INCONSISTENCIES.

ELLSWORTH AVENUE

B STREET

RESIDENTIAL TRASH ROOM
SEE SHEET TR1.1





AMERICAN TRASH MANAGEMENT

AMERICAN TRASH MANAGEMENT
1900 POWELL STREET, SUITE 220
EMERYVILLE, CALIFORNIA 94608
P: 415.292.5400
F: 415.292.5410
SBROWN@TRASHMANAGE.COM

CONSULTANT

KSH

ARCHITECT

LANE PARTNERS

OWNER / DEVELOPER

NO.	DATE	ISSUE / REVISION	ISSUED BY

KSH-222 E 4th-San Mateo

PROJECT

STAGING DETAILS
OFFICE & CAFETERIA

DRAWING TITLE

PROJECT NO.

DRAWN PH

APPROVED SB


DATE 06/03/2022

SCALE 1/50" = 1'-0"

DRAWING NO.

T0.3

- GENERAL NOTES:
- ANY DESIGNS OR DESIGN SOLUTIONS PRESENTED IN THIS DRAWING OR SPECIFICATION, WHICH ARE DIRECT OR IMPLIED, INCLUDING NARRATIVES, DRAWINGS, OR DIAGRAMS, ARE HEREBY CLARIFIED AS EXAMPLES AND SHALL NOT BE CONSIDERED COMPLETE DESIGNS OR DESIGNS SUITABLE FOR CONSTRUCTION.
 - OMISSIONS FROM DRAWINGS OR SPECIFICATIONS, OR THE INACCURATE DESCRIPTION OF DETAILS OF WORK, WHICH ARE MANIFESTLY NECESSARY TO CARRY OUT THE INTENT OF THE DRAWINGS AND SPECIFICATIONS, OR WHICH ARE CUSTOMARILY PERFORMED, SHALL NOT RELIEVE THE CONTRACTOR FROM PERFORMING SUCH OMITTED OR INACCURATELY DESCRIBED DETAILS OF THE WORK. WORK SHALL BE PERFORMED AS IF FULLY AND CORRECTLY SET FORTH AND DESCRIBED IN THE DRAWINGS AND SPECIFICATIONS.
 - CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO START OF CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ALL EXISTING FIELD CONDITIONS AND ANY DISCREPANCIES OR INCONSISTENCIES.

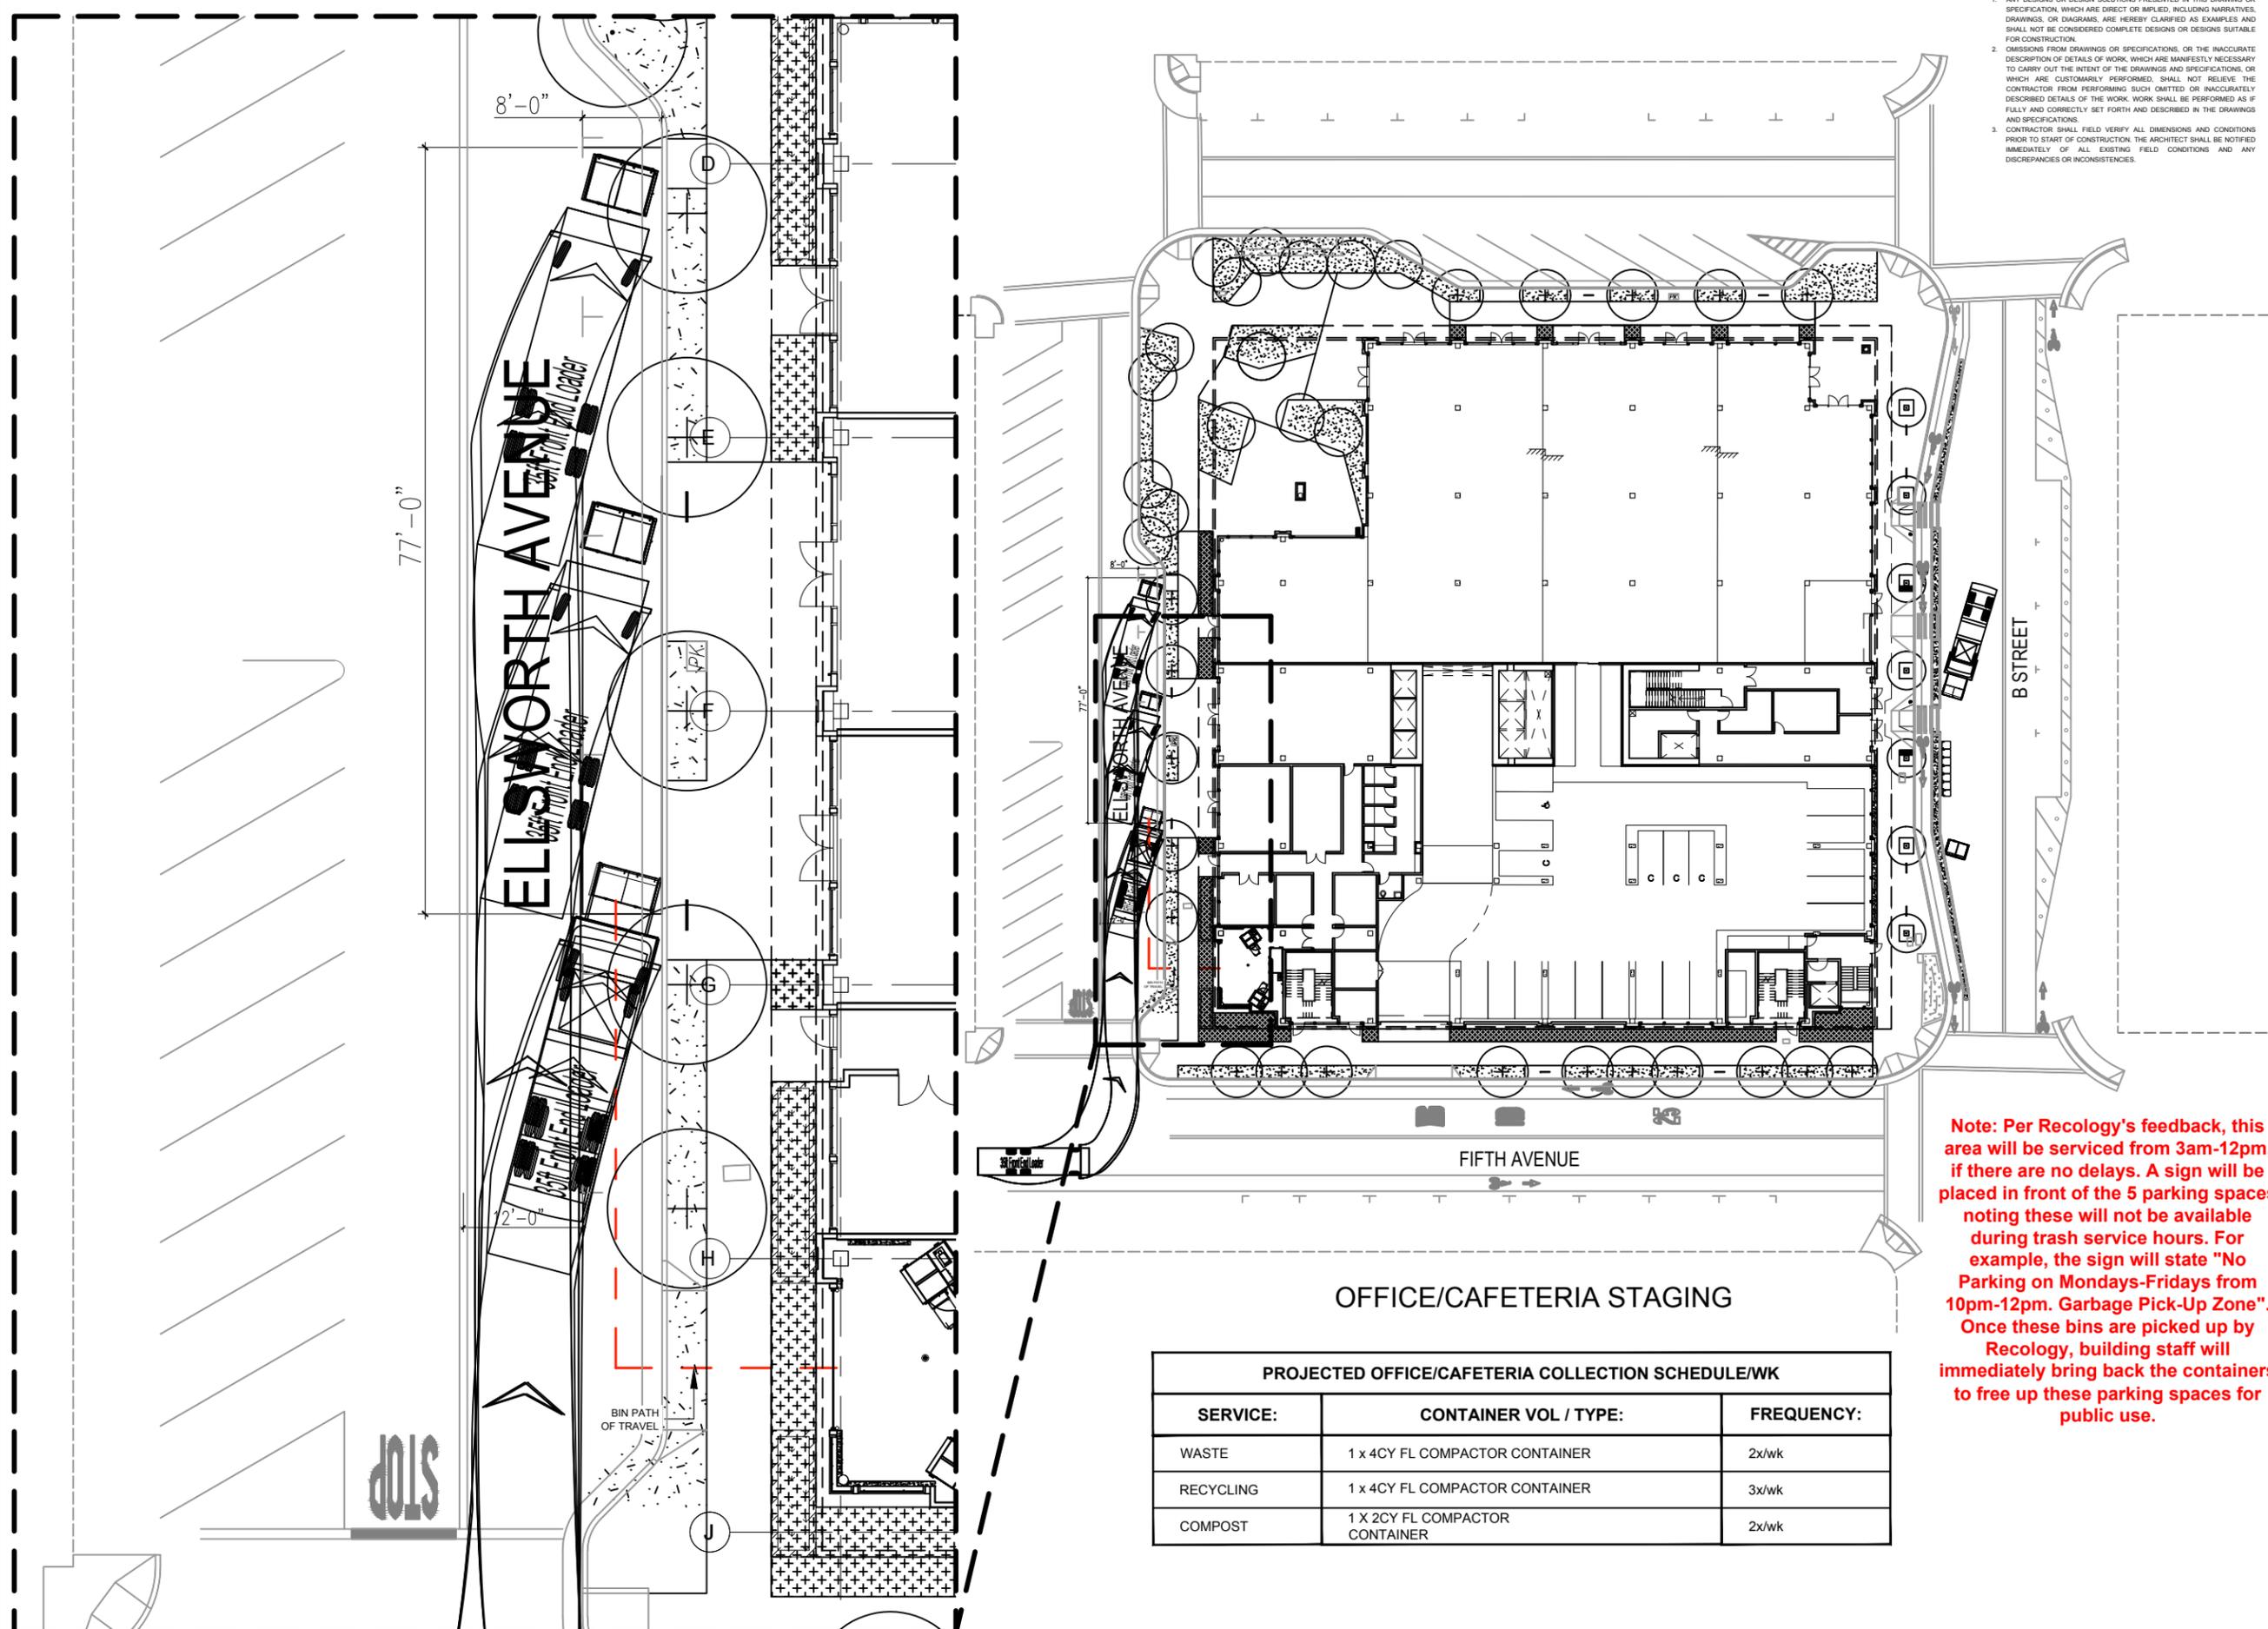

Note: Per Recology's feedback, this area will be serviced from 3am-12pm, if there are no delays. A sign will be placed in front of the 5 parking spaces noting these will not be available during trash service hours. For example, the sign will state "No Parking on Mondays-Fridays from 10pm-12pm. Garbage Pick-Up Zone". Once these bins are picked up by Recology, building staff will immediately bring back the containers to free up these parking spaces for public use.

OFFICE/CAFETERIA STAGING

PROJECTED OFFICE/CAFETERIA COLLECTION SCHEDULE/WK		
SERVICE:	CONTAINER VOL / TYPE:	FREQUENCY:
WASTE	1 x 4CY FL COMPACTOR CONTAINER	2x/wk
RECYCLING	1 x 4CY FL COMPACTOR CONTAINER	3x/wk
COMPOST	1 X 2CY FL COMPACTOR CONTAINER	2x/wk



AMERICAN TRASH MANAGEMENT

AMERICAN TRASH MANAGEMENT
1900 POWELL STREET, SUITE 220
EMERYVILLE, CALIFORNIA 94608
P: 415.292.5400
F: 415.292.5410
SBROWN@TRASHMANAGE.COM

CONSULTANT

KSH

ARCHITECT

LANE PARTNERS

OWNER / DEVELOPER

NO. DATE ISSUE / REVISION ISSUED BY

KSH-222 E 4th-San Mateo

PROJECT

Office/Cafeteria Trash Collection Room Layout

DRAWING TITLE

PROJECT NO.

DRAWN PH

APPROVED SB

DATE 06/03/2022

SCALE 3/16" = 1'-0"

DRAWING NO.

T1.0

SHEET NOTES:

COMMERCIAL TRASH COLLECTION ROOM - LEVEL 1


- CENTRAL TRASH COLLECTION AREA IS 1HR FIRE-RATED - RESTRICTED ACCESS.
- FLOOR SHALL BE FINISHED WITH WATERPROOF DECK COATING. FLOOR TO HAVE MINIMAL SLOPE (1° MAX) AND FLOOR DRAIN. FLOOR LEVEL UNDER COMPACTOR.
- WALLS SHALL BE FINISHED WITH WASHABLE WATERPROOF SURFACE SUCH AS FRP OR HIGH-GLOSS ENAMEL PAINT, 8'-0" AFF.
- INSTALL WALL PROTECTION: 12"Hx6"W CONCRETE CURB AT BASE OF ALL NON-CONCRETE WALLS.
- 14'-3" ROLL-UP DOOR, 6'-0" DOUBLE-SWING DOOR, AND 3'-0" EXIT DOOR.
- (2) A1000 SELF CONTAINED COMPACTORS FOR WASTE AND RECYCLING. PROVIDE 4CY COMPACTOR CONTAINERS.
- (1) P200 COMPACTOR WITH INTERNAL POWER PACK AND 2CY BIN FOR COMPOST. 2HP, 115/230V, 1 PHASE SERVICE REQUIRED. DISCONNECT MOUNTED 60" AFF.
- PP: COMPACTOR POWER PACKS AND LIFT POWER PACKS SHALL BE STACKED & FLOOR-MOUNTED. SEE DETAIL FOR HP PER POWER PACK. EACH PACK IS 3-PHASE, 208/230/460V. EACH PP NEEDS 30A DISCONNECT, 60" AFF.
- OC: ODOR CONTROL UNIT SHALL BE WALL-MOUNTED 60" AFF. REQUIRES 120V 15A SERVICE OUTLET.
- HB: HOT AND COLD HOSE BIB SHALL BE WALL-MOUNTED 60" AFF.
- (1) UNDEDICATED 120V 15A SERVICE OUTLET REQUIRED FOR STAFF MAINTENANCE PURPOSE.

GENERAL NOTES:

- ANY DESIGNS OR DESIGN SOLUTIONS PRESENTED IN THIS DRAWING OR SPECIFICATION, WHICH ARE DIRECT OR IMPLIED, INCLUDING NARRATIVES, DRAWINGS, OR DIAGRAMS, ARE HEREBY CLARIFIED AS EXAMPLES AND SHALL NOT BE CONSIDERED COMPLETE DESIGNS OR DESIGNS SUITABLE FOR CONSTRUCTION.
- OMISSIONS FROM DRAWINGS OR SPECIFICATIONS, OR THE INACCURATE DESCRIPTION OF DETAILS OF WORK, WHICH ARE MANIFESTLY NECESSARY TO CARRY OUT THE INTENT OF THE DRAWINGS AND SPECIFICATIONS, OR WHICH ARE CUSTOMARILY PERFORMED, SHALL NOT RELIEVE THE CONTRACTOR FROM PERFORMING SUCH OMITTED OR INACCURATELY DESCRIBED DETAILS OF THE WORK. WORK SHALL BE PERFORMED AS IF FULLY AND CORRECTLY SET FORTH AND DESCRIBED IN THE DRAWINGS AND SPECIFICATIONS.
- CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO START OF CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ALL EXISTING FIELD CONDITIONS AND ANY DISCREPANCIES OR INCONSISTENCIES.


PROJECTED OFFICE/CAFETERIA COLLECTION SCHEDULE/WK

SERVICE:	CONTAINER VOL / TYPE:	FREQUENCY:
WASTE	1 x 4CY FL COMPACTOR CONTAINER	2x/wk
RECYCLING	1 x 4CY FL COMPACTOR CONTAINER	3x/wk
COMPOST	1 X 2CY FL COMPACTOR CONTAINER	2x/wk

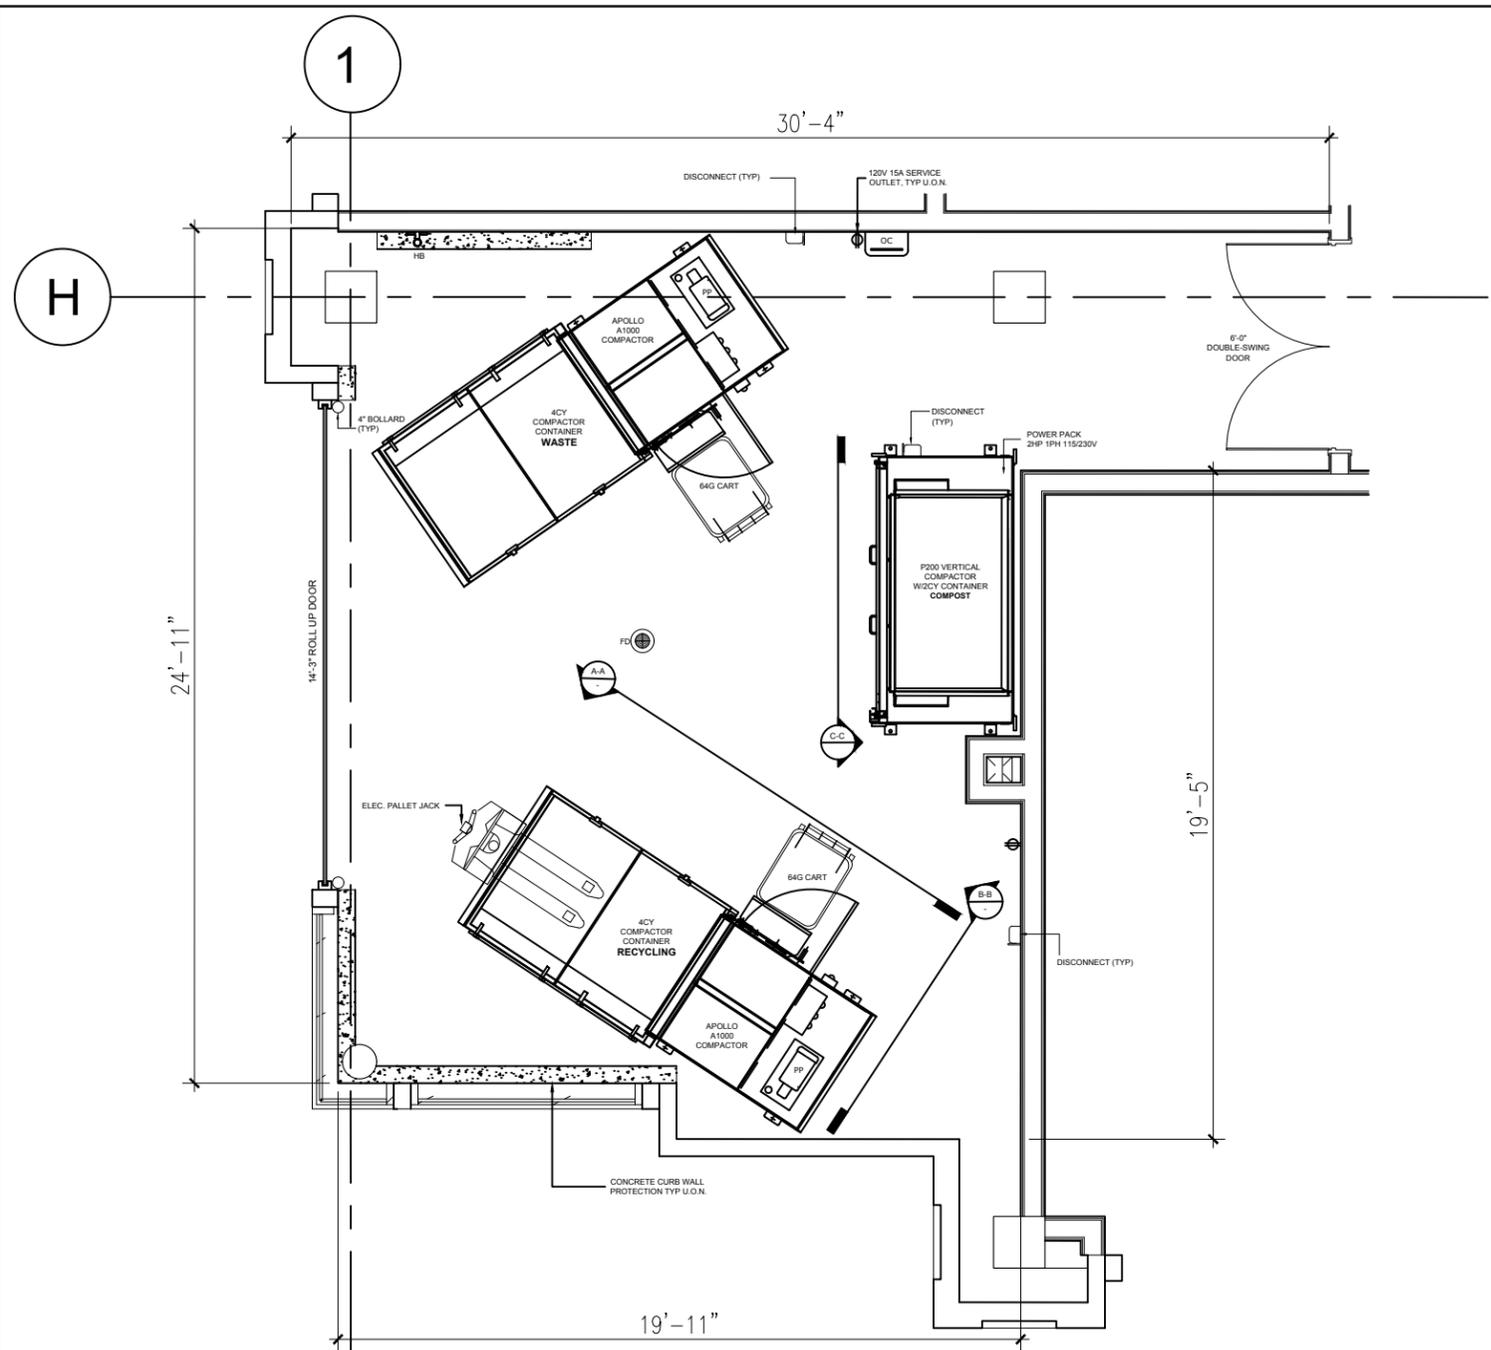


OFFICE/CAFETERIA TRASH ROOM PLAN


LEVEL 1

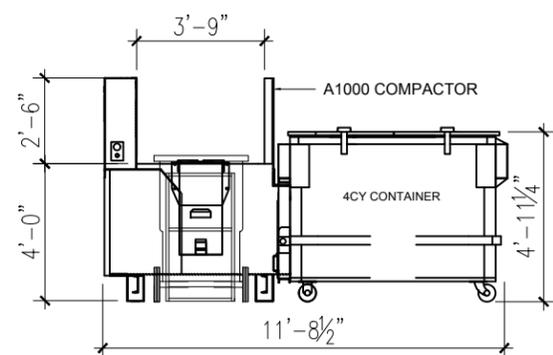

APOLLO A 1000 COMPACTOR
W/ 64 GAL CART AND
BAYNE TASKMASTER HI-LIFT DUMPER

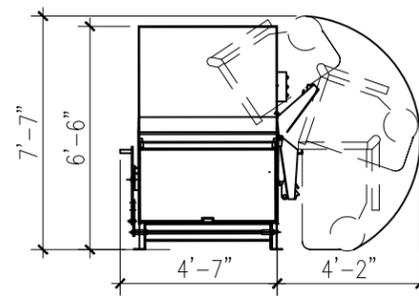

APOLLO A 1000 COMPACTOR
W/ 64 GAL CART AND
BAYNE TASKMASTER HI-LIFT DUMPER

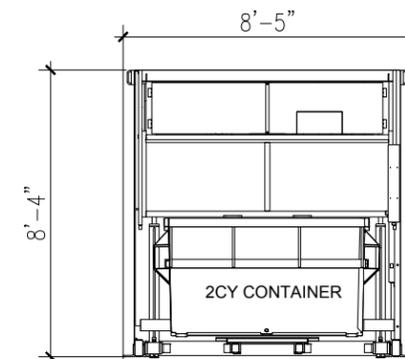

P200 COMPACTOR
W/ 2CY CONTAINER

CONSULTANT

KSH

ARCHITECT

LANE PARTNERS

OWNER / DEVELOPER

SHEET NOTES:


RESIDENTIAL TRASH CLOSET - LEVEL 1:

1. FLOOR SHALL BE FINISHED WITH WATERPROOF DECK COATING.
2. WALLS SHALL BE FINISHED WITH WASHABLE WATERPROOF SURFACE SUCH AS FRP OR HIGH GLOSS ENAMEL PAINT, 8'-0" AFF.
3. OC: ODOR CONTROL UNIT SHALL BE WALL-MOUNTED 60" AFF. REQUIRES 120V 15A SERVICE OUTLET.
4. PROVIDE 3' ACCESS DOOR.

GENERAL NOTES:

1. ANY DESIGNS OR DESIGN SOLUTIONS PRESENTED IN THIS DRAWING OR SPECIFICATION, WHICH ARE DIRECT OR IMPLIED, INCLUDING NARRATIVES, DRAWINGS, OR DIAGRAMS, ARE HEREBY CLARIFIED AS EXAMPLES AND SHALL NOT BE CONSIDERED COMPLETE DESIGNS OR DESIGNS SUITABLE FOR CONSTRUCTION.
2. OMISSIONS FROM DRAWINGS OR SPECIFICATIONS, OR THE INACCURATE DESCRIPTION OF DETAILS OF WORK, WHICH ARE MANIFESTLY NECESSARY TO CARRY OUT THE INTENT OF THE DRAWINGS AND SPECIFICATIONS, OR WHICH ARE CUSTOMARILY PERFORMED, SHALL NOT RELIEVE THE CONTRACTOR FROM PERFORMING SUCH OMITTED OR INACCURATELY DESCRIBED DETAILS OF THE WORK. WORK SHALL BE PERFORMED AS IF FULLY AND CORRECTLY SET FORTH AND DESCRIBED IN THE DRAWINGS AND SPECIFICATIONS.
3. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO START OF CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ALL EXISTING FIELD CONDITIONS AND ANY DISCREPANCIES OR INCONSISTENCIES.

PROJECTED RESIDENTIAL COLLECTION SCHEDULE/WK		
SERVICE:	CONTAINER VOL / TYPE:	FREQUENCY:
WASTE	3 x 96G LOOSE TOTES CARTS	1x/wk
RECYCLING	3 x 96G LOOSE TOTES CARTS	1x/wk
COMPOST	1 X 64G LOOSE TOTES CARTS	1x/wk

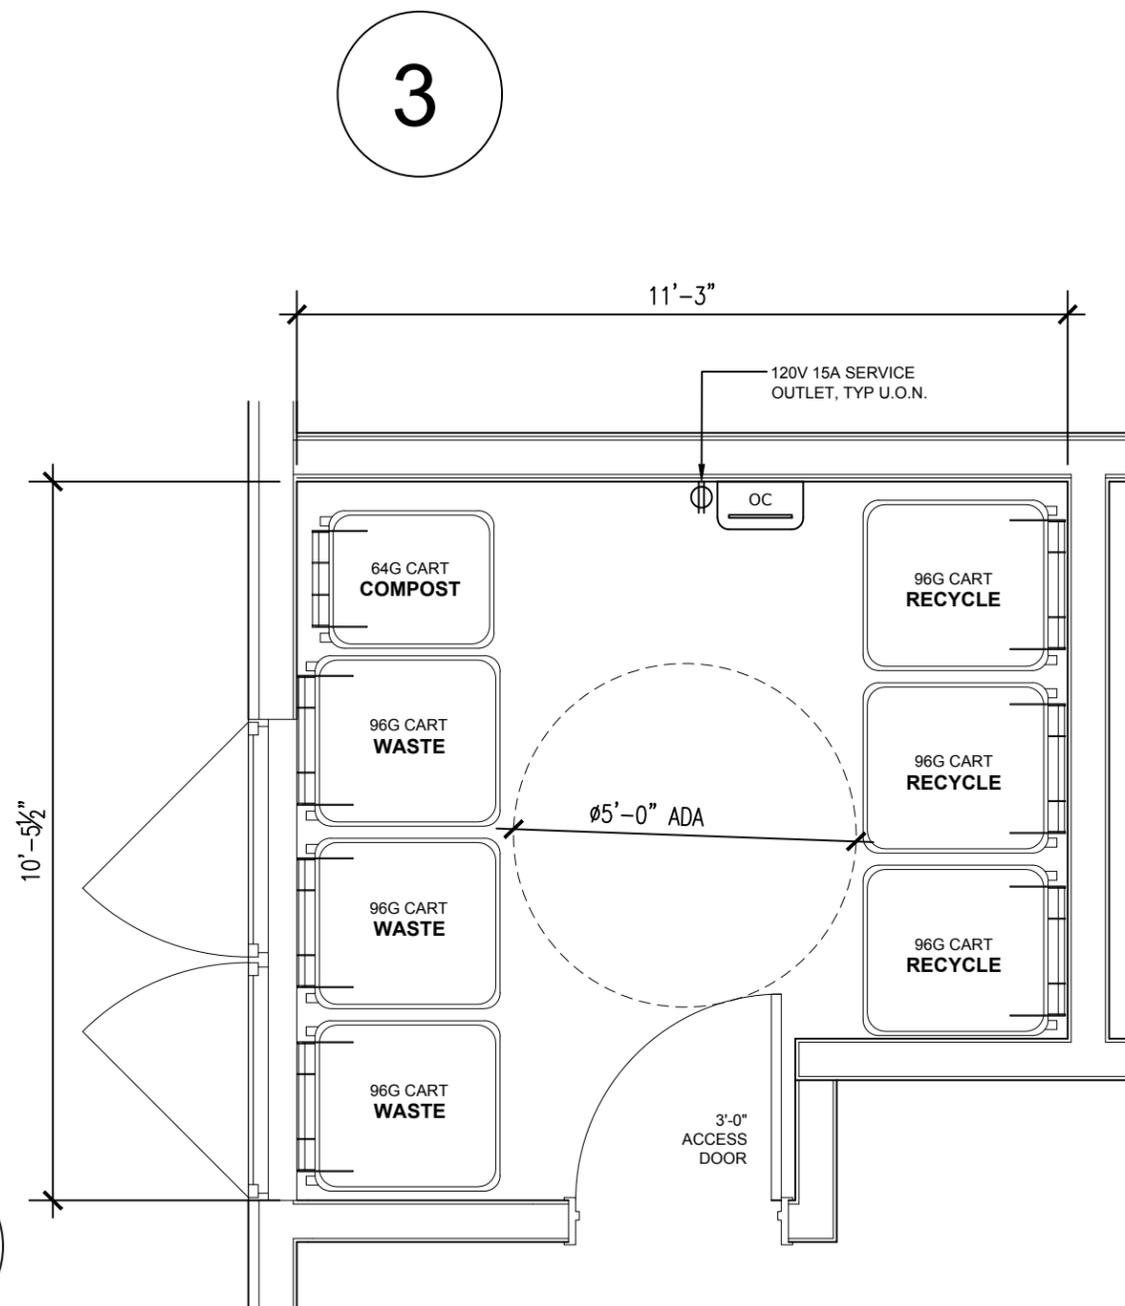

RESIDENTIAL TRASH CLOSET PLAN

LEVEL 5

NO.	DATE	ISSUE / REVISION	ISSUED BY

KSH-222 E 4th-San Mateo

PROJECT

Residential Trash Closet Layout

DRAWING TITLE

PROJECT NO.	DRAWING NO.
DRAWN PH	T1.1
APPROVED SB	
DATE 06/03/2022	
SCALE 3/8" = 1'-0"	

CONSULTANT

KSH

ARCHITECT

LANE PARTNERS

OWNER / DEVELOPER

NO.	DATE	ISSUE / REVISION	ISSUED BY

KSH-222 E 4th-San Mateo

PROJECT

Grocery Trash Room Prototype

DRAWING TITLE

PROJECT NO. DRAWING NO.


DRAWN PH

APPROVED SB

DATE 06/03/2022

SCALE 3/16" = 1'-0"

T1.2

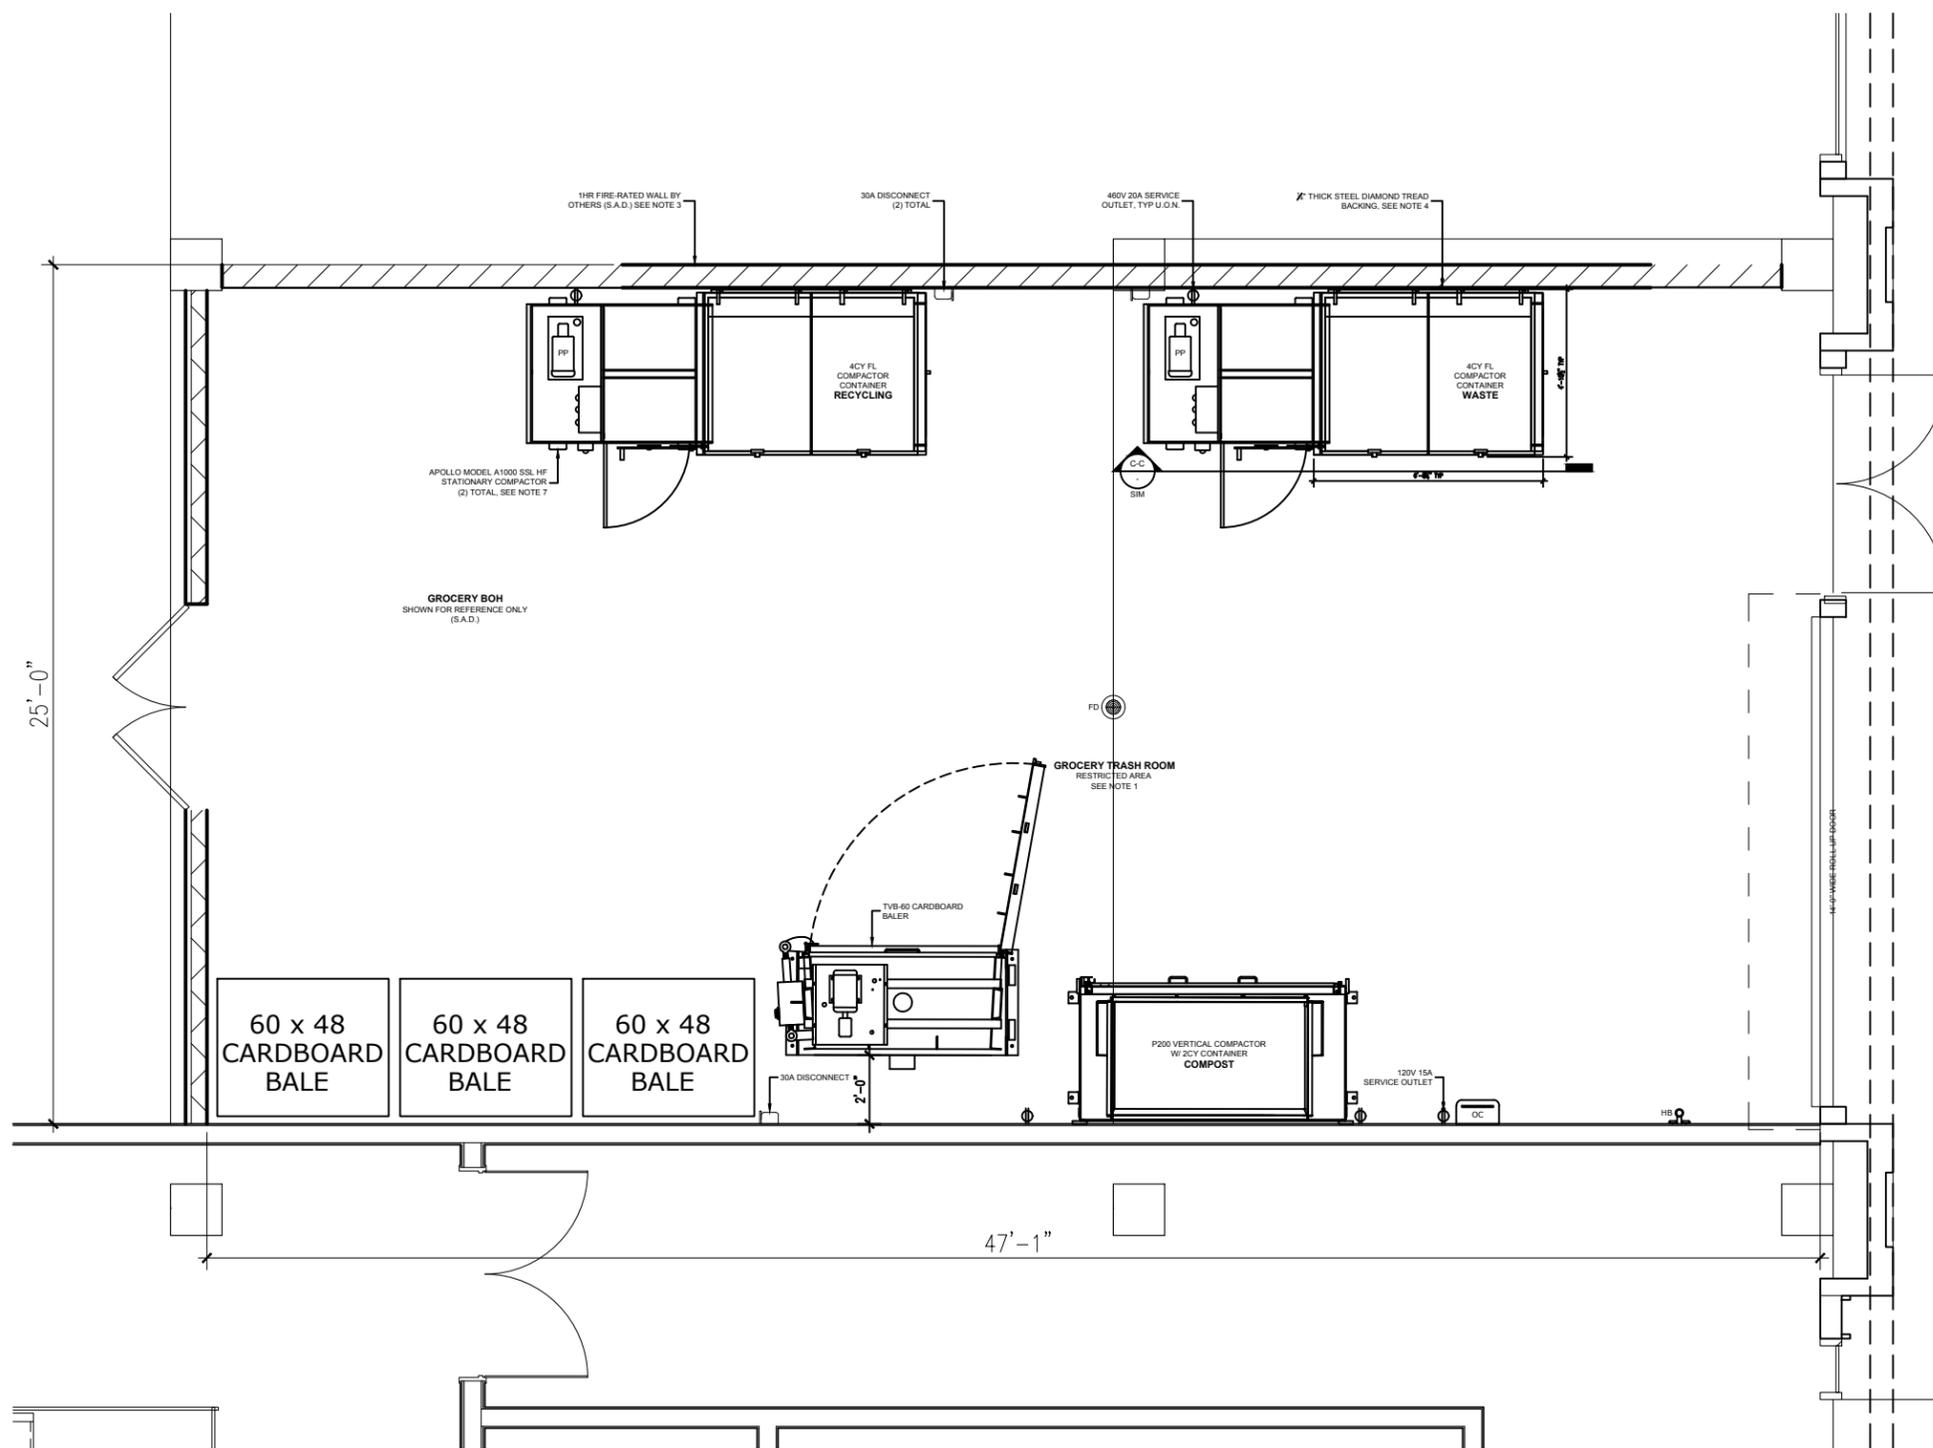

SHEET NOTES:

BUILDING 1. COMMERCIAL TRASH ROOM. LEVEL 1


- TRASH COLLECTION ROOM IS 1HR FIRE-RATED - RESTRICTED ACCESS.
- FLOORS SHALL BE FINISHED WITH WATERPROOF DECK COATING WITH MINIMAL SLOPE AND FLOOR DRAIN. LEVEL FLOOR UNDER COMPACTORS.
- WALLS SHALL BE FINISHED WITH WASHABLE WATERPROOF SURFACE SUCH AS FRP OR HIGH-GLOSS ENAMEL PAINT 8'-0" AFF.
- WALL PROTECTION: 1/2" THICK STEEL DIAMOND TREAD BACKING ALONG WALL BEHIND COMPACTORS 6'-0" AFF.
- (2) 10'-0" WIDE ROLL-UP DOORS FOR TRANSFERRING CONTAINERS.
- ROOM SHALL BE MECHANICALLY VENTILATED WITH (1) CFM/SF PER 2019 CBC.
- APOLLO MODEL A1000 SINGLE-SIDE LATCH HAND-FED STATIONARY COMPACTORS FOR WASTE AND RECYCLING.
- PP: POWER PACKS SHALL BE COMPACTOR- MOUNTED. (2) 5HP 3-PHASE, 208/230/460V. 30A DISCONNECTS 60" AFF. PROVIDE 4CY FL COMPACTOR CONTAINERS FOR DISPOSAL.
- AC: 2HP CHUTE AIR COMPRESSOR SHALL BE FLOOR-MOUNTED.
- OC: ODOR CONTROL UNIT SHALL BE WALL-MOUNTED 60" AFF.
- HB: HOT AND COLD HOSE BIBB SHALL BE WALL-MOUNTED 60" AFF.
- PROVIDE ELECTRIC PALLET TRUCK FOR TRANSFERRING CONTAINERS. 4000LB CAPACITY WITH 45.5" TURNING RADIUS. STORE IN BUILDING 1 RESIDENTIAL TRASH ROOM.
- 120V 15A SERVICE OUTLETS REQUIRED FOR ALL EQUIPMENT (U.O.N.).
- STORE CARDBOARD BALES ELSEWHERE.

GENERAL NOTES:

- ANY DESIGNS OR SOLUTIONS SHOWN IN DRAWING, EITHER DIRECT OR IMPLIED, ARE HEREBY CLARIFIED AS EXAMPLES AND SHALL NOT BE CONSIDERED COMPLETE DESIGNS FOR CONSTRUCTION. THESE DRAWINGS ARE INTENDED TO SUPPLEMENT THE SUBMITTAL PACKAGE FROM ARCHITECT.
- ANY PARTIAL INFORMATION, OMISSIONS, OR INACCURATE DESCRIPTIONS OF WORK SHOWN IN DRAWINGS, WHICH ARE NECESSARY TO PERFORM THE SCOPE OF WORK, SHALL NOT RELIEVE THE CONTRACTOR FROM COMPLETION OF WORK. ALL WORK SHALL BE PERFORMED TO SATISFY THE MINIMUM REQUIREMENTS OF THE CURRENT APPLICABLE BUILDING CODES. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO START OF CONSTRUCTION. THE ARCHITECT SHALL BE PROMPTLY NOTIFIED OF ANY INCONSISTENCIES AND/OR DISCREPANCIES.

**COMMERCIAL TRASH ROOM PLAN
PROTOTYPE ONLY**

PROJECTED GROCERY COLLECTION SCHEDULE/WK		
SERVICE:	CONTAINER VOL / TYPE:	FREQUENCY:
WASTE	1 x 4CY FL COMPACTOR CONTAINER	3x/wk
RECYCLING	1 x 4CY FL COMPACTOR CONTAINER	3x/wk
COMPOST	1 X 2CY FL COMPACTOR CONTAINER	2x/wk

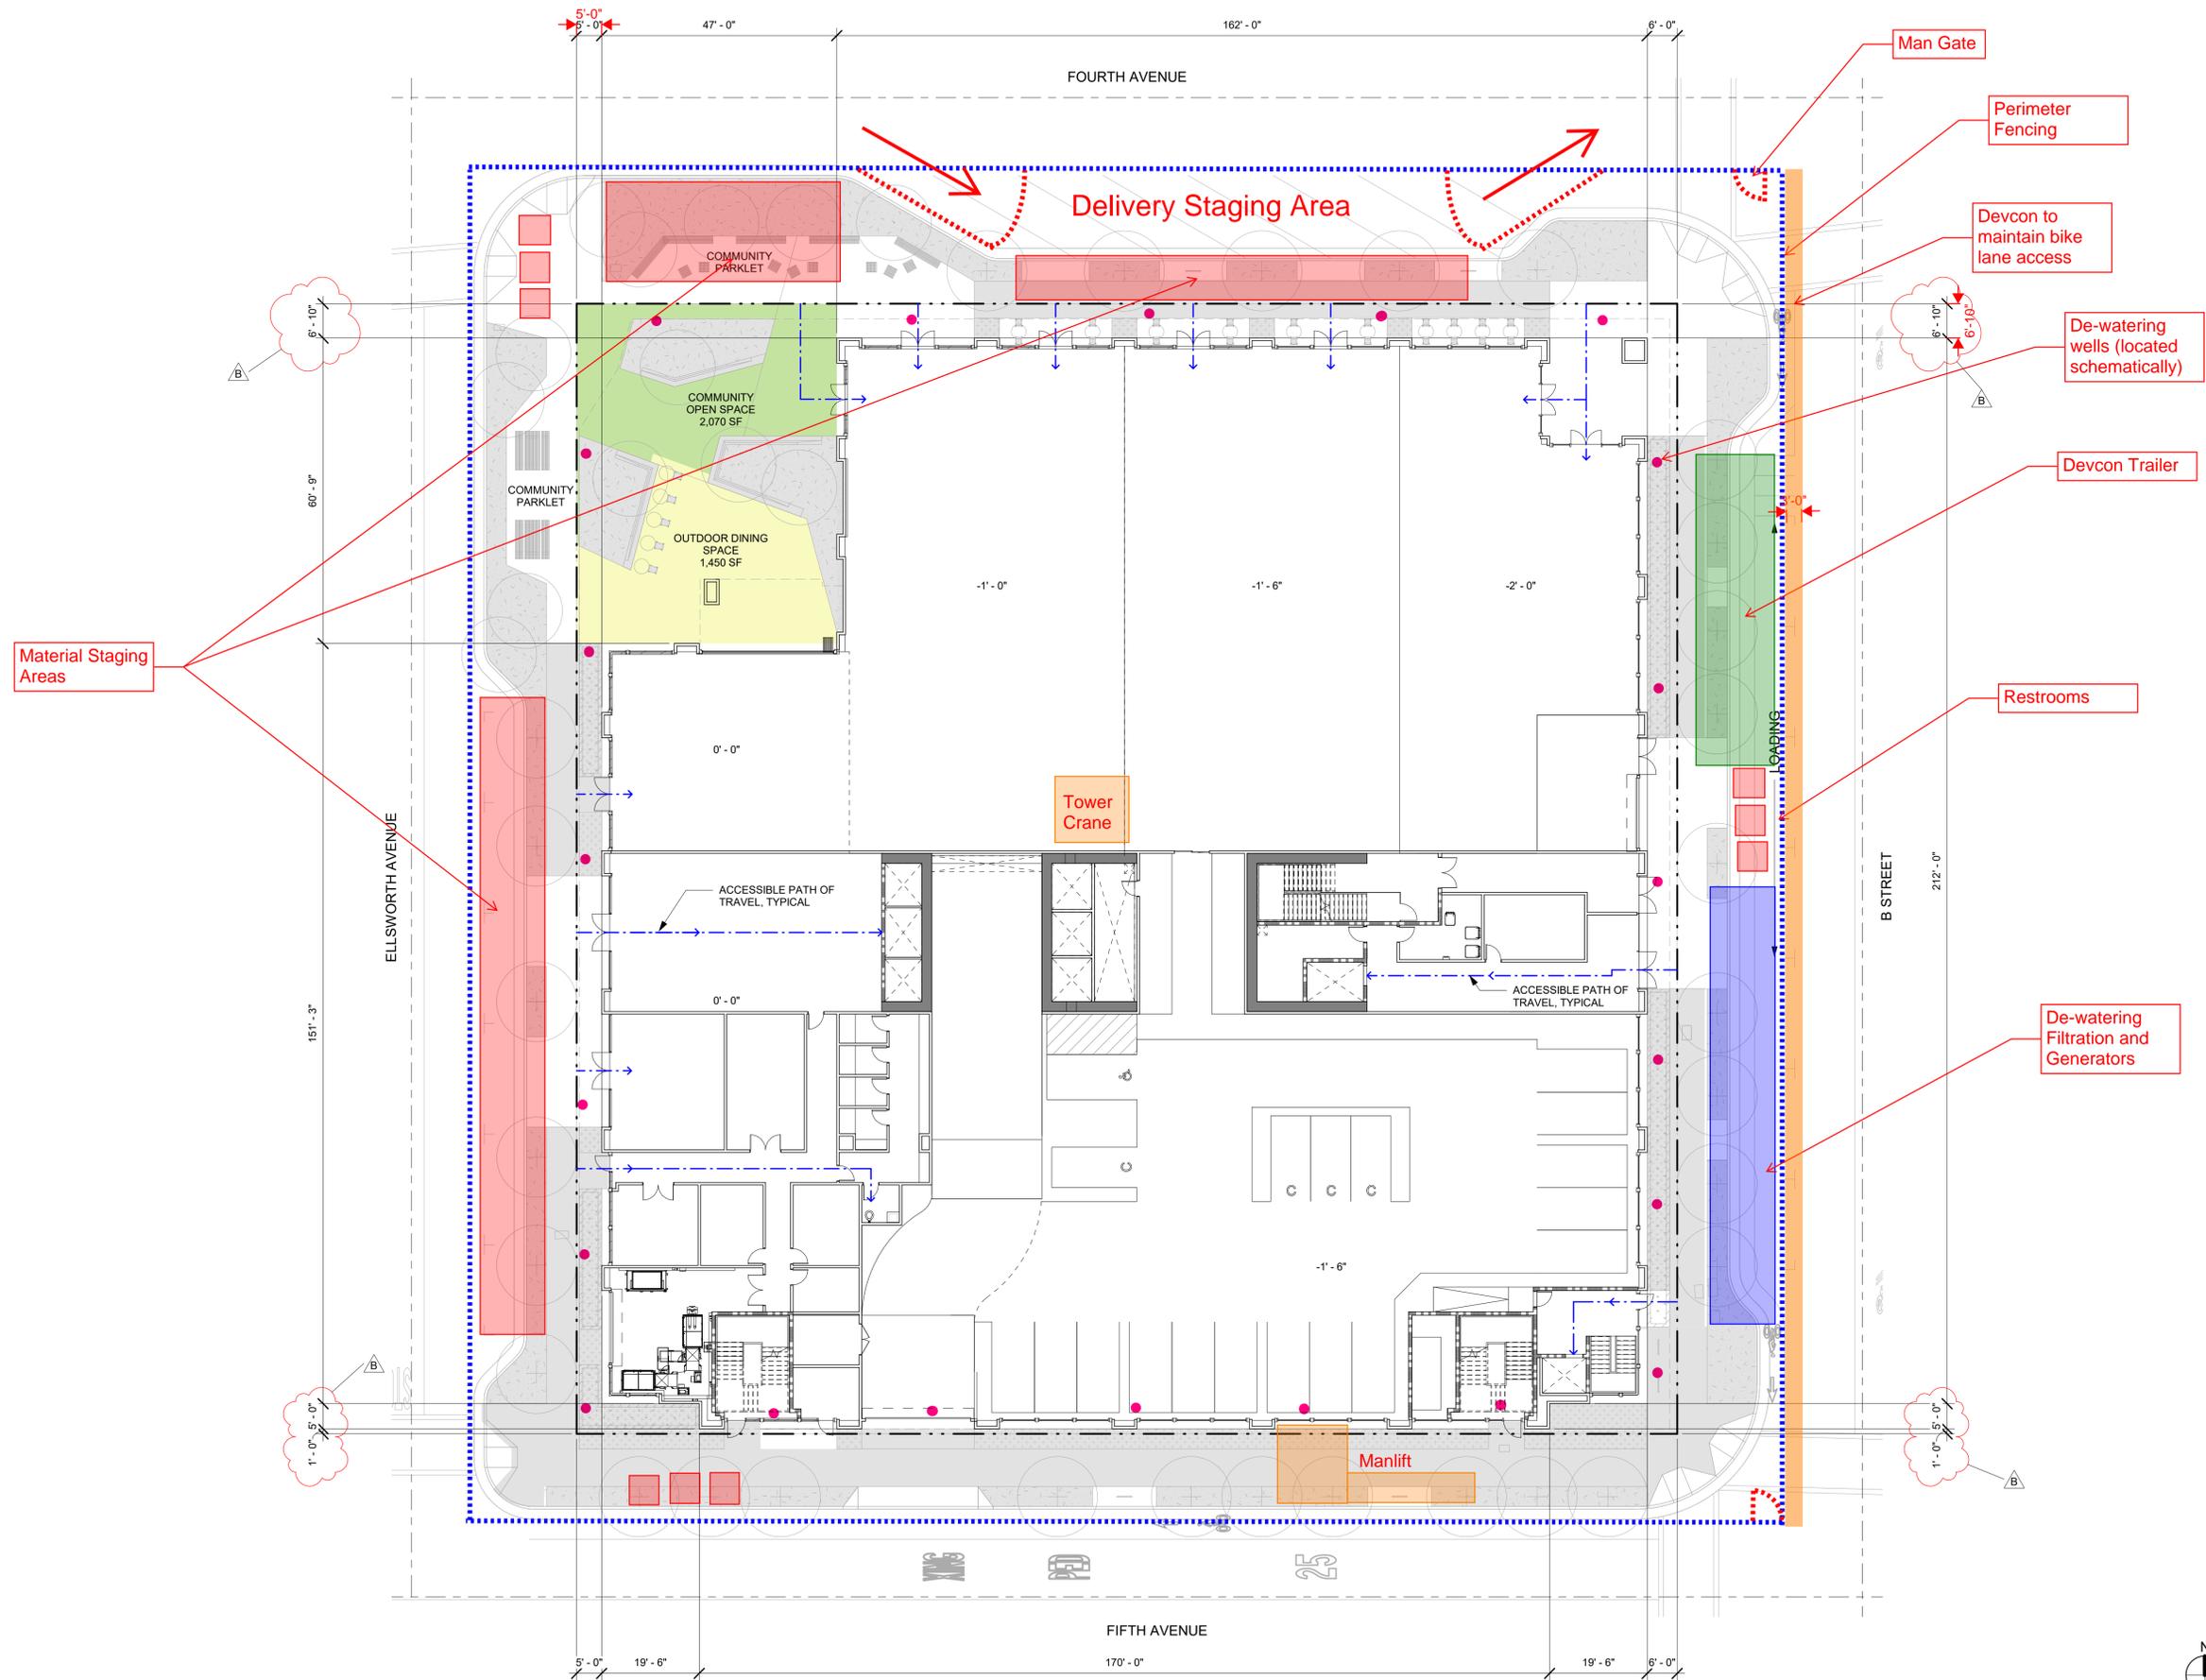

1 LEVEL 1 SITE PLAN
1/16" = 1'-0"

ISSUES AND REVISIONS

No.	Date	Description
A	5/5/20	Pre-Application Set
B	10/21/20	Pre-App Resubmittal
C	03/19/21	Pre-App Resubmittal

PROJECT NUMBER
16010.00


SHEET TITLE
SITE PLAN

SCALE
1/16" = 1'-0"

SHEET NUMBER

DEV-101



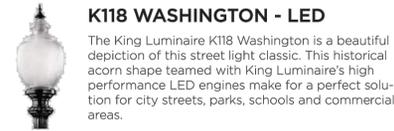

K118 WASHINGTON - LED

The King Luminaire K118 Washington is a beautiful depiction of this street light classic. This historical acorn shape teamed with King Luminaire's high performance LED engines make for a perfect solution for city streets, parks, schools and commercial areas.



PRODUCT SPECIFICATIONS

R1/B3/82 LED ENGINE
Light engine shall be an array of 36, 42, 54 or 63 solid state Cree X-Series high power LEDs (light emitting diodes) mounted to a multi-sided, vertical heat sink of highly conductive aluminum. The LEDs emitters are mounted to removable circuit boards such that they are in full thermal contact with the vertical heat sink. The vertical heat sink is open at the bottom and vented at the top to provide appropriate dynamic airflow cooling for the LED array. The emitters are arranged in various patterns on each face of the vertical heat sink to provide the required light distribution.

The LED arrays include optical baffles constructed of optical grade ABS plastic with a vacuum metallized reflective surface or clear acrylic precision reflectors over each diode. Optical options are designed to efficiently control light distribution in IESNA Type IV & V for the B3/82 and Type III & IV for the R1.

PA LED ENGINE
Light engine shall include an array of Cree X-Series high power LEDs (light emitting diodes). The emitters shall be mounted to a metal core circuit board using SMT technology. The LEDs and circuit boards shall then be mounted to a high performance heat sink.

External light control shall consist of high precision reflective lenses mounted above the LED emitter arrays in such a way to achieve optimum uplight control. The lenses shall also control horizontal light distribution to that other Type II, III, IV or V IESNA distribution patterns are achieved.

LUMINAIRE CONSTRUCTION
All K118 Washington cast components shall consist of a heavy cast aluminum. The main body or capital acts as an enclosure for the driver assembly and is of adequate thickness to give sufficient structural rigidity. The capital shall have an opening at the base to allow the luminaire to be mounted to a tenon of 3/4" maximum diameter. The luminaire shall be locked in place by means of heavy duty, stainless steel set-screws.

LUMEN MAINTENANCE
The protective globe shall be molded of either, rippled polycarbonate Miles Makrolon GP/OP Thermoplastic Polymer or equivalent, or rippled acrylic Acrylite Plus Acrylic Polymer, or equivalent, having a minimum thickness of 0.125".

The globe assembly is a self-contained unit consisting of the globe, rugged cast, locking ring and the LED light engine and optical control. The LED light engine is of a modular design, and is able to be quickly removed from the globe assembly. The globe assembly is secured to a spring-tensioned, twist-locking Rotolock™ unit to allow tool-less removal of the globe, while maintaining a secure seal between the globe assembly and the main body of the luminaire, making the K118 Washington suitable for an outdoor environment.

DRIVER
The LED universal dimmable driver will be class 2 and capable of core circuit board using SMT technology. The driver shall be capable of 120V - 277V or 347V - 480V input voltage, greater than 0.9 power factor, less than 20% total harmonic distortion. The case temperature of the driver can range from -40°C up to 70°C. Each LED system comes with a standard surge protection designed to withstand up to 20kV/10kA of transient line surge as per IEEE C62.41.2 C High. An in-line ferrite choke is utilized to provide protection against EFT's. The driver assembly will be mounted on a heavy duty fabricated galvanized steel bracket to allow complete tool-less maintenance. Dimming capable using 1-10vdc, 0/10% to 100%, 10V PWM, or resistance.

PHOTOMETRICS
Fixtures are tested to IESNA LM79 specifications. These reports are available upon request.

CHROMATICITY
High output LEDs come standard

at 3000K & 4000K (+/- 300K) with a minimum nominal 70 CRI. Additional CCT emitters are available upon request.

WIRING
All internal wiring and connections shall be completed so that it will be necessary only to attach the incoming supply connectors to Male-N-Lok connectors or to a terminal block. Male-N-Lok shall be certified for 600V operation. Internal wire connectors shall be crimp connector only and rated at 1000V and 150°C. All wiring to be CSA certified and/or UL listed, No. 14 gauge, 150°C, 600V, and color coded for the required voltage.

THERMALS
Fixtures tested by a DOE sanctioned test facility to determine the maximum in-situ solder-point or junction-point temperatures of the LED emitters. This report is available upon request.

FINISH
Housing is finished with a 13 step KingCoat™ SuperDurable poly-ester TGIC powder coat. Standard colors include strobe white, brown metal, marine blue, galle gray, Chicago bronze, standard gold, standard black, federal green and rain forest. Please see our website for a complete list of colors. RAL and custom color matches are available.

MISCELLANEOUS
All exterior hardware and fasteners, wholly or partly exposed, shall be stainless steel alloy. All internal fasteners are stainless steel or zinc coated steel. All remaining internal hardware is stainless steel, aluminum alloy, or zinc coated steel.

WARRANTY
The K118 Washington LED luminaire comes with a 7 year limited warranty.

TYPE-P1

CERTIFICATION:
CSA US Listed
Suitable for wet locations
IEC 9001
IMPS
ARRA Compliant
LM79 I LM80 Compliant

DRIVER INFO:
>0.9 Power Factor
<20% Total Harmonic Distortion
120V - 277V or 347V - 480V
>40°C Min. Case Temperature
70°C Max. Case Temperature
Surge Protection: ANSI C136.2
Extreme level 20kV/10kA
Dimming Capable: 1-10vdc

EPA:
1.52 sq. ft.

FIXTURE WEIGHT:
38 lbs

NEW CONSTRUCTION
Mounting Length: 6-11" or 20"


RETIROFIT
Mounting Length: 7-11" or 20"

CEILING THICKNESS	CEILING CUTOUT	NEW CONSTRUCTION	RETIROFIT
1 1/2" to 1 5/8"	6-11" square	Minimum 3/4" (not required)	Existing hole or new hole (not required)

RATINGS / CERTIFICATIONS	NC	RET	IC	ICAT	CP
Type name/C	✓	✓	✓	✓	✓
Type IC	✓	✓	✓	✓	✓
Chicago Plenum (CP)	✓	✓	✓	✓	✓
Substituted for an existing luminaire	✓	✓	✓	✓	✓
Reduced surface temp (ASTM E888)	✓	✓	✓	✓	✓

LED INFO
- SEDCM = 1x2 MacAdam Ellipse, Day +/- 0.001, Lumen Maintenance: L₇₀ = 65,000 hrs

NU6" Square Downlight Xicato

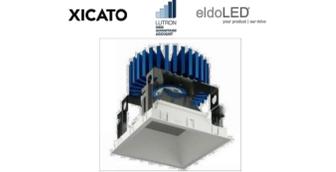

DESCRIPTION
The NU600 6" recessed downlight by ALPHABET offers multiple cutting edge LED technologies, premium performance, thoughtful construction and pleasing aesthetics. Offered standard with premium dimming using EddLED 1% flicker free drivers 120V-277V universal voltage. Also offered 347V. A minimalist look is achieved with an ultrathin 1/16" trim that is only 5/16" wide. Color choices of both trim and bezel are offered for a customized look. Several beam angles and LITEOPTICS available, plus an optional high-efficiency BrightView diffused lens for smooth light distribution and obscured LED image.

HOUSING
Electrocoated 16-gauge cold-rolled steel provides enhanced structural reinforcement and rust prevention. Superior, UL-certified, injection-molded commercial-grade Lexan™ (PC) is used for the frame and recessed bezel trim. Lexan provides unmatched durability and impact resistance, and is tested for UV resistance and water exposure in outdoor applications. The thermally-advanced, anodized heat sink uses 6063 aluminum alloy. Heat location related to offered standard. A 90-minute constant-power IOTA emergency battery backup is available.

INSTALLATION
An advanced mounting system allows for quick and secure installation with LED and driver accessibility from below the ceiling. The LED assembly uses die-cast aluminum mounting clamp grips (MCG) that swing out to lighten onto variable ceiling thicknesses. Integrated rubber feet on each MCG provide a non-slip vibration-resistant installation. The hidden MCG system is accessible from below ceiling by removing the snap-in lens/bezel assembly with either the included suction cup or a screwdriver blade. Integrated bar hangers feature integral toothed nails, T-bar mounting slots with locking tabs for pilot positioning. Removable mounting option allows for installation from below ceiling by use of compact driver box. No risk damaging LED or bezel assembly during installation. Bezel are installed during last steps. Fixture and driver are easily removed for servicing after install without damaging drywall.

CEILING THICKNESS	CEILING CUTOUT	NEW CONSTRUCTION	RETIROFIT
1 1/2" to 1 5/8"	6-11" square	Minimum 3/4" (not required)	Existing hole or new hole (not required)

RATINGS / CERTIFICATIONS	NC	RET	IC	ICAT	CP
Type name/C	✓	✓	✓	✓	✓
Type IC	✓	✓	✓	✓	✓
Chicago Plenum (CP)	✓	✓	✓	✓	✓
Substituted for an existing luminaire	✓	✓	✓	✓	✓
Reduced surface temp (ASTM E888)	✓	✓	✓	✓	✓

LED INFO
- SEDCM = 1x2 MacAdam Ellipse, Day +/- 0.001, Lumen Maintenance: L₇₀ = 65,000 hrs

SERIES	NU6
TYPE	QD square downlight
LED	XTM19 Xicato XTM 19mm
DELIVERED LUMENS	67LM 660 lm 131LM 1320 lm 201LM 1980 lm 271LM 2640 lm 341LM 3180 lm 411LM 4020 lm
CCT	27K 2700K 327K 3270K beauty 35K 3500K 38K 3800K vibrant 40K 4000K
CRI	83 83 CRI 90 90 CRI
REFLECTOR & MULTIPPLIER	HET3 70" high efficiency diffused lens (0.93) HE85 85" high efficiency diffused lens (0.96) D75 65" specular with clear lens (0.97) WH80 80" diffused with clear lens (0.93) WH90 90" brilliant white with clear lens (1.00)
NO LENS OPTION	NL ¹ no lens
VOLTAGE	120V 120V 180V 180V 277V 277V
DIMMING	DM1P 1% EddLED flicker free 0-10V dimming to 1% DM1S2 2% EddLED flicker free 0-10V dimming to 2% DM1S3 3% EddLED flicker free 0-10V dimming to 3% DM1S4 4% EddLED flicker free 0-10V dimming to 4% DM1S5 5% EddLED flicker free 0-10V dimming to 5% DM1S6 6% EddLED flicker free 0-10V dimming to 6% DM1S7 7% EddLED flicker free 0-10V dimming to 7% DM1S8 8% EddLED flicker free 0-10V dimming to 8% DM1S9 9% EddLED flicker free 0-10V dimming to 9% DM1S10 10% EddLED flicker free 0-10V dimming to 10% DM1S11 11% EddLED flicker free 0-10V dimming to 11% DM1S12 12% EddLED flicker free 0-10V dimming to 12% DM1S13 13% EddLED flicker free 0-10V dimming to 13% DM1S14 14% EddLED flicker free 0-10V dimming to 14% DM1S15 15% EddLED flicker free 0-10V dimming to 15% DM1S16 16% EddLED flicker free 0-10V dimming to 16% DM1S17 17% EddLED flicker free 0-10V dimming to 17% DM1S18 18% EddLED flicker free 0-10V dimming to 18% DM1S19 19% EddLED flicker free 0-10V dimming to 19% DM1S20 20% EddLED flicker free 0-10V dimming to 20% DM1S21 21% EddLED flicker free 0-10V dimming to 21% DM1S22 22% EddLED flicker free 0-10V dimming to 22% DM1S23 23% EddLED flicker free 0-10V dimming to 23% DM1S24 24% EddLED flicker free 0-10V dimming to 24% DM1S25 25% EddLED flicker free 0-10V dimming to 25% DM1S26 26% EddLED flicker free 0-10V dimming to 26% DM1S27 27% EddLED flicker free 0-10V dimming to 27% DM1S28 28% EddLED flicker free 0-10V dimming to 28% DM1S29 29% EddLED flicker free 0-10V dimming to 29% DM1S30 30% EddLED flicker free 0-10V dimming to 30% DM1S31 31% EddLED flicker free 0-10V dimming to 31% DM1S32 32% EddLED flicker free 0-10V dimming to 32% DM1S33 33% EddLED flicker free 0-10V dimming to 33% DM1S34 34% EddLED flicker free 0-10V dimming to 34% DM1S35 35% EddLED flicker free 0-10V dimming to 35% DM1S36 36% EddLED flicker free 0-10V dimming to 36% DM1S37 37% EddLED flicker free 0-10V dimming to 37% DM1S38 38% EddLED flicker free 0-10V dimming to 38% DM1S39 39% EddLED flicker free 0-10V dimming to 39% DM1S40 40% EddLED flicker free 0-10V dimming to 40% DM1S41 41% EddLED flicker free 0-10V dimming to 41% DM1S42 42% EddLED flicker free 0-10V dimming to 42% DM1S43 43% EddLED flicker free 0-10V dimming to 43% DM1S44 44% EddLED flicker free 0-10V dimming to 44% DM1S45 45% EddLED flicker free 0-10V dimming to 45% DM1S46 46% EddLED flicker free 0-10V dimming to 46% DM1S47 47% EddLED flicker free 0-10V dimming to 47% DM1S48 48% EddLED flicker free 0-10V dimming to 48% DM1S49 49% EddLED flicker free 0-10V dimming to 49% DM1S50 50% EddLED flicker free 0-10V dimming to 50% DM1S51 51% EddLED flicker free 0-10V dimming to 51% DM1S52 52% EddLED flicker free 0-10V dimming to 52% DM1S53 53% EddLED flicker free 0-10V dimming to 53% DM1S54 54% EddLED flicker free 0-10V dimming to 54% DM1S55 55% EddLED flicker free 0-10V dimming to 55% DM1S56 56% EddLED flicker free 0-10V dimming to 56% DM1S57 57% EddLED flicker free 0-10V dimming to 57% DM1S58 58% EddLED flicker free 0-10V dimming to 58% DM1S59 59% EddLED flicker free 0-10V dimming to 59% DM1S60 60% EddLED flicker free 0-10V dimming to 60% DM1S61 61% EddLED flicker free 0-10V dimming to 61% DM1S62 62% EddLED flicker free 0-10V dimming to 62% DM1S63 63% EddLED flicker free 0-10V dimming to 63% DM1S64 64% EddLED flicker free 0-10V dimming to 64% DM1S65 65% EddLED flicker free 0-10V dimming to 65% DM1S66 66% EddLED flicker free 0-10V dimming to 66% DM1S67 67% EddLED flicker free 0-10V dimming to 67% DM1S68 68% EddLED flicker free 0-10V dimming to 68% DM1S69 69% EddLED flicker free 0-10V dimming to 69% DM1S70 70% EddLED flicker free 0-10V dimming to 70% DM1S71 71% EddLED flicker free 0-10V dimming to 71% DM1S72 72% EddLED flicker free 0-10V dimming to 72% DM1S73 73% EddLED flicker free 0-10V dimming to 73% DM1S74 74% EddLED flicker free 0-10V dimming to 74% DM1S75 75% EddLED flicker free 0-10V dimming to 75% DM1S76 76% EddLED flicker free 0-10V dimming to 76% DM1S77 77% EddLED flicker free 0-10V dimming to 77% DM1S78 78% EddLED flicker free 0-10V dimming to 78% DM1S79 79% EddLED flicker free 0-10V dimming to 79% DM1S80 80% EddLED flicker free 0-10V dimming to 80% DM1S81 81% EddLED flicker free 0-10V dimming to 81% DM1S82 82% EddLED flicker free 0-10V dimming to 82% DM1S83 83% EddLED flicker free 0-10V dimming to 83% DM1S84 84% EddLED flicker free 0-10V dimming to 84% DM1S85 85% EddLED flicker free 0-10V dimming to 85% DM1S86 86% EddLED flicker free 0-10V dimming to 86% DM1S87 87% EddLED flicker free 0-10V dimming to 87% DM1S88 88% EddLED flicker free 0-10V dimming to 88% DM1S89 89% EddLED flicker free 0-10V dimming to 89% DM1S90 90% EddLED flicker free 0-10V dimming to 90% DM1S91 91% EddLED flicker free 0-10V dimming to 91% DM1S92 92% EddLED flicker free 0-10V dimming to 92% DM1S93 93% EddLED flicker free 0-10V dimming to 93% DM1S94 94% EddLED flicker free 0-10V dimming to 94% DM1S95 95% EddLED flicker free 0-10V dimming to 95% DM1S96 96% EddLED flicker free 0-10V dimming to 96% DM1S97 97% EddLED flicker free 0-10V dimming to 97% DM1S98 98% EddLED flicker free 0-10V dimming to 98% DM1S99 99% EddLED flicker free 0-10V dimming to 99% DM1S100 100% EddLED flicker free 0-10V dimming to 100%

CEILING THICKNESS	CEILING CUTOUT	NEW CONSTRUCTION	RETIROFIT
1 1/2" to 1 5/8"	6-11" square	Minimum 3/4" (not required)	Existing hole or new hole (not required)

RATINGS / CERTIFICATIONS	NC	RET	IC	ICAT	CP
Type name/C	✓	✓	✓	✓	✓
Type IC	✓	✓	✓	✓	✓
Chicago Plenum (CP)	✓	✓	✓	✓	✓
Substituted for an existing luminaire	✓	✓	✓	✓	✓
Reduced surface temp (ASTM E888)	✓	✓	✓	✓	✓

LED INFO
- SEDCM = 1x2 MacAdam Ellipse, Day +/- 0.001, Lumen Maintenance: L₇₀ = 65,000 hrs

CEILING THICKNESS	CEILING CUTOUT	NEW CONSTRUCTION	RETIROFIT
1 1/2" to 1 5/8"	6-11" square	Minimum 3/4" (not required)	Existing hole or new hole (not required)

RATINGS / CERTIFICATIONS	NC	RET	IC	ICAT	CP
Type name/C	✓	✓	✓	✓	✓
Type IC	✓	✓	✓	✓	✓
Chicago Plenum (CP)	✓	✓	✓	✓	✓
Substituted for an existing luminaire	✓	✓	✓	✓	✓
Reduced surface temp (ASTM E888)	✓	✓	✓	✓	✓

LED INFO
- SEDCM = 1x2 MacAdam Ellipse, Day +/- 0.001, Lumen Maintenance: L₇₀ = 65,000 hrs

ENERGY STAR - ORDERING CODE

SERIES	NU6
TYPE	QD square downlight
LED	XTM19 Xicato XTM 19mm
DELIVERED LUMENS	67LM 660 lm 131LM 1320 lm 201LM 1980 lm 271LM 2640 lm 341LM 3180 lm 411LM 4020 lm
CCT	27K 2700K 327K 3270K beauty 35K 3500K 38K 3800K vibrant 40K 4000K
CRI	83 83 CRI 90 90 CRI
REFLECTOR & MULTIPPLIER	HET3 70" high efficiency diffused lens (0.93) HE85 85" high efficiency diffused lens (0.96) D75 65" specular with clear lens (0.97) WH80 80" diffused with clear lens (0.93) WH90 90" brilliant white with clear lens (1.00)
VOLTAGE	120V 120V 180V 180V 277V 277V
DIMMING	DM1P 1% EddLED flicker free 0-10V dimming to 1% DM1S2 2% EddLED flicker free 0-10V dimming to 2% DM1S3 3% EddLED flicker free 0-10V dimming to 3% DM1S4 4% EddLED flicker free 0-10V dimming to 4% DM1S5 5% EddLED flicker free 0-10V dimming to 5% DM1S6 6% EddLED flicker free 0-10V dimming to 6% DM1S7 7% EddLED flicker free 0-10V dimming to 7% DM1S8 8% EddLED flicker free 0-10V dimming to 8% DM1S9 9% EddLED flicker free 0-10V dimming to 9% DM1S10 10% EddLED flicker free 0-10V dimming to 10% DM1S11 11% EddLED flicker free 0-10V dimming to 11% DM1S12 12% EddLED flicker free 0-10V dimming to 12% DM1S13 13% EddLED flicker free 0-10V dimming to 13% DM1S14 14% EddLED flicker free 0-10V dimming to 14% DM1S15 15% EddLED flicker free 0-10V dimming to 15% DM1S16 16% EddLED flicker free 0-10V dimming to 16% DM1S17 17% EddLED flicker free 0-10V dimming to 17% DM1S18 18% EddLED flicker free 0-10V dimming to 18% DM1S19 19% EddLED flicker free 0-10V dimming to 19% DM1S20 20% EddLED flicker free 0-10V dimming to 20% DM1S21 21% EddLED flicker free 0-10V dimming to 21% DM1S22 22% EddLED flicker free 0-10V dimming to 22% DM1S23 23% EddLED flicker free 0-10V dimming to 23% DM1S24 24% EddLED flicker free 0-10V dimming to 24% DM1S25 25% EddLED flicker free 0-10V dimming to 25% DM1S26 26% EddLED flicker free 0-10V dimming to 26% DM1S27 27% EddLED flicker free 0-10V dimming to 27% DM1S28 28% EddLED flicker free 0-10V dimming to 28% DM1S29 29% EddLED flicker free 0-10V dimming to 29% DM1S30 30% EddLED flicker free 0-10V dimming to 30% DM1S31 31% EddLED flicker free 0-10V dimming to 31% DM1S32 32% EddLED flicker free 0-10V dimming to 32% DM1S33 33% EddLED flicker free 0-10V dimming to 33% DM1S34 34% EddLED flicker free 0-10V dimming to 34% DM1S35 35% EddLED flicker free 0-10V dimming to 35% DM1S36 36% EddLED flicker free 0-10V dimming to 36% DM1S37 37% EddLED flicker free 0-10V dimming to 37% DM1S38 38% EddLED flicker free 0-10V dimming to 38% DM1S39 39% EddLED flicker free 0-10V dimming to 39% DM1S40 40% EddLED flicker free 0-10V dimming to 40% DM1S41 41% EddLED flicker free 0-10V dimming to 41% DM1S42 42% EddLED flicker free 0-10V dimming to 42% DM1S43 43% EddLED flicker free 0-10V dimming to 43% DM1S44 44% EddLED flicker free 0-10V dimming to 44% DM1S45 45% EddLED flicker free 0-10V dimming to 45% DM1S46 46% EddLED flicker free 0-10V dimming to 46% DM1S47 47% EddLED flicker free 0-10V dimming to 47% DM1S48 48% EddLED flicker free 0-10V dimming to 48% DM1S49 49% EddLED flicker free 0-10V dimming to 49% DM1S50 50% EddLED flicker free 0-10V dimming to 50% DM1S51 51% EddLED flicker free 0-10V dimming to 51% DM1S52 52% EddLED flicker free 0-10V dimming to 52% DM1S53 53% EddLED flicker free 0-10V dimming to 53% DM1S54 54% EddLED flicker free 0-10V dimming to 54% DM1S55 55% EddLED flicker free 0-10V dimming to 55% DM1S56 56% EddLED flicker free 0-10V dimming to 56% DM1S57 57% EddLED flicker free 0-10V dimming to 57% DM1S58 58% EddLED flicker free 0-10V dimming to 58% DM1S59 59% EddLED flicker free 0-10V dimming to 59% DM1S60 60% EddLED flicker free 0-10V dimming to 60% DM1S61 61% EddLED flicker free 0-10V dimming to 61% DM1S62 62% EddLED flicker free 0-10V dimming to 62% DM1S63 63% EddLED flicker free 0-10V dimming to 63% DM1S64 64% EddLED flicker free 0-10V dimming to 64% DM1S65 65% EddLED flicker free 0-10V dimming to 65% DM1S66 66% EddLED flicker free 0-10V dimming to 66% DM1S67 67% EddLED flicker free 0-10V dimming to 67% DM1S68 68% EddLED flicker free 0-10V dimming to 68% DM1S69 69% EddLED flicker free 0-10V dimming to 69% DM1S70 70% EddLED flicker free 0-10V dimming to 70% DM1S71 71% EddLED flicker free 0-10V dimming to 71% DM1S72 72% EddLED flicker free 0-10V dimming to 72% DM1S73 73% EddLED flicker free 0-10V dimming to 73% DM1S74 74% EddLED flicker free 0-10V dimming to 74% DM1S75 75% EddLED flicker free 0-10V dimming to 75% DM1S76 76% EddLED flicker free 0-10V dimming to 76% DM1S77 77% EddLED flicker free 0-10V dimming to 77% DM1S78 78% EddLED flicker free 0-10V dimming to 78% DM1S79 79% EddLED flicker free 0-10V dimming to 79% DM1S80 80% EddLED flicker free 0-10V dimming to 80% DM1S81 81% EddLED flicker free 0-10V dimming to 81% DM1S82 82% EddLED flicker free 0-10V dimming to 82% DM1S83 83% EddLED flicker free 0-10V dimming to 83% DM1S84 84% EddLED flicker free 0-10V dimming to 84% DM1S85 85% EddLED flicker free 0-

75 LED Narrow Strip

TYPE-B

FIXTURE PERFORMANCE DATA


LED PACKAGE	MOUNTAGE	75 (NO LENS)			75R & 75S			LUMEN MAINTENANCE			AMBIENT TEMPERATURE ¹	
		DELIVERED LUMENS	EFFICACY (lm/W)	DELIVERED LUMENS	EFFICACY (lm/W)	L70	L80	L90	LM	NO LM		
L15	3x3	1592	147.5	1911	140.1	>72000	>72000	>72000	50,000	40	40	
L25	1x2	2652	142.7	2470	135.5	>72000	>72000	>72000	50,000	40	40	
L32	2x3	3092	155.5	2936	138.1	>72000	>72000	>72000	58,000	36,000	40	
L42	3x4	4344	138.8	4124	115.5	>72000	>72000	>72000	58,000	36,000	35	
L60	4x3.6	6052	138.9	—	—	>72,000	53,000	38,000	24,000	—	—	
L40	2x2	4092	145.2	3885	137.9	>72000	>72000	>72000	58,000	36,000	35	
L64	4x2	6593	136.9	6259	130.0	>72,000	53,000	38,000	24,000	30	35	
L30	1x3	3071	155.8	2916	147.9	>72000	>72000	>72000	50,000	40	40	
L50	3x3	5126	155.5	4867	147.6	>72000	>72000	>72000	50,000	40	40	
L65	4x3	6393	149.3	5994	141.7	>72000	>72000	>72000	58,000	36,000	40	
L85	5x2	8530	151.7	8098	144.0	>72,000	53,000	38,000	24,000	35	40	
L100	6x3	10164	148.8	9660	141.2	>72000	>72000	>72000	58,000	36,000	30	
L120	8x3	12105	141.0	—	—	>72,000	53,000	38,000	24,000	—	—	
L60	2x3	5874	154.9	5520	156.6	>72000	>72000	>72000	50,000	40	40	
L100	6x3	10078	152.9	9568	146.1	>72000	>72000	>72000	50,000	35	35	
L120	8x3	12011	148.1	11353	140.6	>72000	>72000	>72000	58,000	36,000	35	
L170	12x4	17060	151.7	16197	144.0	>72,000	53,000	38,000	24,000	35	35	
L200	15x5	20309	148.8	19281	141.2	>72000	>72000	>72000	58,000	36,000	30	
L240	17x7	24209	141.0	—	—	>72,000	53,000	38,000	24,000	—	—	

MULTIPLIER TABLE

CCX	CONVERSION FACTOR
2700K	0.97
3000K	0.99
3500K	1.00
4000K	1.03
5000K	1.06

PHOTOMETRY

75-4-L85-R35-DIM Total Luminaire Output: 8530 lumens; 56.2 Watts | Efficacy: 152 lm/W | 80 CR; 3500K CCT




VERTICAL ANGLE	HORIZONTAL ANGLE	ZONAL LUMENS
0	0°	0
5	2917	2876
10	2837	2799
15	2663	2624
20	2475	2366
25	2265	2106
30	2044	1850
35	1814	1600
40	1576	1357
45	1331	1122
50	1080	895
55	834	676
60	594	464
65	359	259
70	129	61
75	0	0
80	0	0
85	0	0
90	0	0

75 LED Narrow Strip

TYPE-B


75R-4-L85-R35 Total Luminaire Output: 8098 lumens; 56.2 Watts | Efficacy: 144 lm/W | 80 CR; 3500K CCT



VERTICAL ANGLE	HORIZONTAL ANGLE	ZONAL LUMENS
0	0°	0
5	2554	2594
10	2422	2463
15	2263	2297
20	2076	2104
25	1875	1902
30	1661	1684
35	1435	1451
40	1200	1205
45	957	947
50	708	697
55	455	445
60	200	190
65	75	75
70	0	0
75	0	0
80	0	0
85	0	0
90	0	0
95	0	0
100	0	0
105	0	0
110	0	0
115	0	0
120	0	0
125	0	0
130	0	0
135	0	0
140	0	0
145	0	0
150	0	0
155	0	0
160	0	0
165	0	0
170	0	0
175	0	0
180	0	0

ZONE	LUMENS	% FIXTURE
0 - 30	2008	25
0 - 40	2772	40
0 - 50	3487	50
0 - 60	4151	60
0 - 70	4774	70
0 - 80	5356	80
0 - 90	5898	90
0 - 180	8098	100

75S-4-L85-R35 Total Luminaire Output: 8098 lumens; 56.2 Watts | Efficacy: 144 lm/W | 80 CR; 3500K CCT



VERTICAL ANGLE	HORIZONTAL ANGLE	ZONAL LUMENS
0	2732	2732
5	2736	2736
10	2633	2633
15	2511	2511
20	2371	2371
25	2213	2213
30	2037	2037
35	1845	1845
40	1638	1638
45	1417	1417
50	1183	1183
55	947	947
60	709	709
65	468	468
70	224	224
75	0	0
80	0	0
85	0	0
90	0	0
95	0	0
100	0	0
105	0	0
110	0	0
115	0	0
120	0	0
125	0	0
130	0	0
135	0	0
140	0	0
145	0	0
150	0	0
155	0	0
160	0	0
165	0	0
170	0	0
175	0	0
180	0	0

ZONE	LUMENS	% FIXTURE
0 - 30	2279	27
0 - 40	3321	41
0 - 50	4222	52
0 - 60	4983	61
0 - 70	5607	70
0 - 80	6100	79
0 - 90	6562	86
0 - 180	8098	100

75 LED Narrow Strip

TYPE-B

CONTROL DETAILS

SENSOR PLACEMENT


AVI-LVFA-PIR LV-ZLS05-1W5-FSP | VDO



AVI-LVFA-PIR

SPECIFICATIONS	
TYPE	PIR Motion + Daylight
MOUNTING HEIGHT	8" - 45"
LENS	Single lens detects high and low bay motion.
DETECTION ANGLE	360°
TEMPERATURE RANGE	-30° to 70°C
RELATIVE HUMIDITY	90 to 95% at 30°C
COMMISSIONING	App (iOS or Android)
SYSTEM REQUIREMENTS	Aut-On wireless future controls plus desktop and mobile apps
MANUFACTURER	Aut-On


SENSOR COVERAGE PATTERNS



VDO

SPECIFICATIONS	
TYPE	PIR Motion + Daylight
MOUNTING HEIGHT	8" - 12"
DETECTION ANGLE	360°
TEMPERATURE RANGE	0° to 55°C
RELATIVE HUMIDITY	0 to 90%, non-condensing
COMMISSIONING	App (iOS or Android)
MANUFACTURER	Lutron

SENSOR COVERAGE PATTERNS



VIVE CONTROL OPTIONS

CATALOG NUMBER	DESCRIPTION
VDO	Lutron Vive integral fixture control, RF with daylight and occupancy sensor (DFCS-1-DEM-OC), for use with sensor-ready driver
VDF	Lutron Vive integral fixture control, RF only (DFCS-1-DEM-RF), for use with sensor-ready driver
VDO/BI	Lutron Vive integral fixture control, RF with daylight and occupancy sensor (DFCS-1-DEM-OC) and digital link interface, for use with Lutron Hi-Kume T5 EcoSystem dimming LED driver
VDF/BI	Lutron Vive integral fixture control, RF only (DFCS-1-DEM-RF) and digital link interface, for use with Lutron Hi-Kume T5 EcoSystem dimming LED driver



ISSUES AND REVISIONS

No.	Date	Description
A	2/14/20	Pre-Application Set

PROJECT NUMBER
16010.00

SHEET TITLE
LIGHT FIXTURE
CUT SHEETS

SCALE

SHEET NUMBER

EP-3


75 LED Narrow Strip

TYPE-B

LV-OSFHU-1W-120-347

SPECIFICATIONS	
TYPE	PIR Motion
MOUNTING HEIGHT	8" - 40"
LENS	Interchangeable high bay, low bay or walk mask
DETECTION ANGLE	360°
TEMPERATURE RANGE	-10° to 70°C
RELATIVE HUMIDITY	20% to 90% non-condensing
MANUFACTURER	Leviton

SENSOR COVERAGE PATTERNS



LV-ZLS05-1LW

SPECIFICATIONS	
TYPE	PIR Motion + Daylight
MOUNTING HEIGHT	8" - 10"
DETECTION ANGLE	120°
TEMPERATURE RANGE	-20° to 70°C
COMMISSIONING	DIP switches or optional remote: ZLS05-RM1
MANUFACTURER	Leviton


SENSOR COVERAGE PATTERNS



WS-FSP-311-L2-120-277

SPECIFICATIONS	
TYPE	PIR Motion + Daylight
MOUNTING HEIGHT	8" - 20"
DETECTION ANGLE	360°
TEMPERATURE RANGE	-40° to 75°C
COMMISSIONING	App (iOS or Android)
MANUFACTURER	Wattsstopper

SENSOR COVERAGE PATTERNS



ADDITIONAL DRIVER OPTIONS

CATALOG NUMBER	DESCRIPTION
DDV	Driver prewired for non-dimming applications
DDM	Dimming driver prewired for 0-10V low voltage applications
DDM1	1% dimming driver prewired for 0-10V low voltage applications
DDM LINE	Line voltage dimming driver (TRAC and ELV compatible, 120V only)
DDM TRC	Line voltage dimming driver (TRAC compatible, 120V only)
DA	Dimming driver with 12V auxiliary
DDR	Sensor-ready driver
SD40	40% step-dimming driver
SD40	50% step-dimming driver
DAU	DAU dimming driver
LVE LINE	Lutron Hi-Kume T5 EcoSystem dimming LED driver
ELDO	ELDO Solochrome, 0.1% dimming driver for 0-10V controls
ELDO SOL08	ELDO Solochrome, 0.1% dimming driver for 0-10V controls
ELDO SOL08 DALI	ELDO Solochrome, 1% dimming driver for DALI controls
ELDO ECO1	ELDO EcoDim, 1% dimming driver for 0-10V controls
ELDO ECO1 DALI	ELDO EcoDim, 1% dimming driver for DALI controls

75 LED Narrow Strip

TYPE-B

CROSS SECTIONS